


The following documents are included with this submittal package.

- Project Narrative
- Comment and Response Log
- Citizen Participation Plan
- Vicinity Zoning Plan
- Overall Site Plan
- Preliminary Grading and Drainage Plan
- Preliminary Fire Department Vicinity Access Plan
- Overall Landscape Plan
- Exterior Elevations
- Building Elevation and Sections: color elevations, floor plans, roof plans, and 3D renderings
- Proposed New Building Drawings
- Photographs of Existing Site
- Photometric Study & Proposed Lighting Fixture Cut Sheet

Project Narrative

The existing City of Mesa Signal Butte Water Treatment Plant (SBWTP) is a 24 million-gallon-per-day (mgd) facility located at 10950 E. Elliot Road (see Location Map below). As part of this project (City Project number CP0372), the SBWTP will be expanded to the planned ultimate nominal capacity of 48 mgd. The perimeter site landscaping will remain unchanged. The original grading and drainage plan was master planned for this expansion and is not anticipated to change.

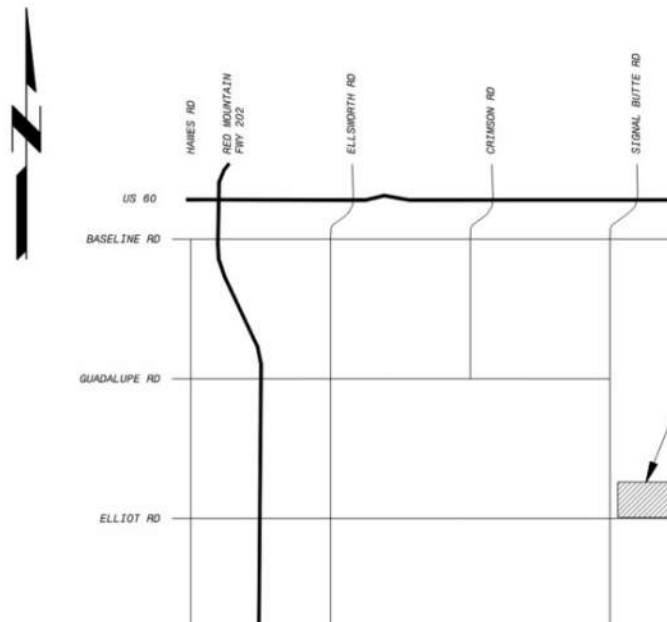

All new facilities included for the Expansion Project are located within the existing perimeter block wall as shown in Figure 2. The one exception is a new overflow structure integral to the second finished water reservoir (SW corner of the site). The new overflow structure will match the existing reservoir overflow structure as shown in Figure 2. The site is located within a secure City facility that is not accessible to the public unless escorted by City Personnel. The new reservoir is mostly buried, projecting approximately 2 feet above grade. The existing sewer from the site's west entrance in Elliot Road will be upsized to Signal Butte Road and extended 1775 ft to the west to connect with other existing infrastructure.

The expansion of the filter complex will match the existing structure height with shade canopies and a footprint of 95 ft x 95 ft, sitting 28" above grade. New stairs will be added as required for egress from the top level. The new filters and other processes on the top level will be protected with pre-engineered metal canopies matching the style of the existing canopies on the Treatment Complex.

A second gravity thickener will be installed to handle the additional solids production. The thickener will be sized to match existing, and sludge will be conveyed to the gravity thickener from the new Sludge Flow Splitter. Thickened sludge will flow to the Thickened Sludge Pump Station and decant from the new thickener will connect to Gravity Thickener No. 1's decant piping prior to flowing to the existing RWB.

A new Storage Building is proposed, which was included in the previous project's approved Overall Site Plan (City Permit No. PLN2015-00077) as a 10,000 SF building, and

will be visible from Elliot Road as simulated in Figure 10. The Storage Building is proposed to be 18'-10" above grade as shown in Figure 2 with a 100 ft x 100 ft footprint. The building will be a pre-engineered metal and concrete building used for storing a tractor, forklift, trailer, and other maintenance equipment.

A new landscaping plan for the Expansion project will not be necessary as the existing landscaping on site will not be modified for the expanded areas of the site. Similarly, a new signage plan will not be necessary as the existing signs on site will not be modified.


MATERIALS AND WALL PLAN

CONFORMED TO CONSTRUCTION
RECORD OVERALL
LANDSCAPE DRAWING
FIGURE 6




DATE	REVISIONS AND RECORD OF ISSUE	NO.	BY	CK	APP
03/28/19	CONFORMED TO CONSTRUCTION		RW	VB	TS

SHEET LAYOUT KEY LEGEND

SHEET TITLE	SHEET NUMBERS
MATERIAL PLANS	L-05-104 - L-05-107
PLANTING PLANS	L-05-108 - L-05-110
IRRIGATION PLANS	L-05-111 - L-05-113

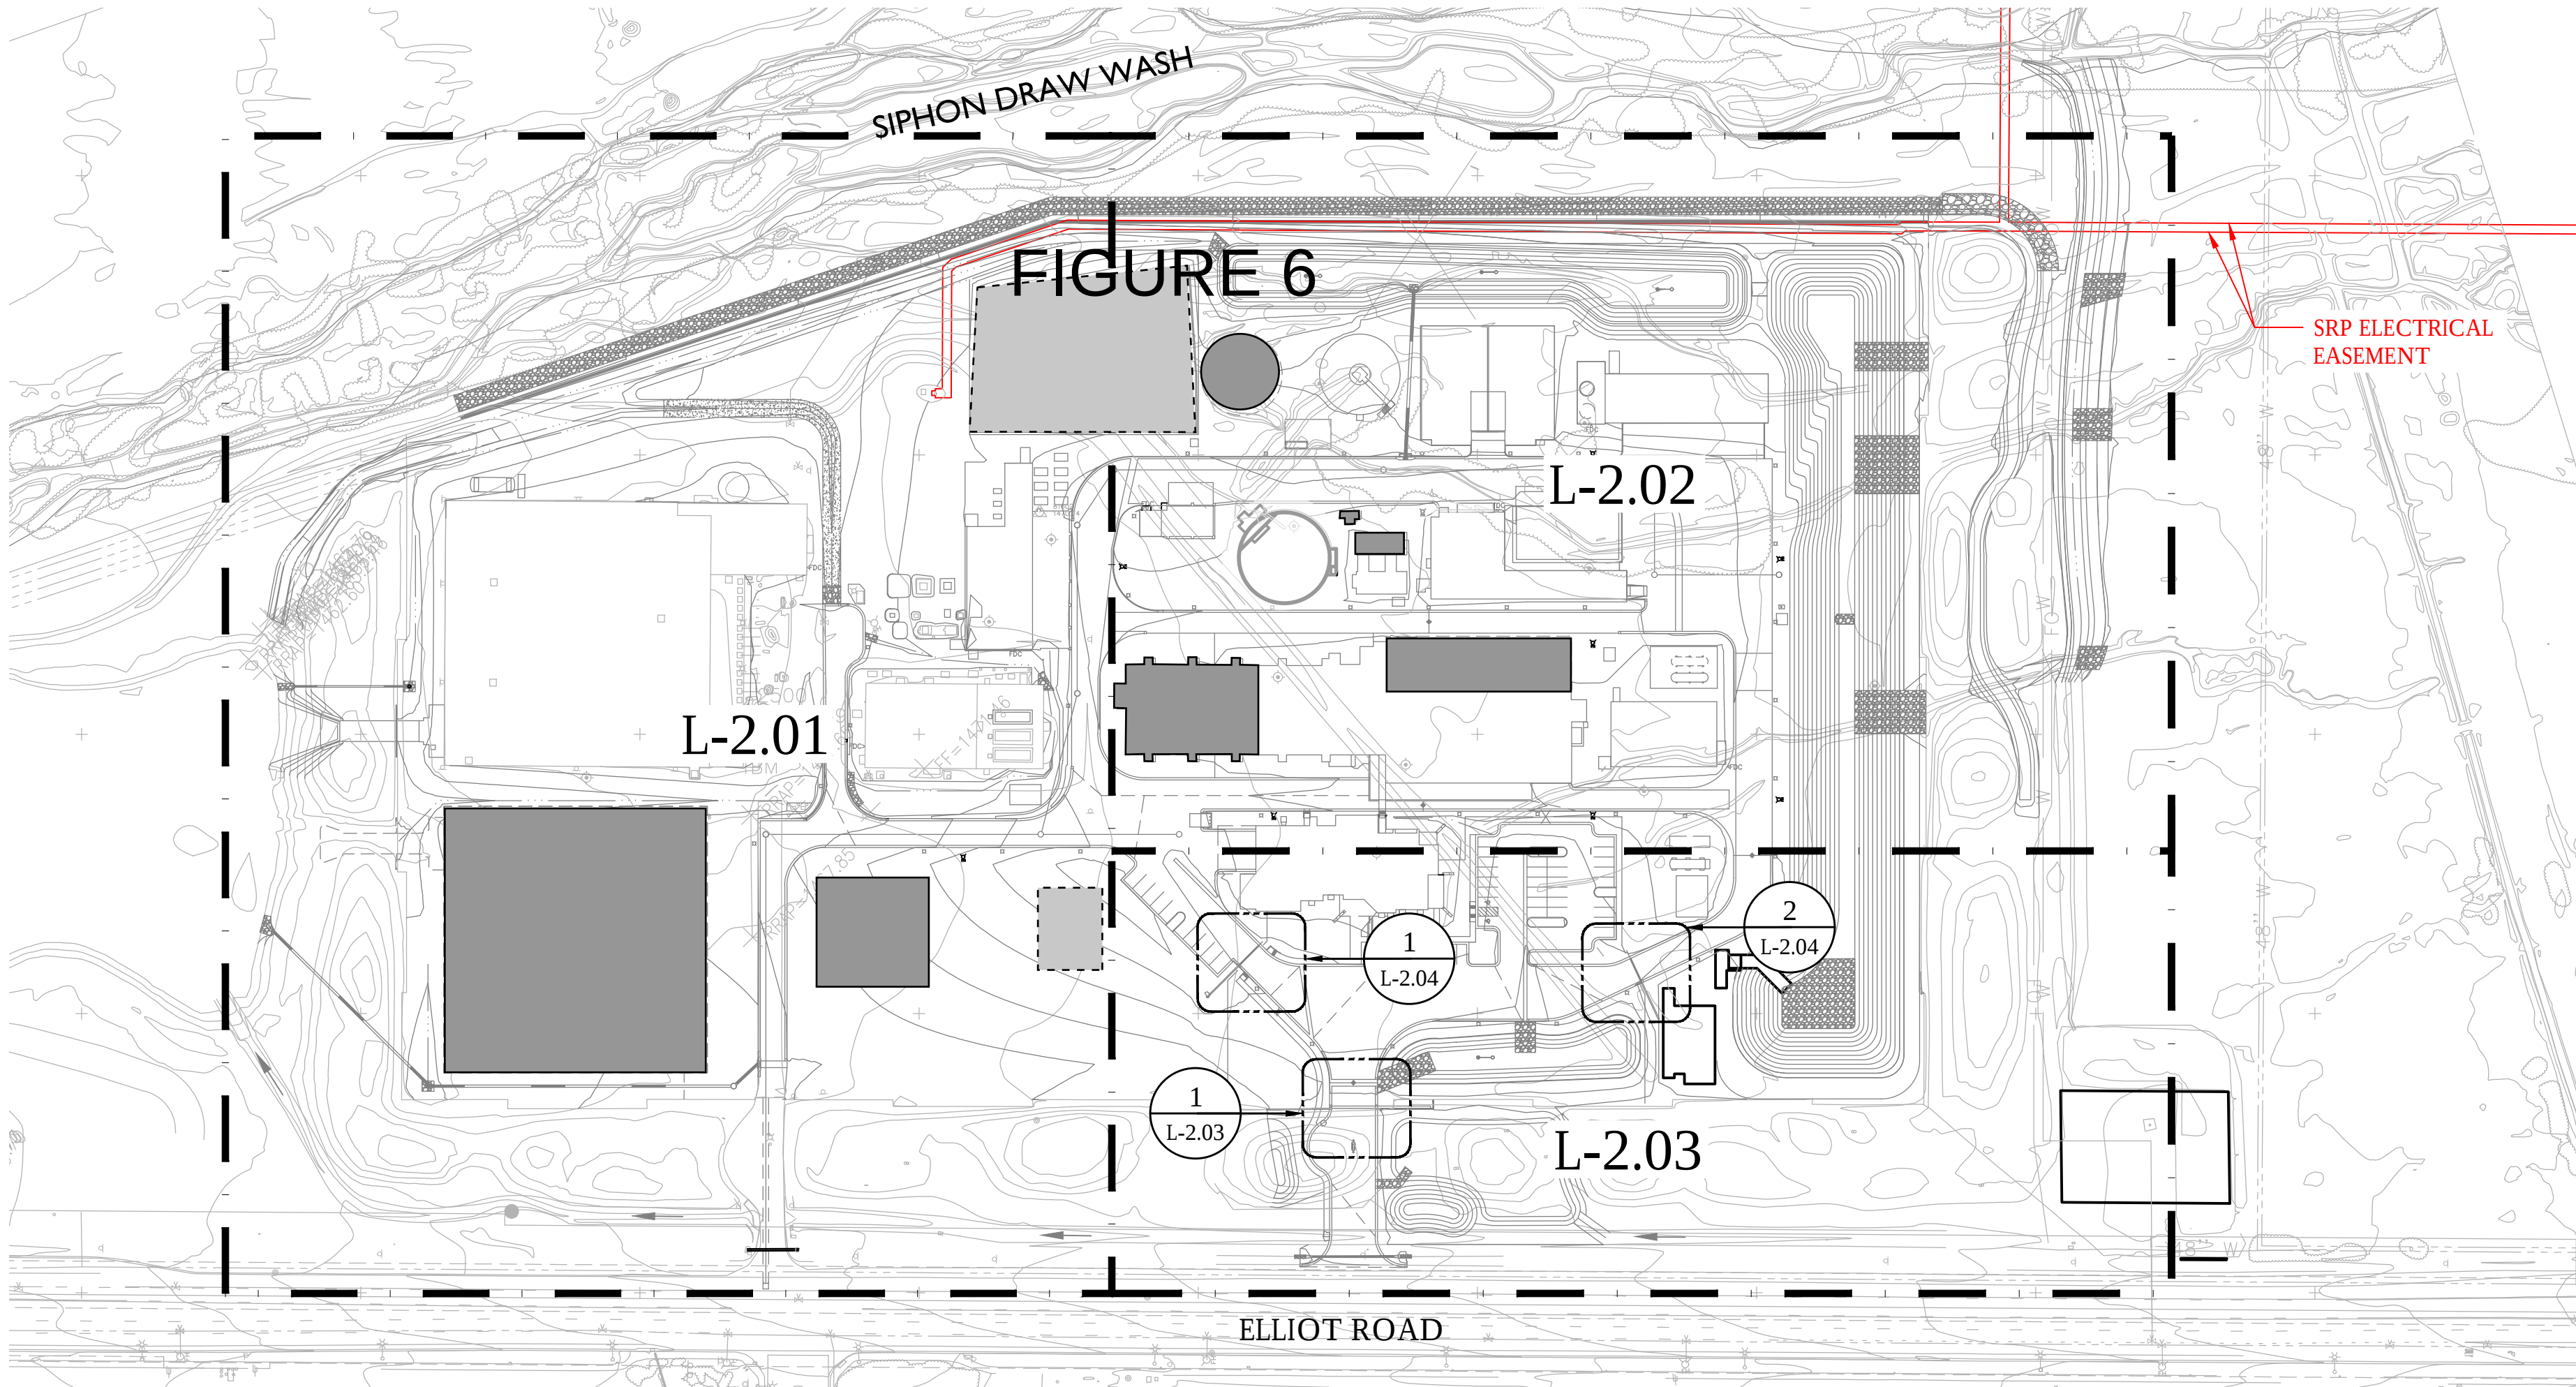


PLANTING AND IRRIGATION PLANS

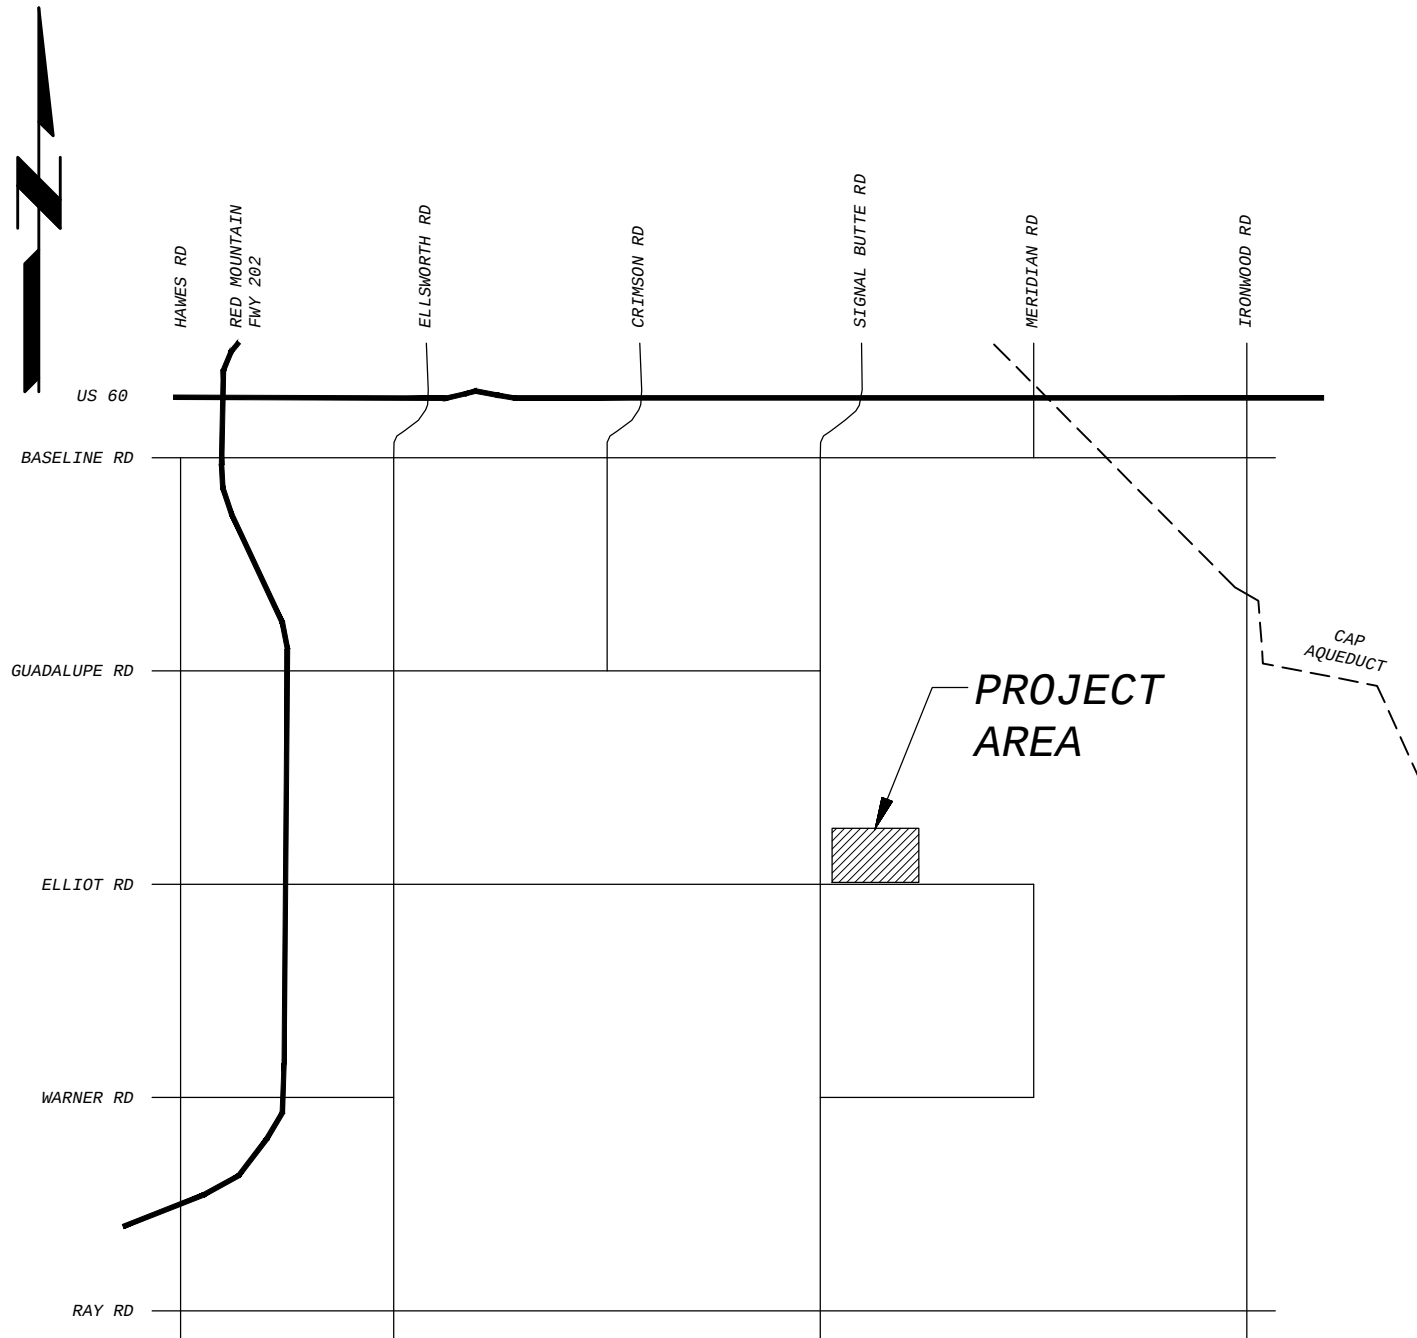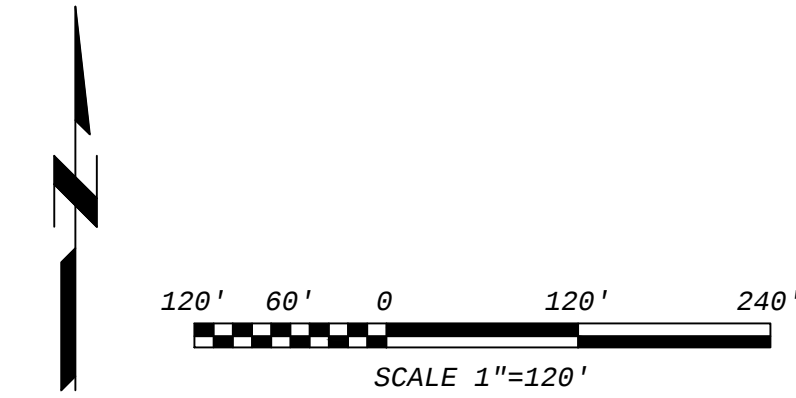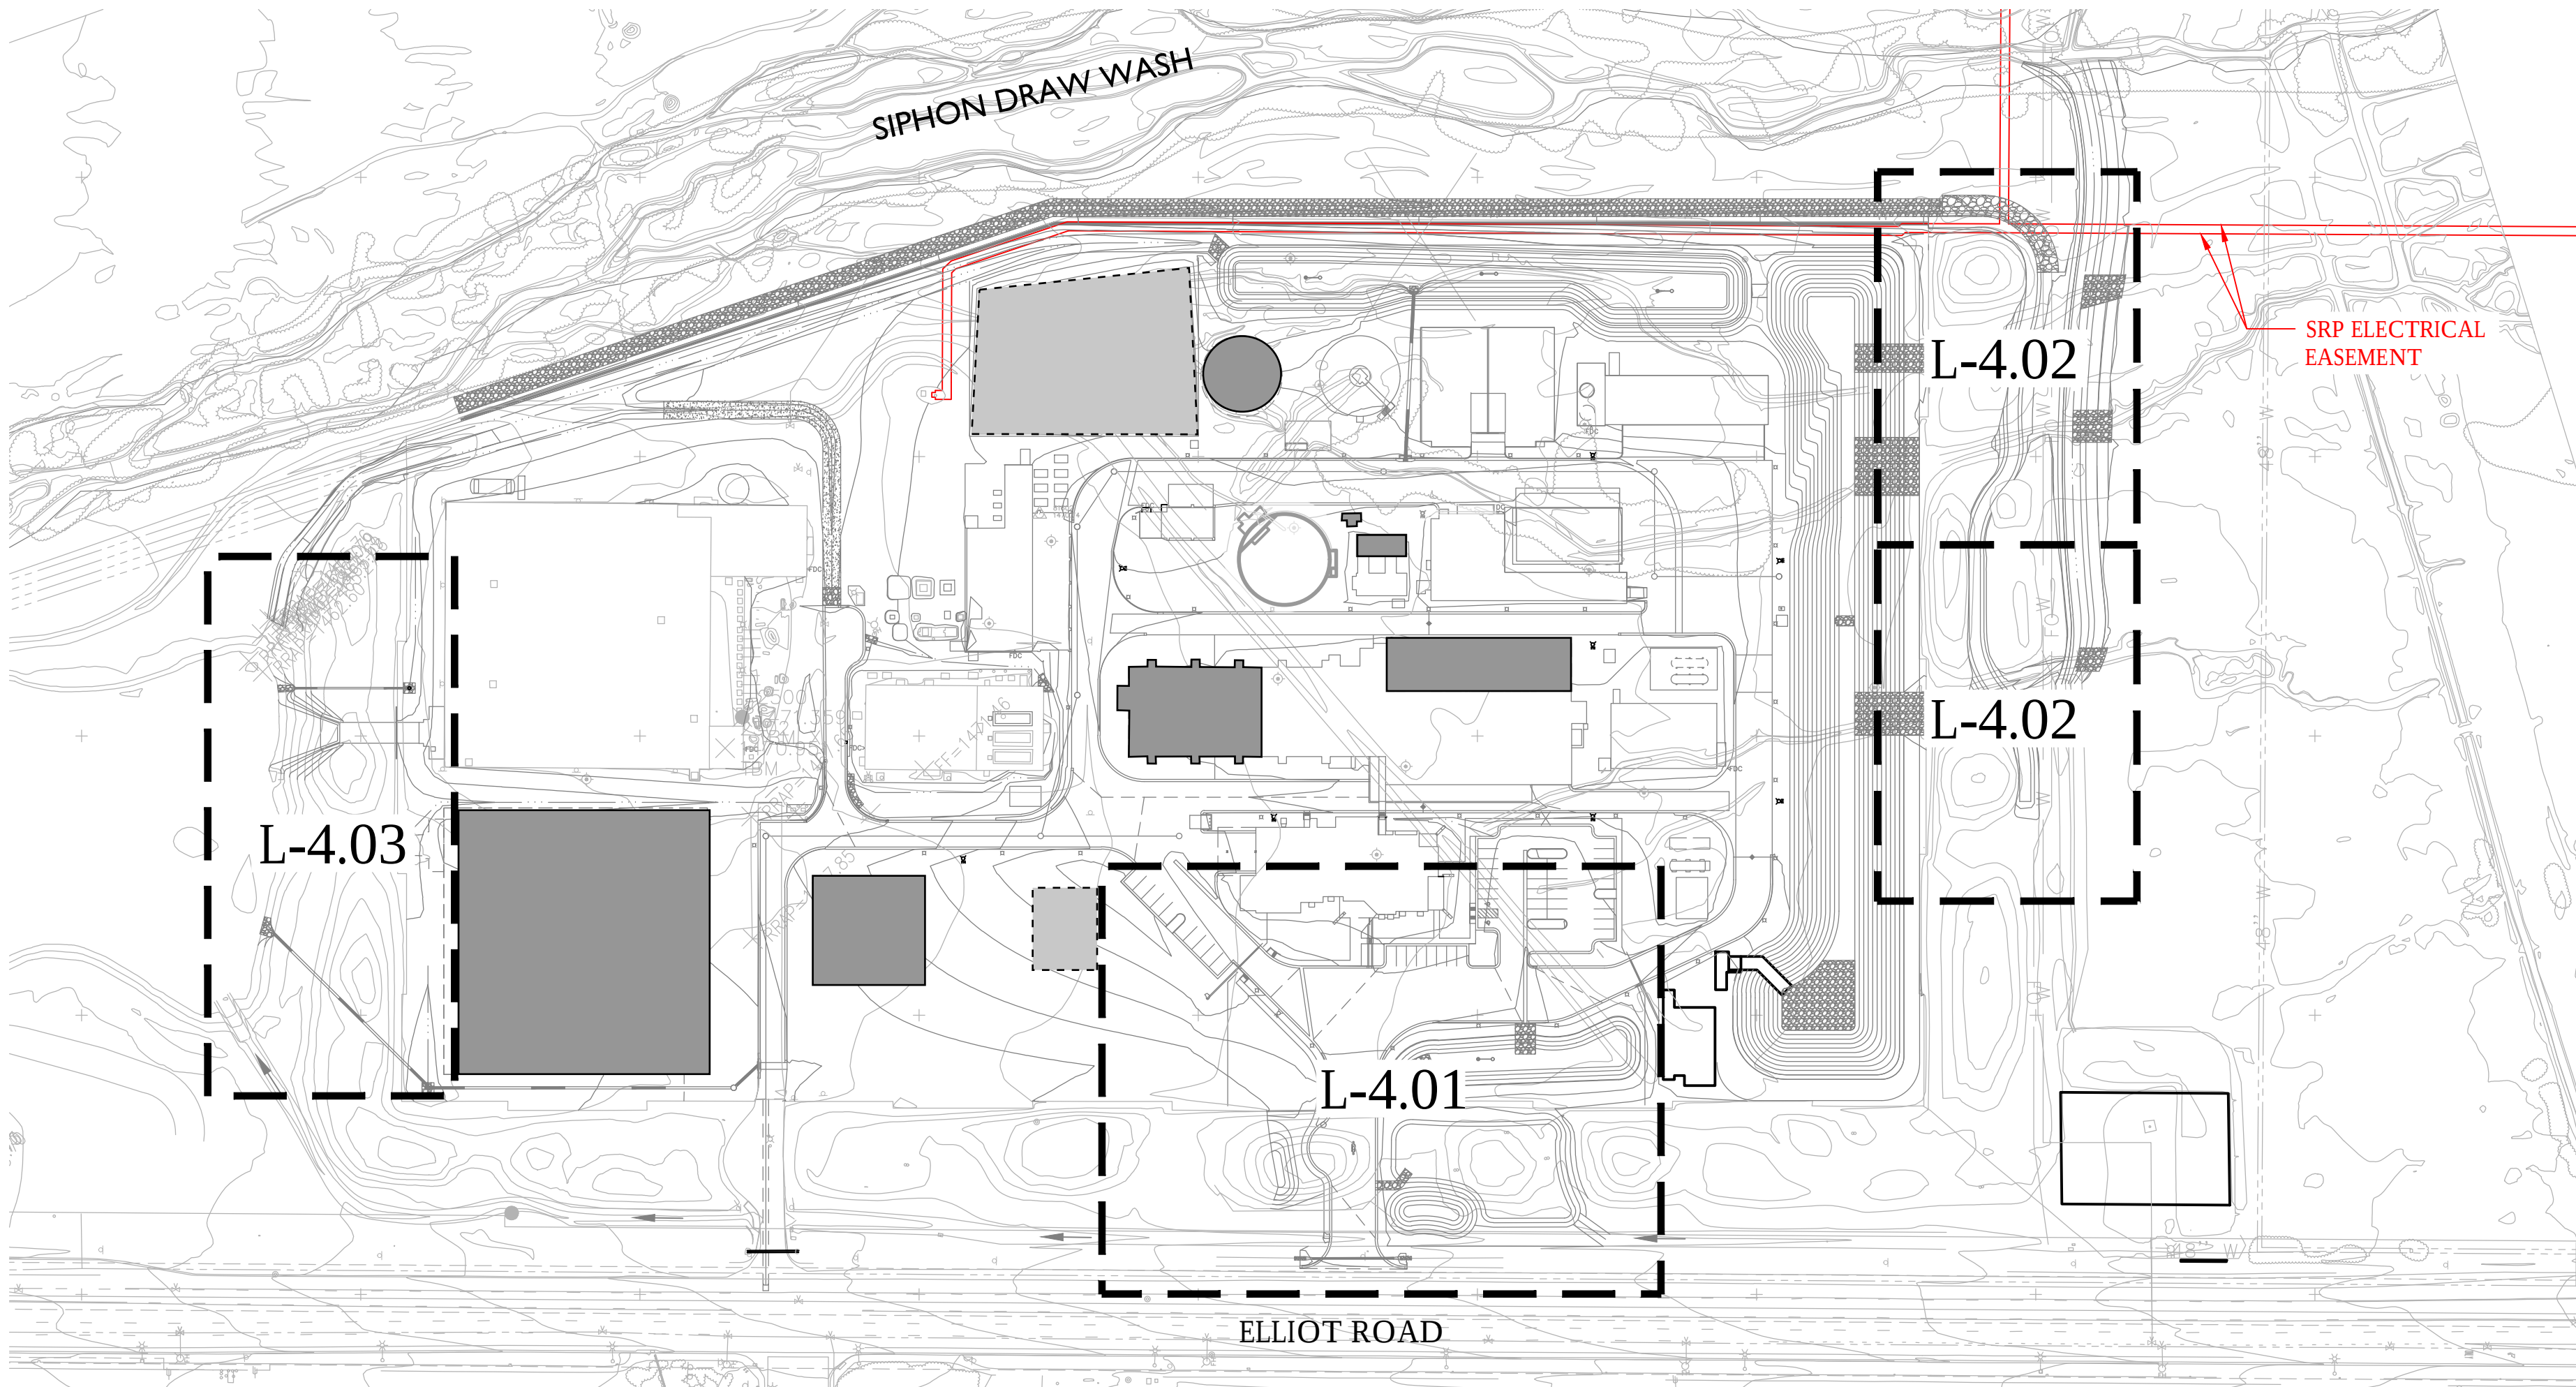

LEGEND:

- NEW STRUCTURE
- FUTURE STRUCTURE
- LANDSCAPING BARRIER

NO EXISTING LANDSCAPE TO BE IMPACTED BY CONSTRUCTION OF NEW STRUCTURES

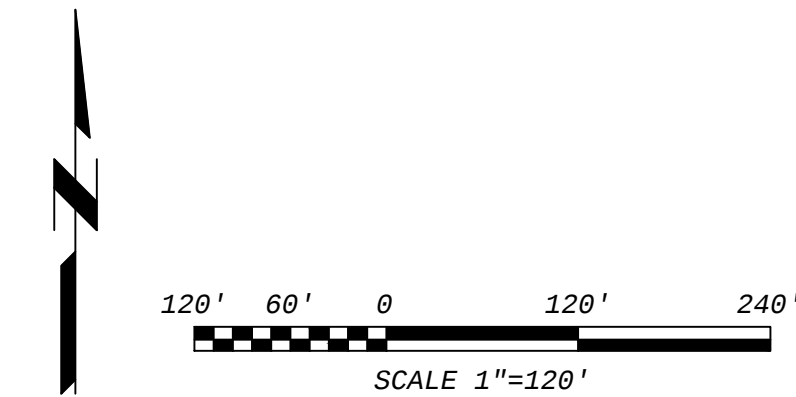

CONFORMED TO CONSTRUCTION		
	 2045 S. Vineyard Ave, Ste 101 Mesa, AZ 85210 T:480.503.2250 F:480.503.2258 www.epsgroupinc.com	
	CITY OF MESA ENGINEERING DEPARTMENT	
THIS DRAWING WAS ORIGINALLY SEALED ON 10/21/2016 BY THOMAS SNYDER, A REGISTERED LANDSCAPE ARCHITECT IN ARIZONA REGISTRANT 40702	SIGNAL BUTTE WATER TREATMENT PLANT 10950 EAST ELLIOT ROAD	
	LANDSCAPE KEY PLAN	
DATE: MAY 31, 2019	L-05-103	
DRAWN BY: KZ, VB DESIGNER: TES APPROVED BY: TES	SHEET 89 OF 854	
ACTIVITY: PROJ NO.: C01600	CATALOG NUMBER: A-210285	

Schedule											
Symbol	Label	Quantity	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens Per Lamp	Light Loss Factor	Wattage
	2	16	DIALIGHT	D9859L, NO MOD#	LED LOWBAY LAMP	LED	1	LBW1C1D_L M79.IES	5974	0.85	79.5
	7	3	DIALIGHT COPORATION	LTM3C4M2P	141041845, MOD: LTM3C4M2P	LED	1	DuroSite_Linear_4FT_LTM3C4M2P.IES	7132.513	0.85	65.8


Luminaire Locations										
Location							Aim			
No.	Label	X	Y	Z	MH	Orientation	Tilt	X	Y	Z
1	2	21.41	-31.08	10.00	10.00	0.00	0.00	21.41	-31.08	0.00
2	2	35.34	-31.08	10.00	10.00	0.00	0.00	35.34	-31.08	0.00
3	2	51.36	-31.08	10.00	10.00	0.00	0.00	51.36	-31.08	0.00
4	2	61.97	-31.08	10.00	10.00	0.00	0.00	61.97	-31.08	0.00
5	2	74.81	-31.08	10.00	10.00	0.00	0.00	74.81	-31.08	0.00
6	2	86.56	-31.08	10.00	10.00	0.00	0.00	86.56	-31.08	0.00
7	2	99.40	-31.08	10.00	10.00	0.00	0.00	99.40	-31.08	0.00
8	2	21.41	-36.33	10.00	10.00	0.00	0.00	21.41	-36.33	0.00
9	2	35.34	-36.33	10.00	10.00	0.00	0.00	35.34	-36.33	0.00
10	2	51.36	-36.33	10.00	10.00	0.00	0.00	51.36	-36.33	0.00
11	2	61.97	-36.33	10.00	10.00	0.00	0.00	61.97	-36.33	0.00
12	2	74.81	-36.33	10.00	10.00	0.00	0.00	74.81	-36.33	0.00
13	2	86.56	-36.33	10.00	10.00	0.00	0.00	86.56	-36.33	0.00
14	2	99.40	-36.33	10.00	10.00	0.00	0.00	99.40	-36.33	0.00
15	2	44.23	-31.08	10.00	10.00	0.00	0.00	44.23	-31.08	0.00
16	2	44.23	-36.33	10.00	10.00	0.00	0.00	44.23	-36.33	0.00
17	7	5.63	-33.58	24.12	10.00	90.00	0.00	5.63	-33.58	14.12
18	7	6.06	-50.61	17.68	10.00	90.00	0.00	6.06	-50.61	7.68
19	7	5.63	-33.58	10.02	10.00	90.00	0.00	5.63	-33.58	0.02

Power Statistics				
Description	Total Watts	Area	Density	# Luminaires
FILTER GALLERY POWER	1272.0 W	2197.9 ft²	0.6 W/ft²	16

Statistics						
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
FILTER GALLERY	+	30.2 fc	46.5 fc	13.8 fc	3.4:1	2.2:1
STAIRCASE 1	+	33.9 fc	36.6 fc	31.3 fc	1.2:1	1.1:1
STAIRCASE 2	+	23.0 fc	34.8 fc	14.5 fc	2.4:1	1.6:1
STAIRCASE 3	+	30.6 fc	33.5 fc	26.6 fc	1.3:1	1.2:1
STAIRCASE 4	+	25.0 fc	35.2 fc	17.7 fc	2.0:1	1.4:1

SIGNAL BUTTE WTP
LIGHTING CALCULATIONS
FOR
FILTER COMPLEX GALLERY LEVEL

Designer
MAMTA
Date
5/31/2022
Scale
Not to Scale
Drawing No.
Summary

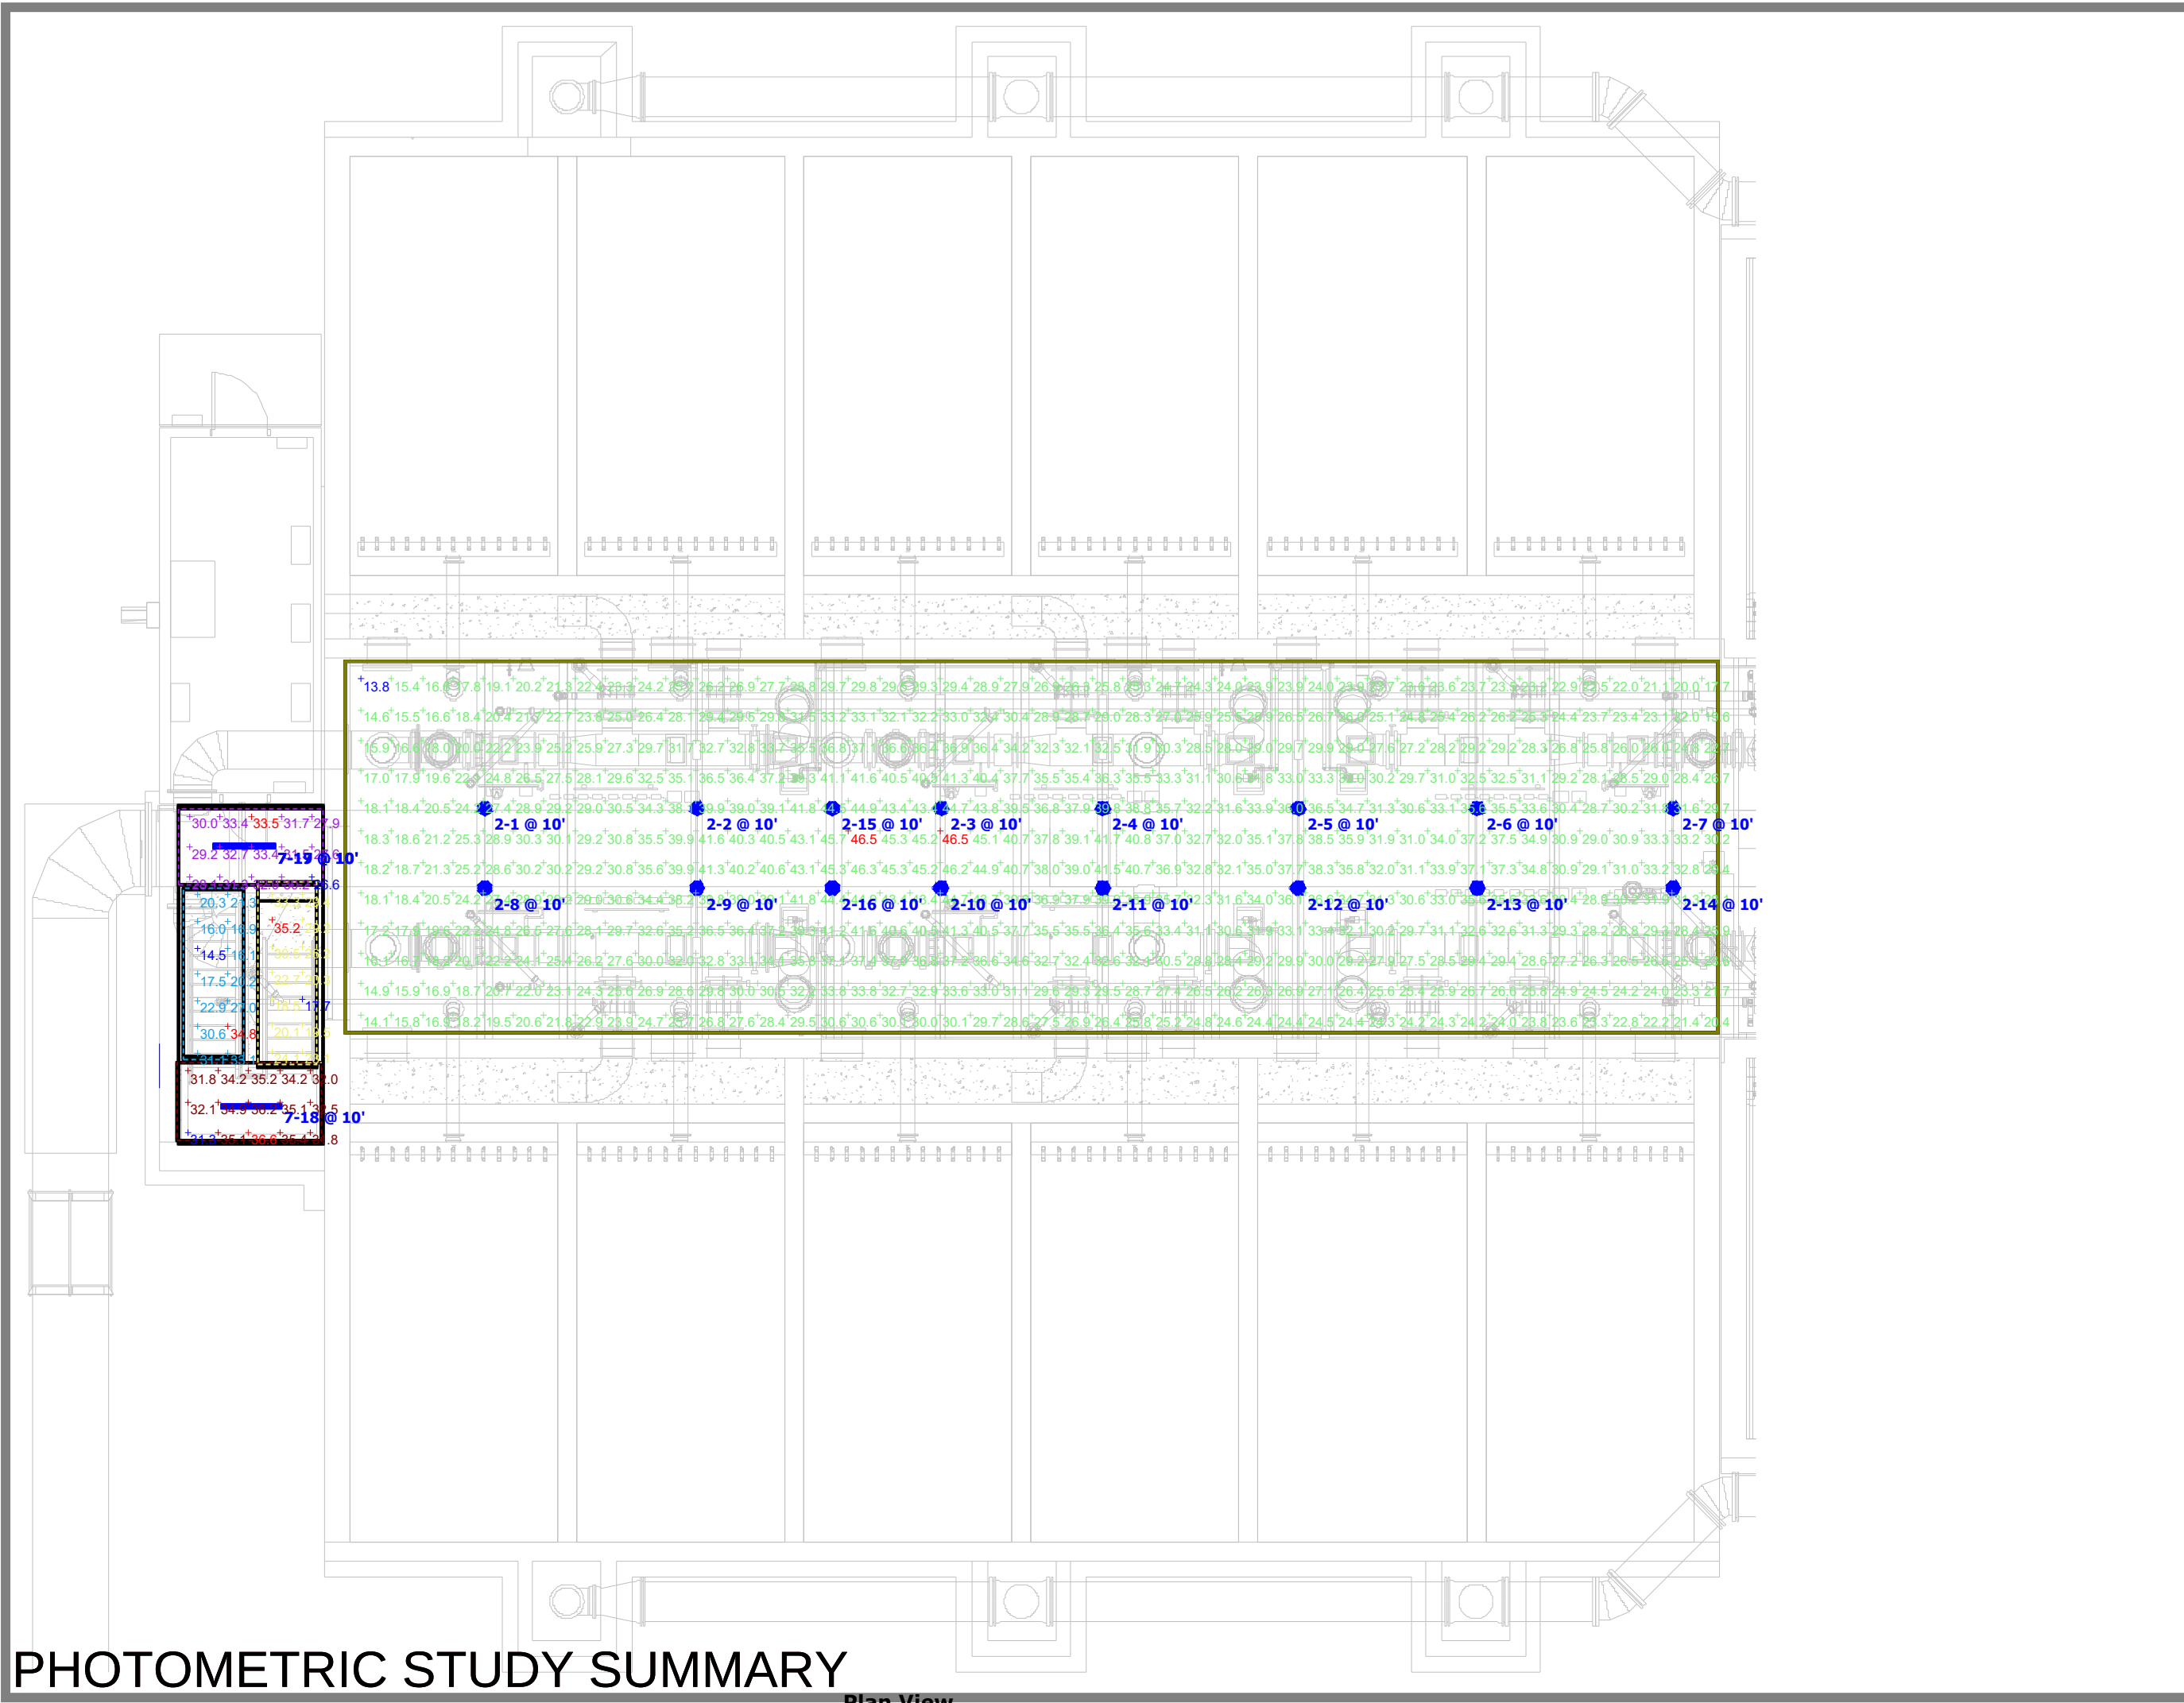

SIGNAL BUTTE WTP
LIGHTING CALCULATIONS
FOR
FILTER COMPLEX GALLERY LEVEL

Designer
MAMTA

Date
5/31/2022

Scale
Not to Scale

Drawing No.

Summary


2 of 2

Schedule											
Symbol	Label	QTY	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens per Lamp	LLF	Wattage
	5	8	DIALIGHT - AREA LUMINAIRE	STW2C2G	WITH SPECULAR REFLECTORS AND CLEAR GLASS FLAT LENS	THREE ARRAYS OF LEDS. LUMINAIRE OUTPUT = 4000 LMS	1	STW2C2G.ies	4000	0.85	37.1
	6	12	DIALIGHT - AREA LUMINAIRE	STW2C2G	WITH SPECULAR REFLECTORS AND CLEAR GLASS FLAT LENS	THREE ARRAYS OF LEDS. LUMINAIRE OUTPUT = 4000 LMS	1	STW2C2G.ies	4000	0.85	37.1

Luminaire Locations										
		Location						Aim		
No.	Label	X	Y	Z	MH	Orientation	Tilt	X	Y	Z
1	5	38.13	-79.29	10.00	10.00	0.00	0.00	38.13	-79.29	0.00
2	5	12.71	-79.19	10.00	10.00	0.00	0.00	12.71	-79.19	0.00
3	5	68.22	-79.19	10.00	10.00	0.00	0.00	68.22	-79.19	0.00
4	5	100.53	-79.19	10.00	10.00	0.00	0.00	100.53	-79.19	0.00
5	6	41.65	-61.64	10.00	10.00	0.00	0.00	41.65	-61.64	0.00
6	6	71.54	-61.65	10.00	10.00	0.00	0.00	71.54	-61.65	0.00
7	6	13.09	-50.91	10.00	10.00	90.00	0.00	13.09	-50.91	0.00
8	6	100.26	-47.19	10.00	10.00	270.00	0.00	100.26	-47.19	0.00
9	6	41.72	-46.10	10.00	10.00	0.00	0.00	41.72	-46.10	0.00
10	6	71.53	-46.07	10.00	10.00	0.00	0.00	71.53	-46.07	0.00
11	6	41.67	-21.42	10.00	10.00	180.00	0.00	41.67	-21.42	0.00
12	6	71.57	-21.42	10.00	10.00	180.00	0.00	71.57	-21.42	0.00
13	6	100.27	-20.32	10.00	10.00	270.00	0.00	100.27	-20.32	0.00
14	6	12.60	-16.65	10.00	10.00	90.00	0.00	12.60	-16.65	0.00
15	6	41.76	-5.93	10.00	10.00	180.00	0.00	41.76	-5.93	0.00
16	6	71.51	-5.90	10.00	10.00	180.00	0.00	71.51	-5.90	0.00
17	5	38.94	11.36	10.00	10.00	180.00	0.00	38.94	11.36	0.00
18	5	68.22	11.36	10.00	10.00	180.00	0.00	68.22	11.36	0.00
19	5	100.54	11.39	10.00	10.00	180.00	0.00	100.54	11.39	0.00
20	5	12.71	11.41	10.00	10.00	180.00	0.00	12.71	11.41	0.00

Statistics						
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
FILTER OPERATING AREA		7.2 fc	22.3 fc	0.2 fc	111.5:1	36.0:1


Power Statistics				
Description	# Luminaires	Total Watts	Area	Density
FILTER POWER	20	742.0 W	8470.6 ft²	0.1 W/ft²

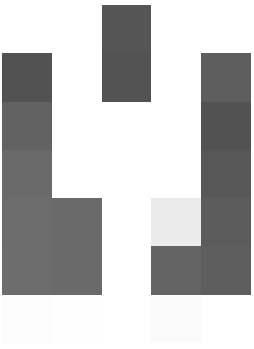

SIGNAL BUTTE WTP
LIGHTING CALCULATIONS
FOR
FILTER AREA OPERATING FLOOR

Designer
MAMTA
Date
6/2/2022
Scale
Not to Scale
Drawing No.

Summary

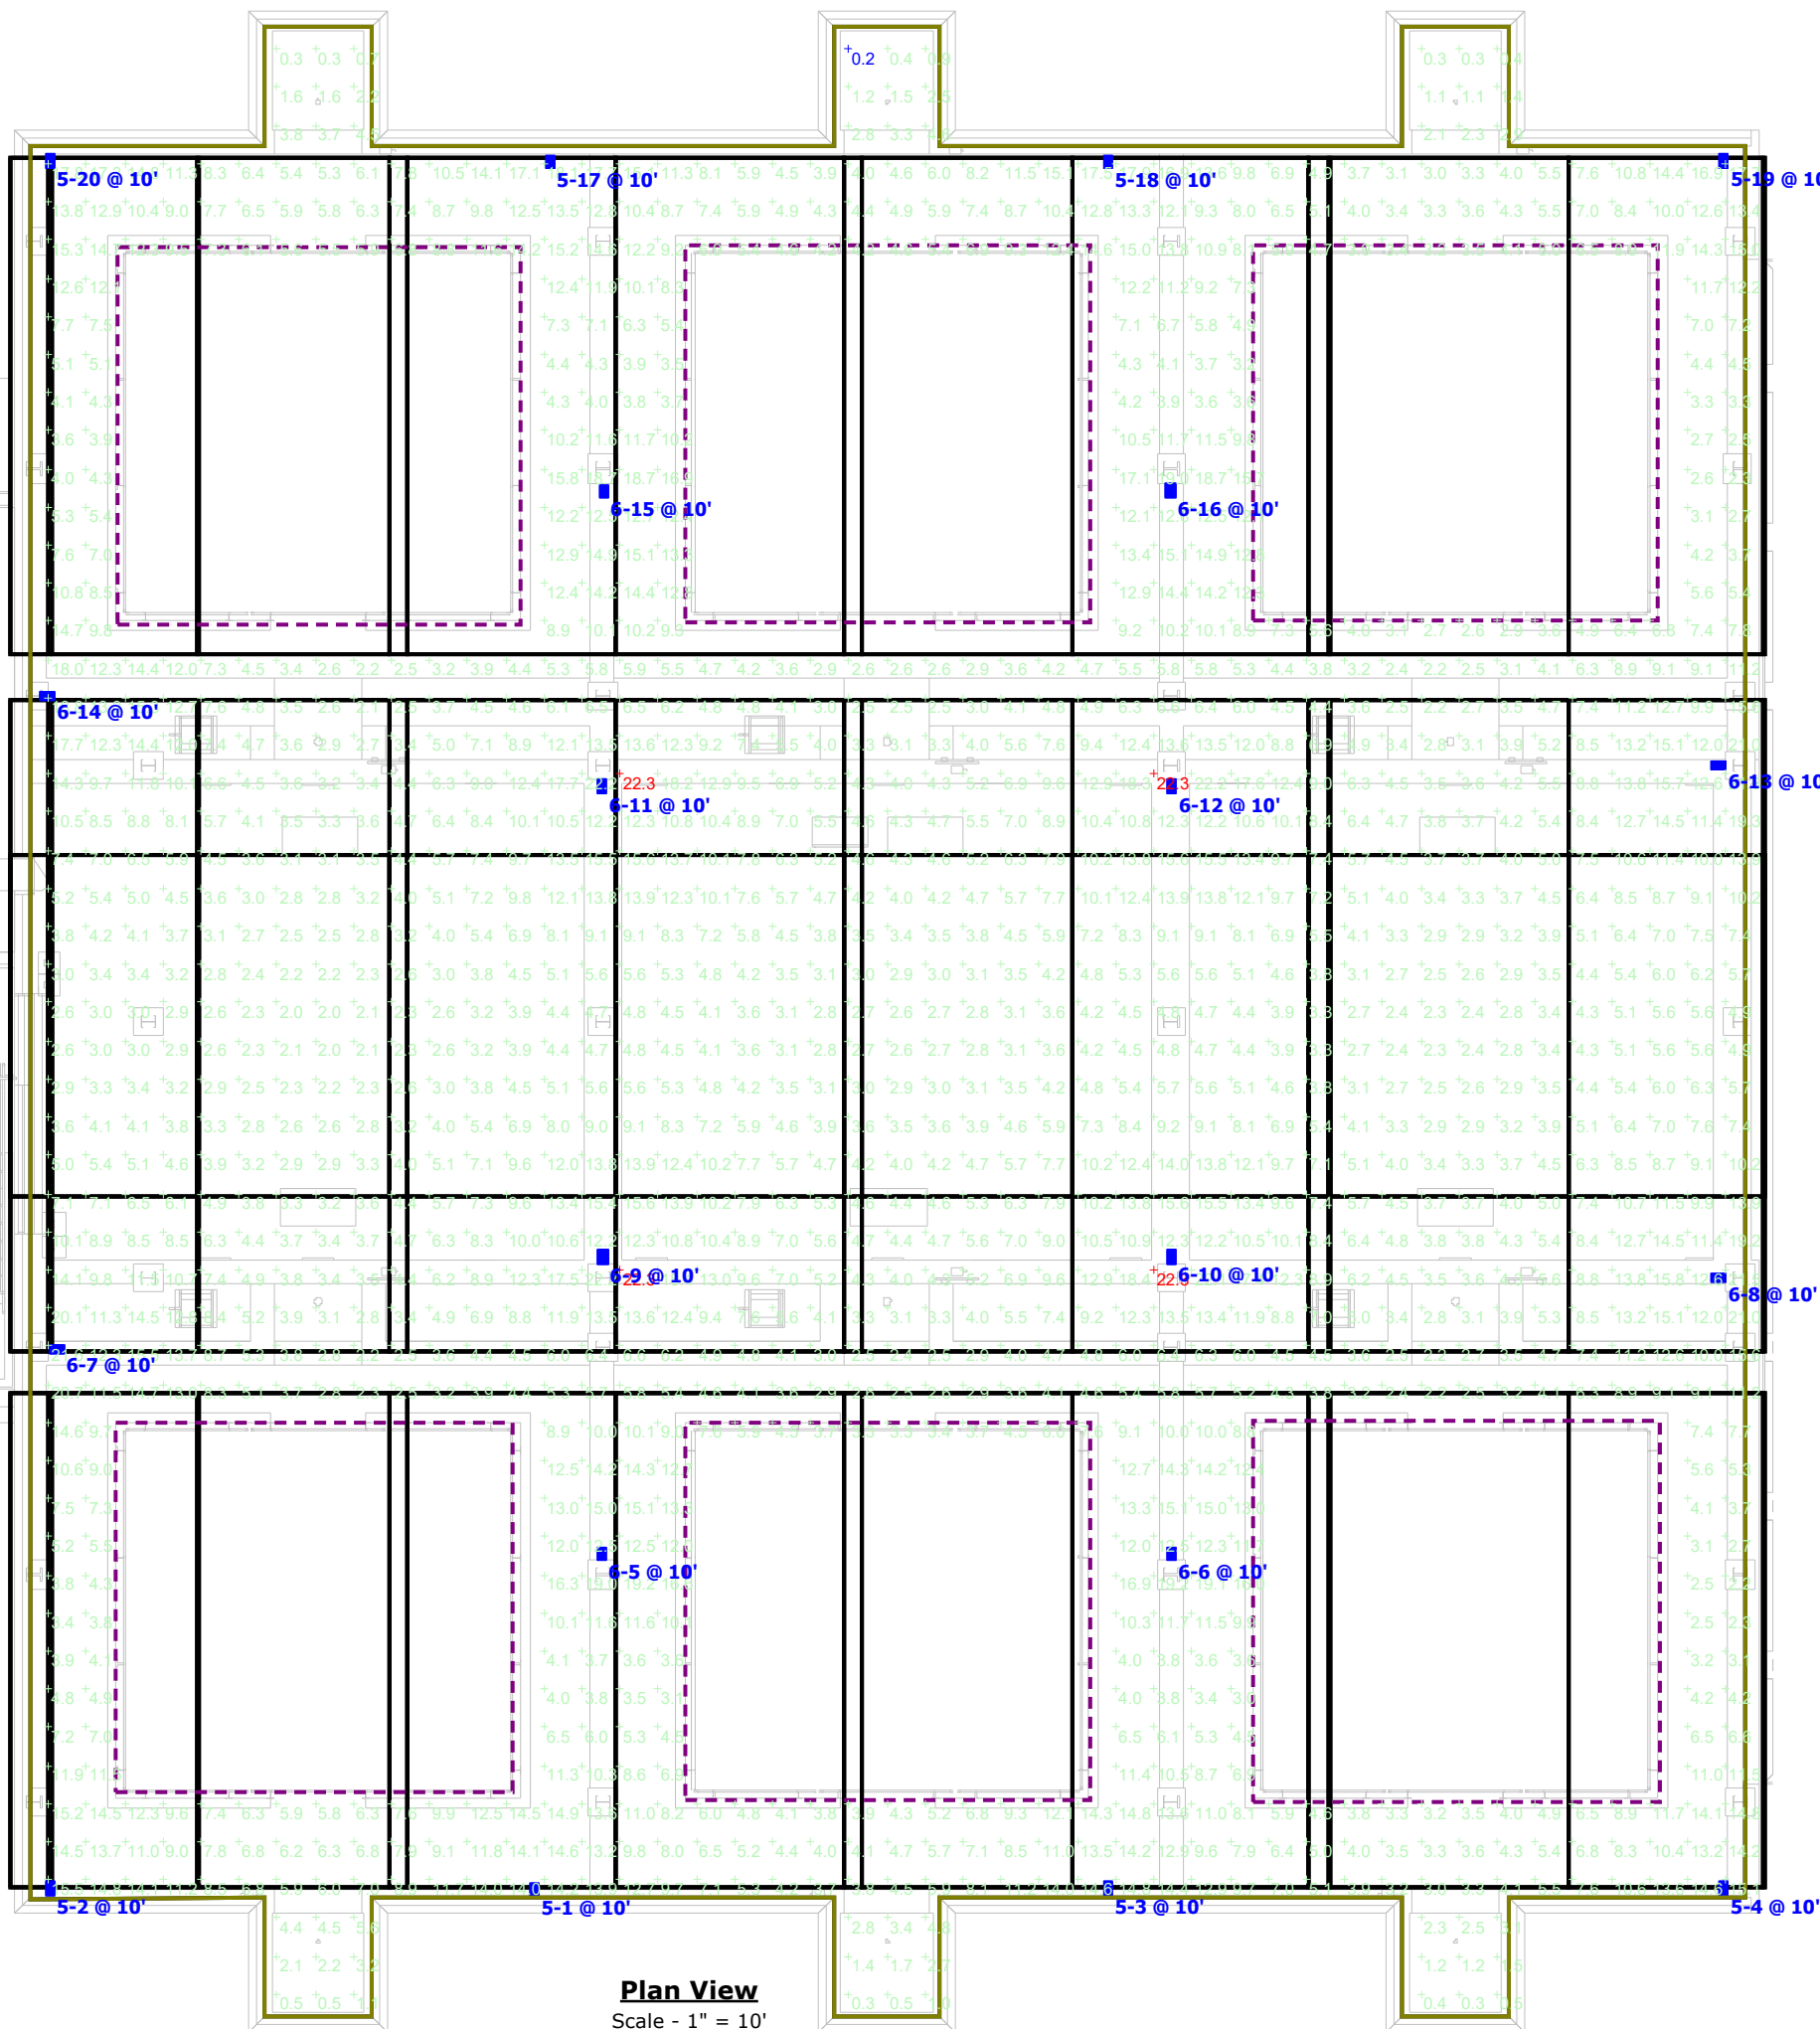

Plan View
Scale - 1" = 10'

Schedule												
Symbol	Label	Quantity	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens Per Lamp	Light Loss Factor	Wattage	
	2	5	DIALIGHT	D9859L, NO MOD#	LED LOWBAY LAMP	LED	1	LBW1C1D_L M79.IES	5974	0.85	79.5	

Luminaire Locations

Location						Aim				
No.	Label	X	Y	Z	MH	Orientation	Tilt	X	Y	Z
1	2	2.55	4.43	10.00	10.00	0.00	0.00	2.55	4.43	0.00
2	2	7.67	4.43	10.00	10.00	0.00	0.00	7.67	4.43	0.00
3	2	5.34	12.28	10.00	10.00	0.00	0.00	5.34	12.28	0.00
4	2	2.55	20.13	10.00	10.00	0.00	0.00	2.55	20.13	0.00
5	2	7.67	20.13	10.00	10.00	0.00	0.00	7.67	20.13	0.00

Power Statistics

Description	# Luminaires	Total Watts	Area	Density
Power Density Zone # 1	5	397.5 W	220.8 ft²	1.8 W/ft²

Statistics


Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
ELECTRICAL ROOM	+	35.1 fc	39.6 fc	28.6 fc	1.4:1	1.2:1

SIGNAL BUTTE WTP
LIGHTING CALCULATIONS
FOR
NEW ELECTRICAL ROOM

Designer
MAMTA
Date
6/2/2022
Scale
Not to Scale
Drawing No.

Summary

PHOTOMETRIC STUDY SUMMARY

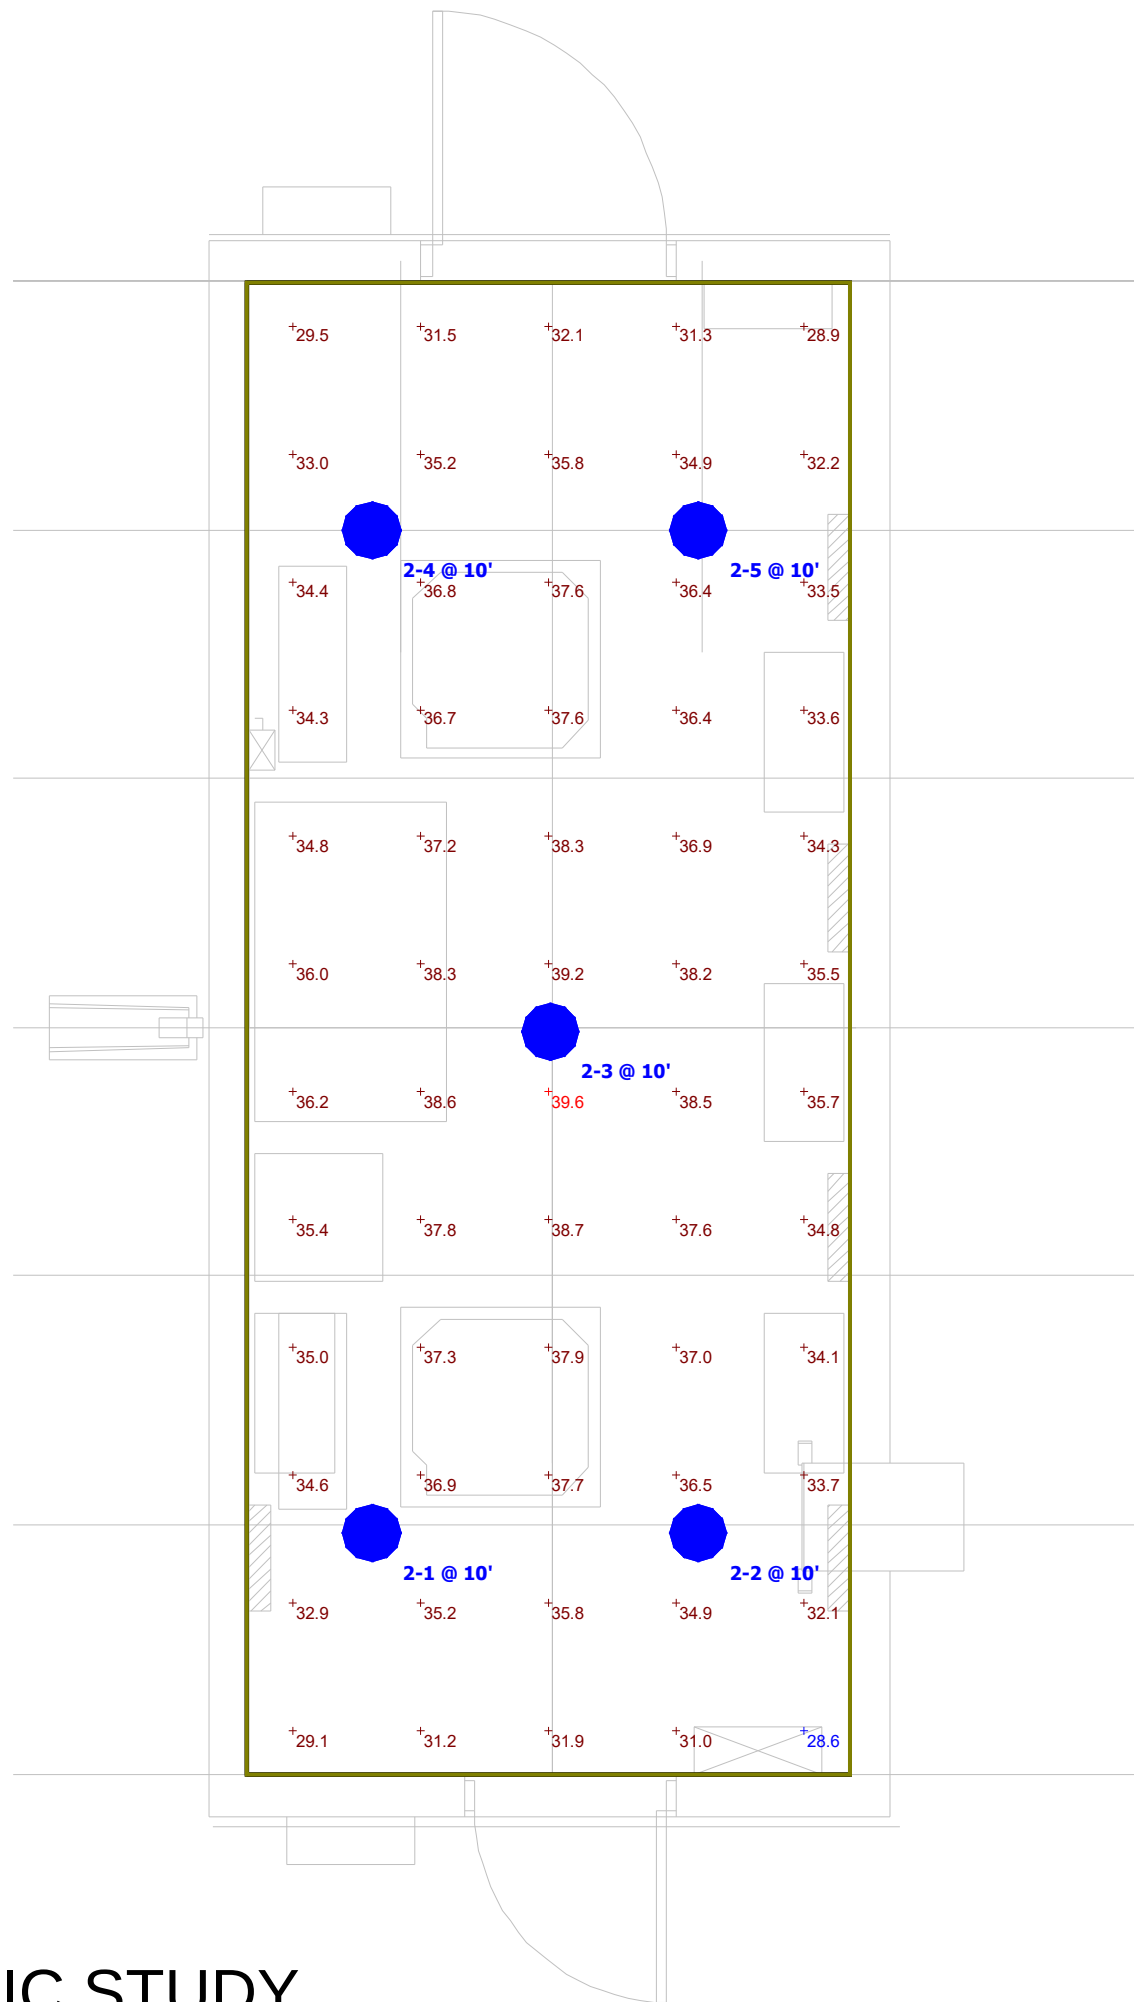

Plan View
Scale - 1" = 3'

SIGNAL BUTTE WTP LIGHTING CALCULATIONS FOR NEW ELECTRICAL ROOM


Designer
MAMTA
Date
6/2/2022
Scale
Not to Scale
Drawing No.

Summary

Schedule											
Symbol	Label	Quantity	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens Per Lamp	Light Loss Factor	Wattage
	5	2	DIALIGHT - AREA LUMINAIRE	STW2C2G	WITH SPECULAR REFLECTORS AND CLEAR GLASS FLAT LENS	THREE ARRAYS OF LEDS. LUMINAIRE OUTPUT = 4000 LMS	1	STW2C2G.ies	4000	0.85	37.1

Luminaire Locations											
Location								Aim			
No.	Label	X	Y	Z	MH	Orientation	Tilt	X	Y	Z	
1	5	42.45	52.27	10.00	10.00	225.00	0.00	42.45	52.27	0.00	
2	5	4.56	38.24	10.00	10.00	55.00	0.00	4.56	38.24	0.00	

Statistics						
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
RECOVERY WATER BASIN	+	5.3 fc	19.0 fc	0.3 fc	63.3:1	17.7:1

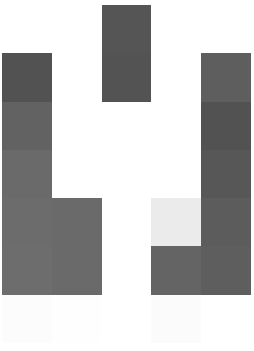

SIGNAL BUTTE WTP
LIGHTING CALCULATIONS
FOR
WASHWATER TREATMENT


Designer
MAMTA

Date
6/7/2022

Scale
Not to Scale

Drawing No.


Summary

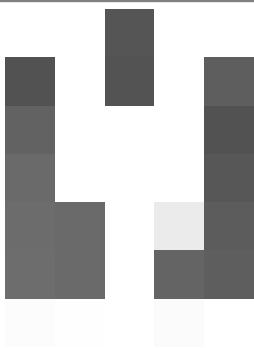

SIGNAL BUTTE WTP
LIGHTING CALCULATIONS
FOR
WASHWATER TREATMENT

Designer
MAMTA
Date
6/7/2022
Scale
Not to Scale
Drawing No.

Summary

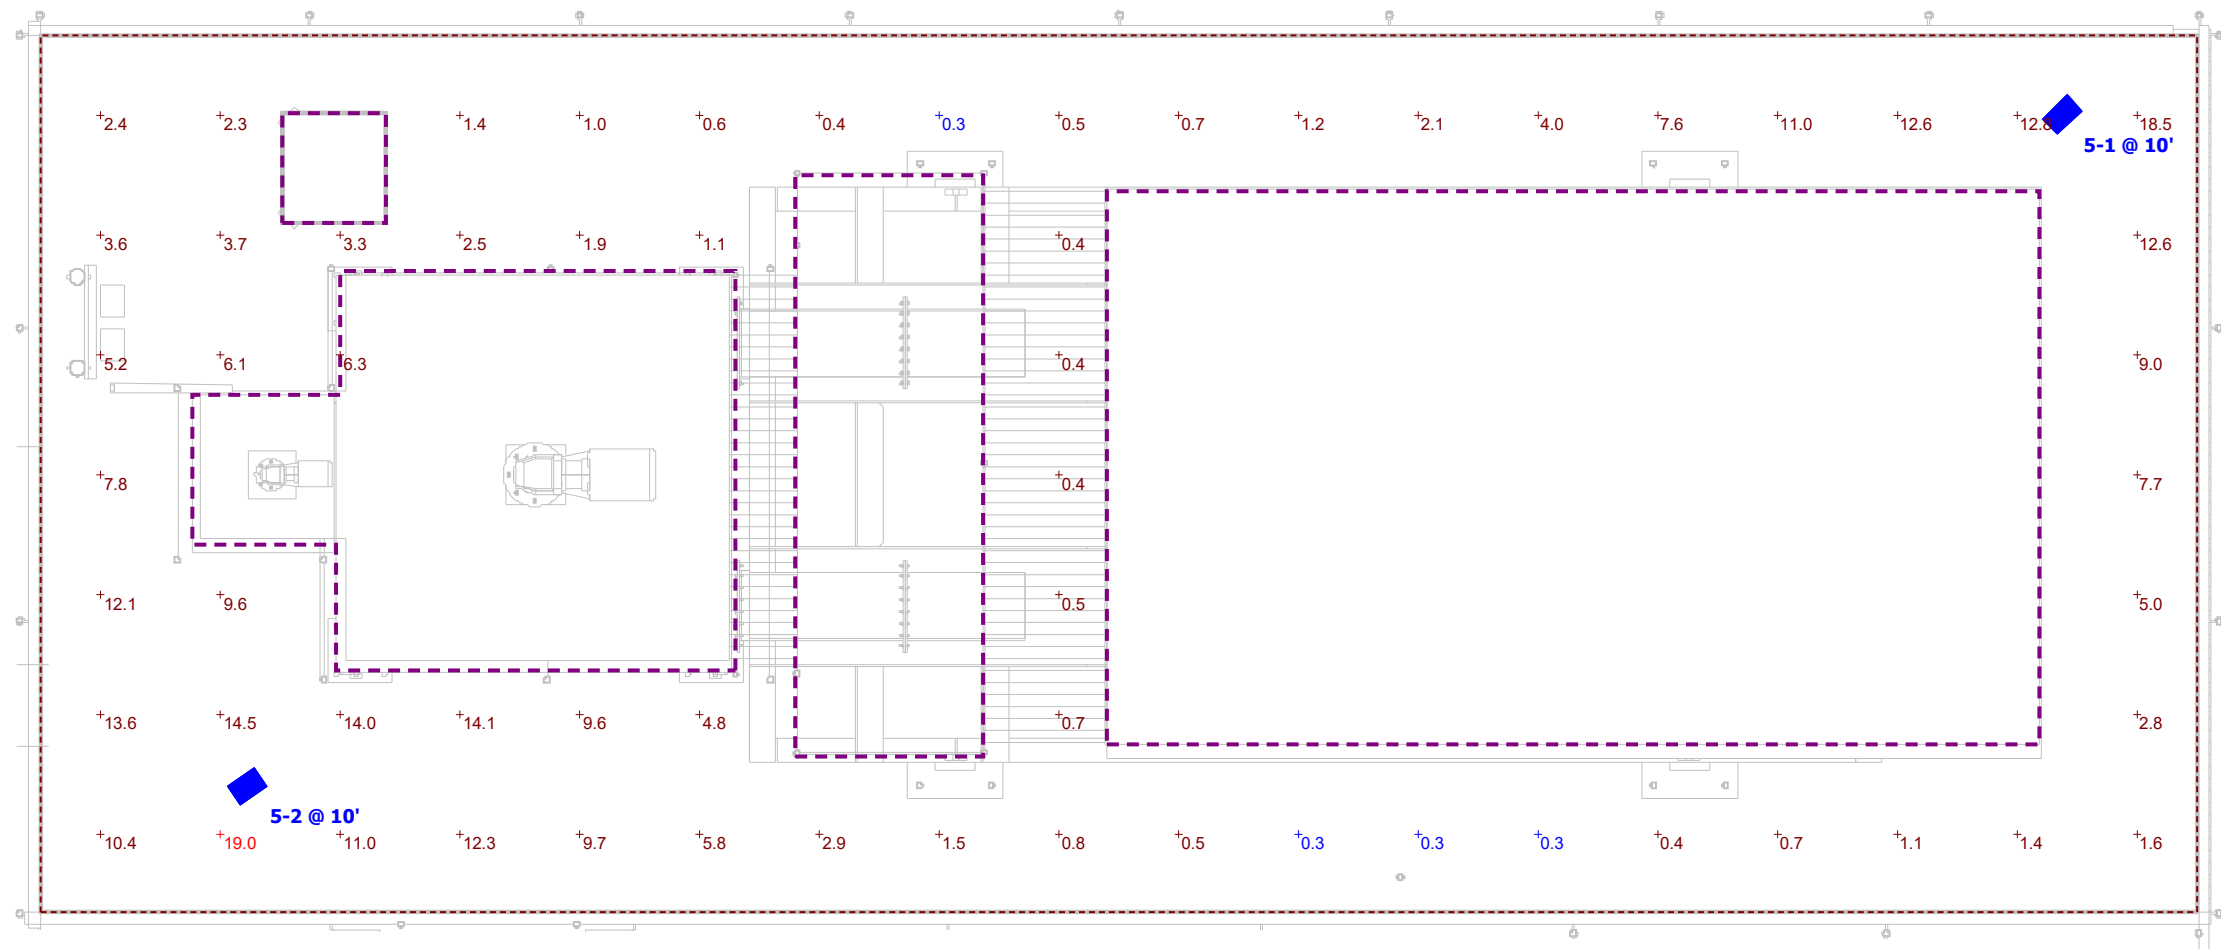

Plan View
Scale - 1" = 4'

Schedule											
Symbol	Label	Quantity	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens Per Lamp	Light Loss Factor	Wattage
	5	15	DIALIGHT - AREA LUMINAIRE	STW2C2G	WITH SPECULAR REFLECTORS AND CLEAR GLASS FLAT LENS	THREE ARRAYS OF LEDS. LUMINAIRE OUTPUT = 4000 LMS	1	STW2C2G.ies	4000	0.85	37.1
	5 EX	6	DIALIGHT - AREA LUMINAIRE	STW2C2G	WITH SPECULAR REFLECTORS AND CLEAR GLASS FLAT LENS	THREE ARRAYS OF LEDS. LUMINAIRE OUTPUT = 4000 LMS	1	STW2C2G.ies	4000	0.85	37.1
	6	4	DIALIGHT - AREA LUMINAIRE	STW2C2G	WITH SPECULAR REFLECTORS AND CLEAR GLASS FLAT LENS	THREE ARRAYS OF LEDS. LUMINAIRE OUTPUT = 4000 LMS	1	STW2C2G.ies	4000	0.85	37.1

Luminaire Locations

Location								Aim		
No.	Label	X	Y	Z	MH	Orientation	Tilt	X	Y	Z
1	5 EX	37.83	90.46	16.21	10.00	144.71	45.00	41.92	84.69	9.14
2	5 EX	103.70	90.75	16.21	10.00	210.02	45.00	100.17	84.62	9.14
3	5 EX	163.35	91.13	22.25	10.00	221.33	45.00	158.68	85.82	15.18
4	5 EX	105.91	91.46	22.25	10.00	118.14	45.00	112.15	88.12	15.18
5	5 EX	35.56	91.51	14.70	10.00	210.02	45.00	32.03	85.38	7.63
6	5 EX	1.64	91.77	14.70	10.00	133.07	45.00	6.81	86.94	7.63
7	5	22.41	93.10	14.46	10.00	0.00	0.00	22.41	93.10	4.46
8	5	47.83	93.11	15.97	10.00	0.00	0.00	47.83	93.11	5.97
9	5	162.04	93.45	22.01	10.00	315.00	0.00	162.04	93.45	12.01
10	5	103.69	93.79	15.97	10.00	315.00	0.00	103.69	93.79	5.97
11	5	77.89	94.31	15.97	10.00	0.00	0.00	77.89	94.31	5.97
12	5	106.92	108.47	22.01	10.00	90.00	0.00	106.92	108.47	12.01
13	5	1.73	114.81	14.46	10.00	90.00	0.00	1.73	114.81	4.46
14	5	163.98	115.00	22.01	10.00	270.00	0.00	163.98	115.00	12.01
15	5	98.41	115.51	15.97	10.00	270.00	0.00	98.41	115.51	5.97
16	6	140.18	117.08	22.01	10.00	225.00	0.00	140.18	117.08	12.01
17	6	22.42	130.03	14.46	10.00	120.00	0.00	22.42	130.03	4.46
18	6	52.38	135.99	15.97	10.00	135.00	0.00	52.38	135.99	5.97
19	6	75.61	136.04	15.97	10.00	180.00	0.00	75.61	136.04	5.97
20	5	161.24	137.68	22.01	10.00	220.00	0.00	161.24	137.68	12.01
21	5	133.15	137.73	22.01	10.00	180.00	0.00	133.15	137.73	12.01
22	5	107.40	137.78	22.01	10.00	108.00	0.00	107.40	137.78	12.01
23	5	40.76	137.81	14.46	10.00	0.00	0.00	40.76	137.81	4.46
24	5	1.81	137.84	14.46	10.00	135.00	0.00	1.81	137.84	4.46
25	5	102.55	137.98	15.97	10.00	225.00	0.00	102.55	137.98	5.97

Statistics

Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
AREA 31	+	5.6 fc	23.8 fc	0.3 fc	79.3:1	18.7:1
AREA 32	+	6.0 fc	22.8 fc	0.0 fc	N/A	N/A
AREA 33	+	6.1 fc	23.1 fc	0.2 fc	115.5:1	30.5:1

SIGNAL BUTTE WTP
LIGHTING CALCULATIONS
FOR
TREATMENT COMPLEX OPERATING FLOOR

Designer
MAMTA
Date
6/6/2022
Scale
Not to Scale
Drawing No.

Summary

Luminaire Schedule											
Symbol	Label	Quantity	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens Per Lamp	Light Loss Factor	Wattage
	4	3	DIALIGHT - AREA LUMINAIRE	STW2C2G	WITH SPECULAR REFLECTORS AND CLEAR GLASS FLAT LENS	THREE ARRAYS OF LEDS. LUMINAIRE OUTPUT = 4000 LMS	1	STW2C2G.ies	4000	0.85	37.1

Statistics


Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min	Avg/Max
THICKNER 2	+	14.5 fc	32.7 fc	4.8 fc	6.8:1	3.0:1	0.4:1

Luminaire Locations

Location								Aim		
No.	Label	X	Y	Z	MH	Orientation	Tilt	X	Y	Z
1	4	22.11	42.82	8.00	8.00	225.00	0.00	22.11	42.82	0.00
2	4	4.98	27.71	8.00	8.00	135.00	0.00	4.98	27.71	0.00
3	4	-10.08	11.29	8.00	8.00	45.00	0.00	-10.08	11.29	0.00

Power Statistics


Description	# Luminaires	Total Watts	Area	Density
THICKNER 2 POWER	3	111.3 W	249.3 ft²	0.4 W/ft²

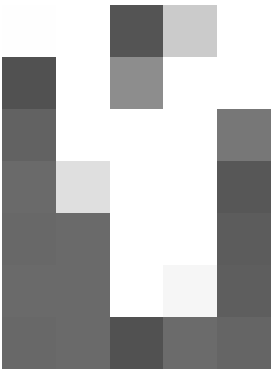

SIGNAL BUTTE
WATER TREATMENT PLANT, MESA
GRAVITY THICKNER 2

Designer
MAMTA
Date
30-MAY-22
Scale
Not to Scale
Drawing No.


Summary

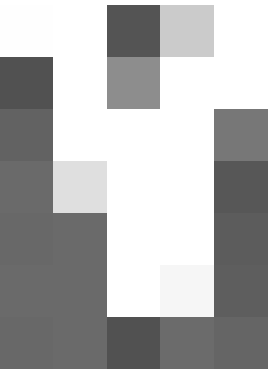


SIGNAL BUTTE
WATER TREATMENT PLANT, MESA
GRAVITY THICKNER 2

Designer
MAMTA
Date
30-MAY-22
Scale
Not to Scale
Drawing No.

Summary

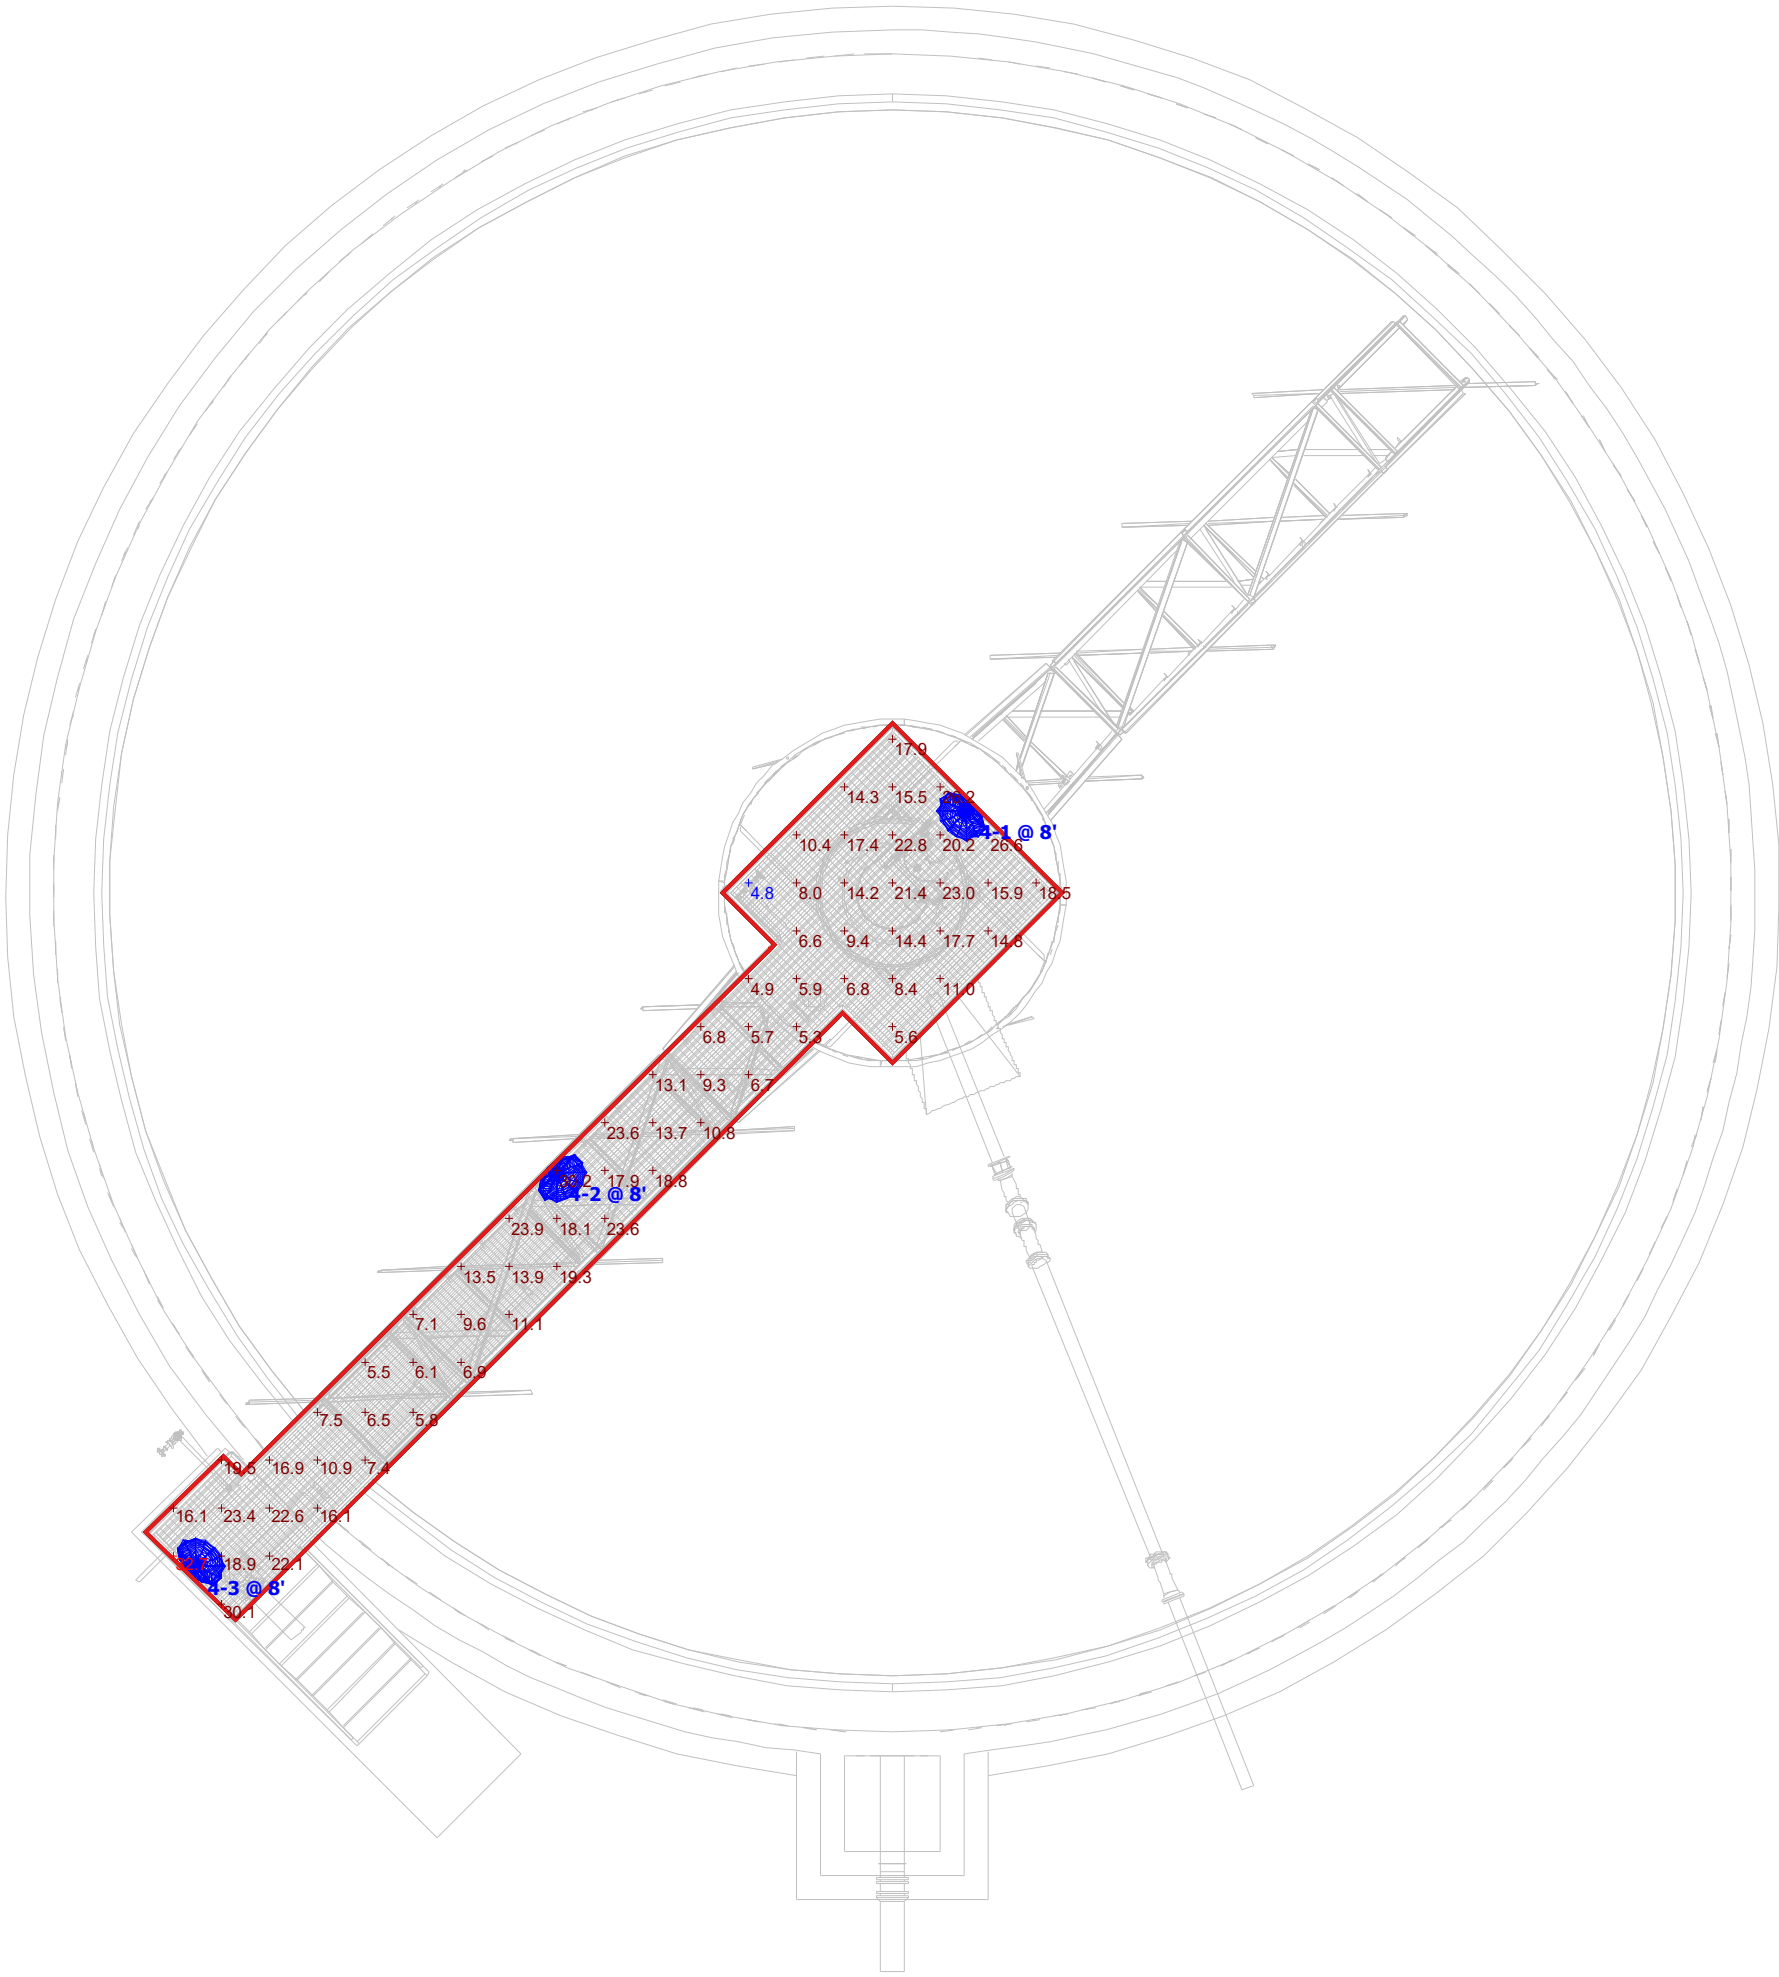

Plan View
Scale - 1" = 8'

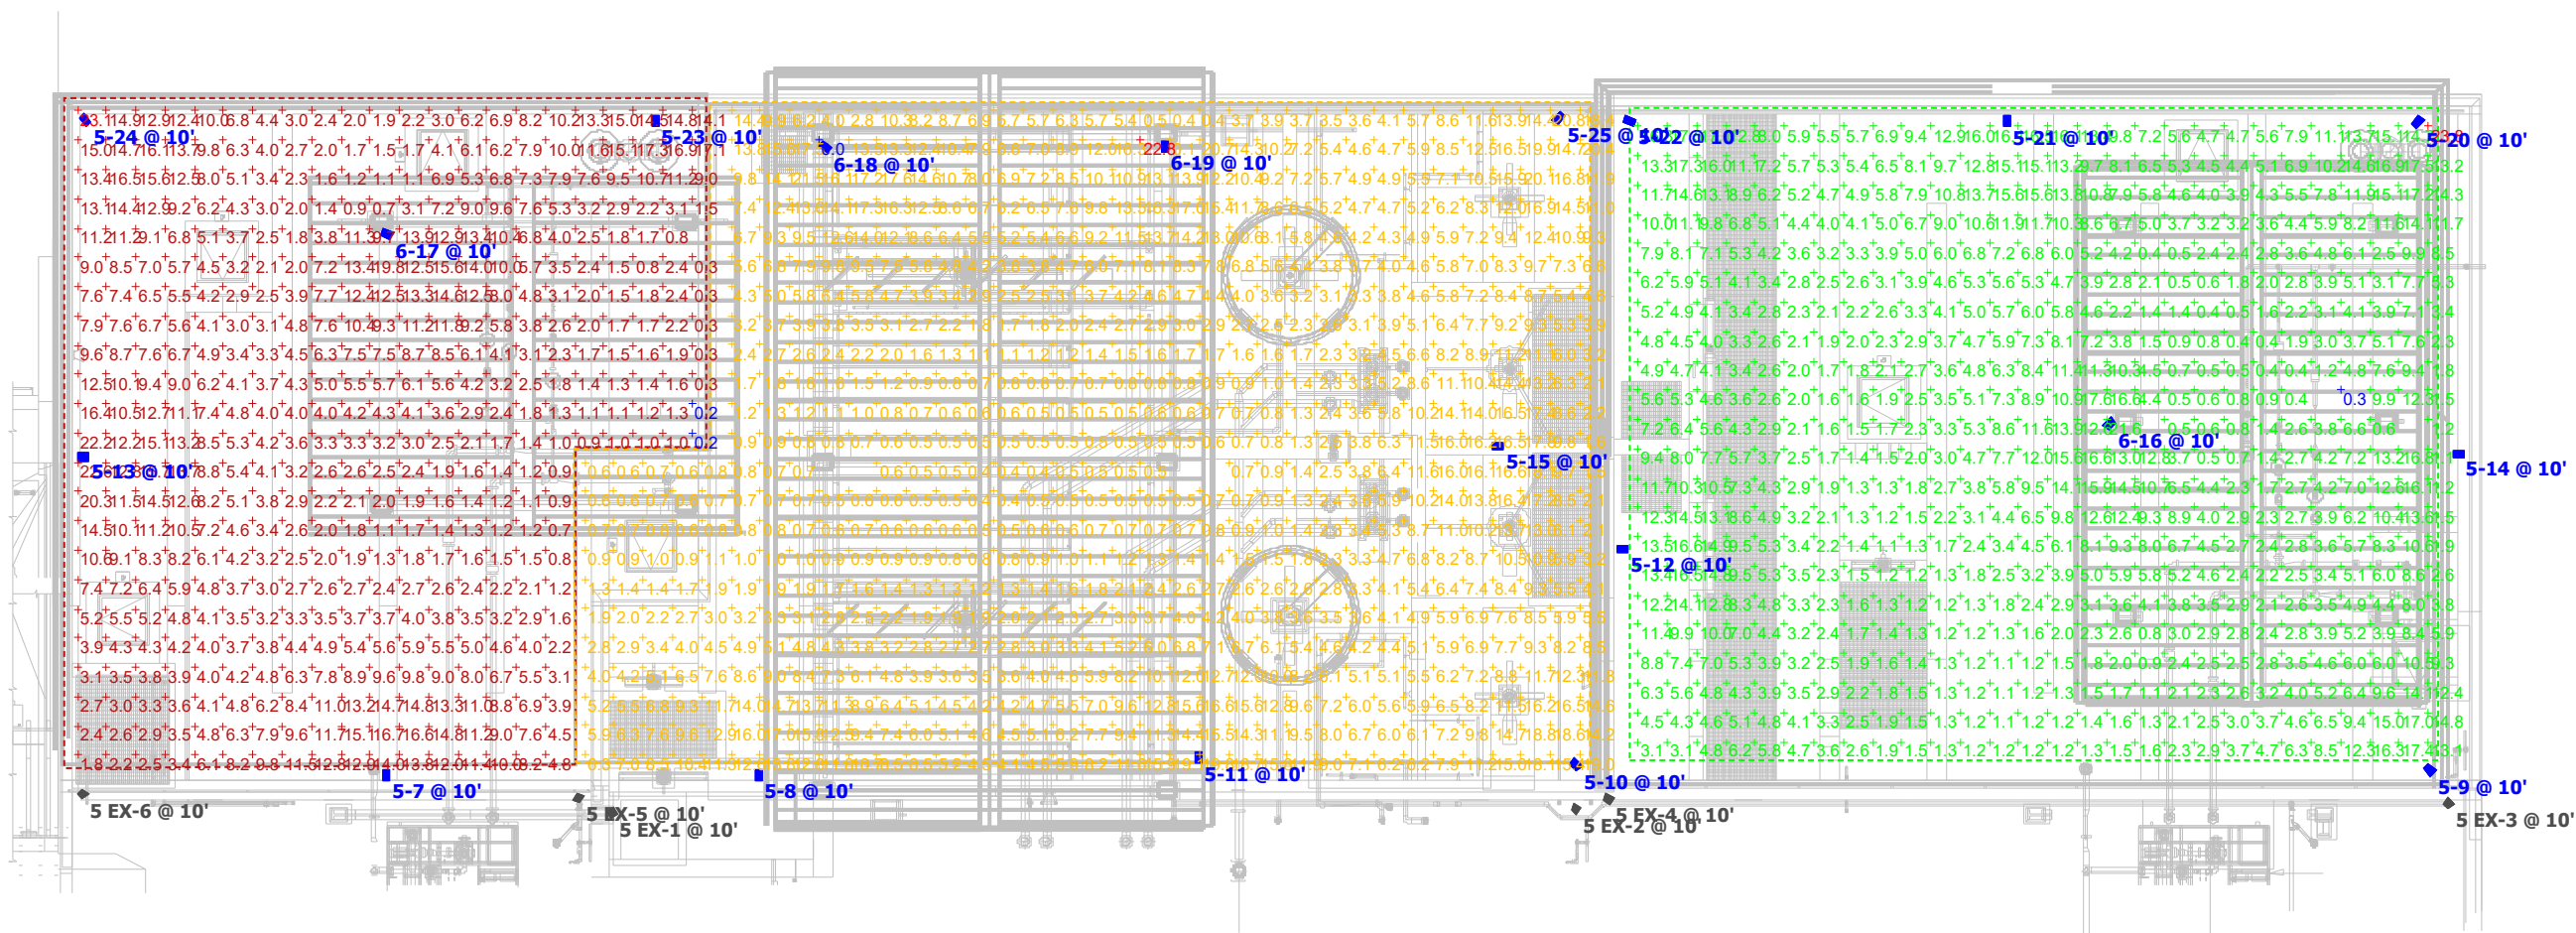

Plan View

Scale - 1" = 13'

SIGNAL BUTTE WTP
LIGHTING CALCULATIONS
FOR
TREATMENT COMPLEX OPERATING FLOOR

Designer
MAMTA
Date
6/6/2022
Scale
Not to Scale
Drawing No.

Summary

Schedule											
Symbol	Label	Quantity	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens Per Lamp	Light Loss Factor	Wattage
	JE	6	Lithonia Lighting	JCBL 12000LM ACCR 40K 80CRI	JCBL, 12,000 Lumens, Acrylic Clear Reflector, 4000K Color Temperature, 80 Color Rendering Index		1	JCBL_12000LM_ACCR_40K_80CRI.ies	12328	0.126	84
	EL1	14	LITHONIA LIGHTING	H3512S	PAR 36 GLASS SEALED BEAM LAMP	HALOGEN, 35 WATT, 12 VOLT	1	H3512SB.ies	706	0.85	35



Luminaire Locations										
Location								Aim		
No.	Label	X	Y	Z	MH	Orientation	Tilt	X	Y	Z
1	EL1	13.85	1.04	9.00	9.00	0.00	0.00	13.85	1.04	0.00
2	EL1	38.85	1.04	9.00	9.00	0.00	0.00	38.85	1.04	0.00
3	EL1	63.85	1.04	9.00	9.00	0.00	0.00	63.85	1.04	0.00
4	EL1	88.85	1.04	9.00	9.00	0.00	0.00	88.85	1.04	0.00
5	JE	17.48	25.56	14.00	14.00	0.00	0.00	17.48	25.56	0.00
6	JE	83.32	25.56	14.00	14.00	0.00	0.00	83.32	25.56	0.00
7	EL1	97.01	49.99	9.00	9.00	0.00	0.00	97.01	49.99	0.00
8	EL1	3.05	50.09	9.00	9.00	0.00	0.00	3.05	50.09	0.00
9	EL1	2.95	74.95	9.00	9.00	0.00	0.00	2.95	74.95	0.00
10	JE	17.48	74.96	14.00	14.00	0.00	0.00	17.48	74.96	0.00
11	JE	83.32	74.96	14.00	14.00	0.00	0.00	83.32	74.96	0.00
12	EL1	96.95	75.02	9.00	9.00	0.00	0.00	96.95	75.02	0.00
13	EL1	96.91	99.97	9.00	9.00	0.00	0.00	96.91	99.97	0.00
14	EL1	2.95	100.07	9.00	9.00	0.00	0.00	2.95	100.07	0.00
15	JE	17.48	125.03	14.00	14.00	0.00	0.00	17.48	125.03	0.00
16	JE	83.32	125.03	14.00	14.00	0.00	0.00	83.32	125.03	0.00
17	EL1	13.85	149.11	9.00	9.00	0.00	0.00	13.85	149.11	0.00
18	EL1	38.85	149.11	9.00	9.00	0.00	0.00	38.85	149.11	0.00
19	EL1	63.85	149.11	9.00	9.00	0.00	0.00	63.85	149.11	0.00
20	EL1	88.85	149.11	9.00	9.00	0.00	0.00	88.85	149.11	0.00

Statistics						
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
Storage Building - Emergency	+	1.0 fc	14.6 fc	0.2 fc	73.0:1	5.0:1

SIGNAL BUTTE WTP
EMERGENCY LIGHTING CALCULATIONS
FOR
STORAGE BUILDING

Designer
MAMTA
Date
5/31/2022
Scale
Not to Scale
Drawing No.


Summary

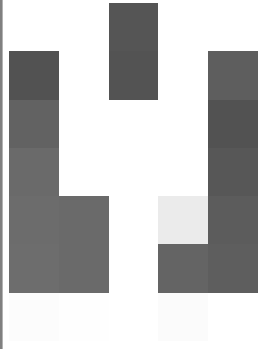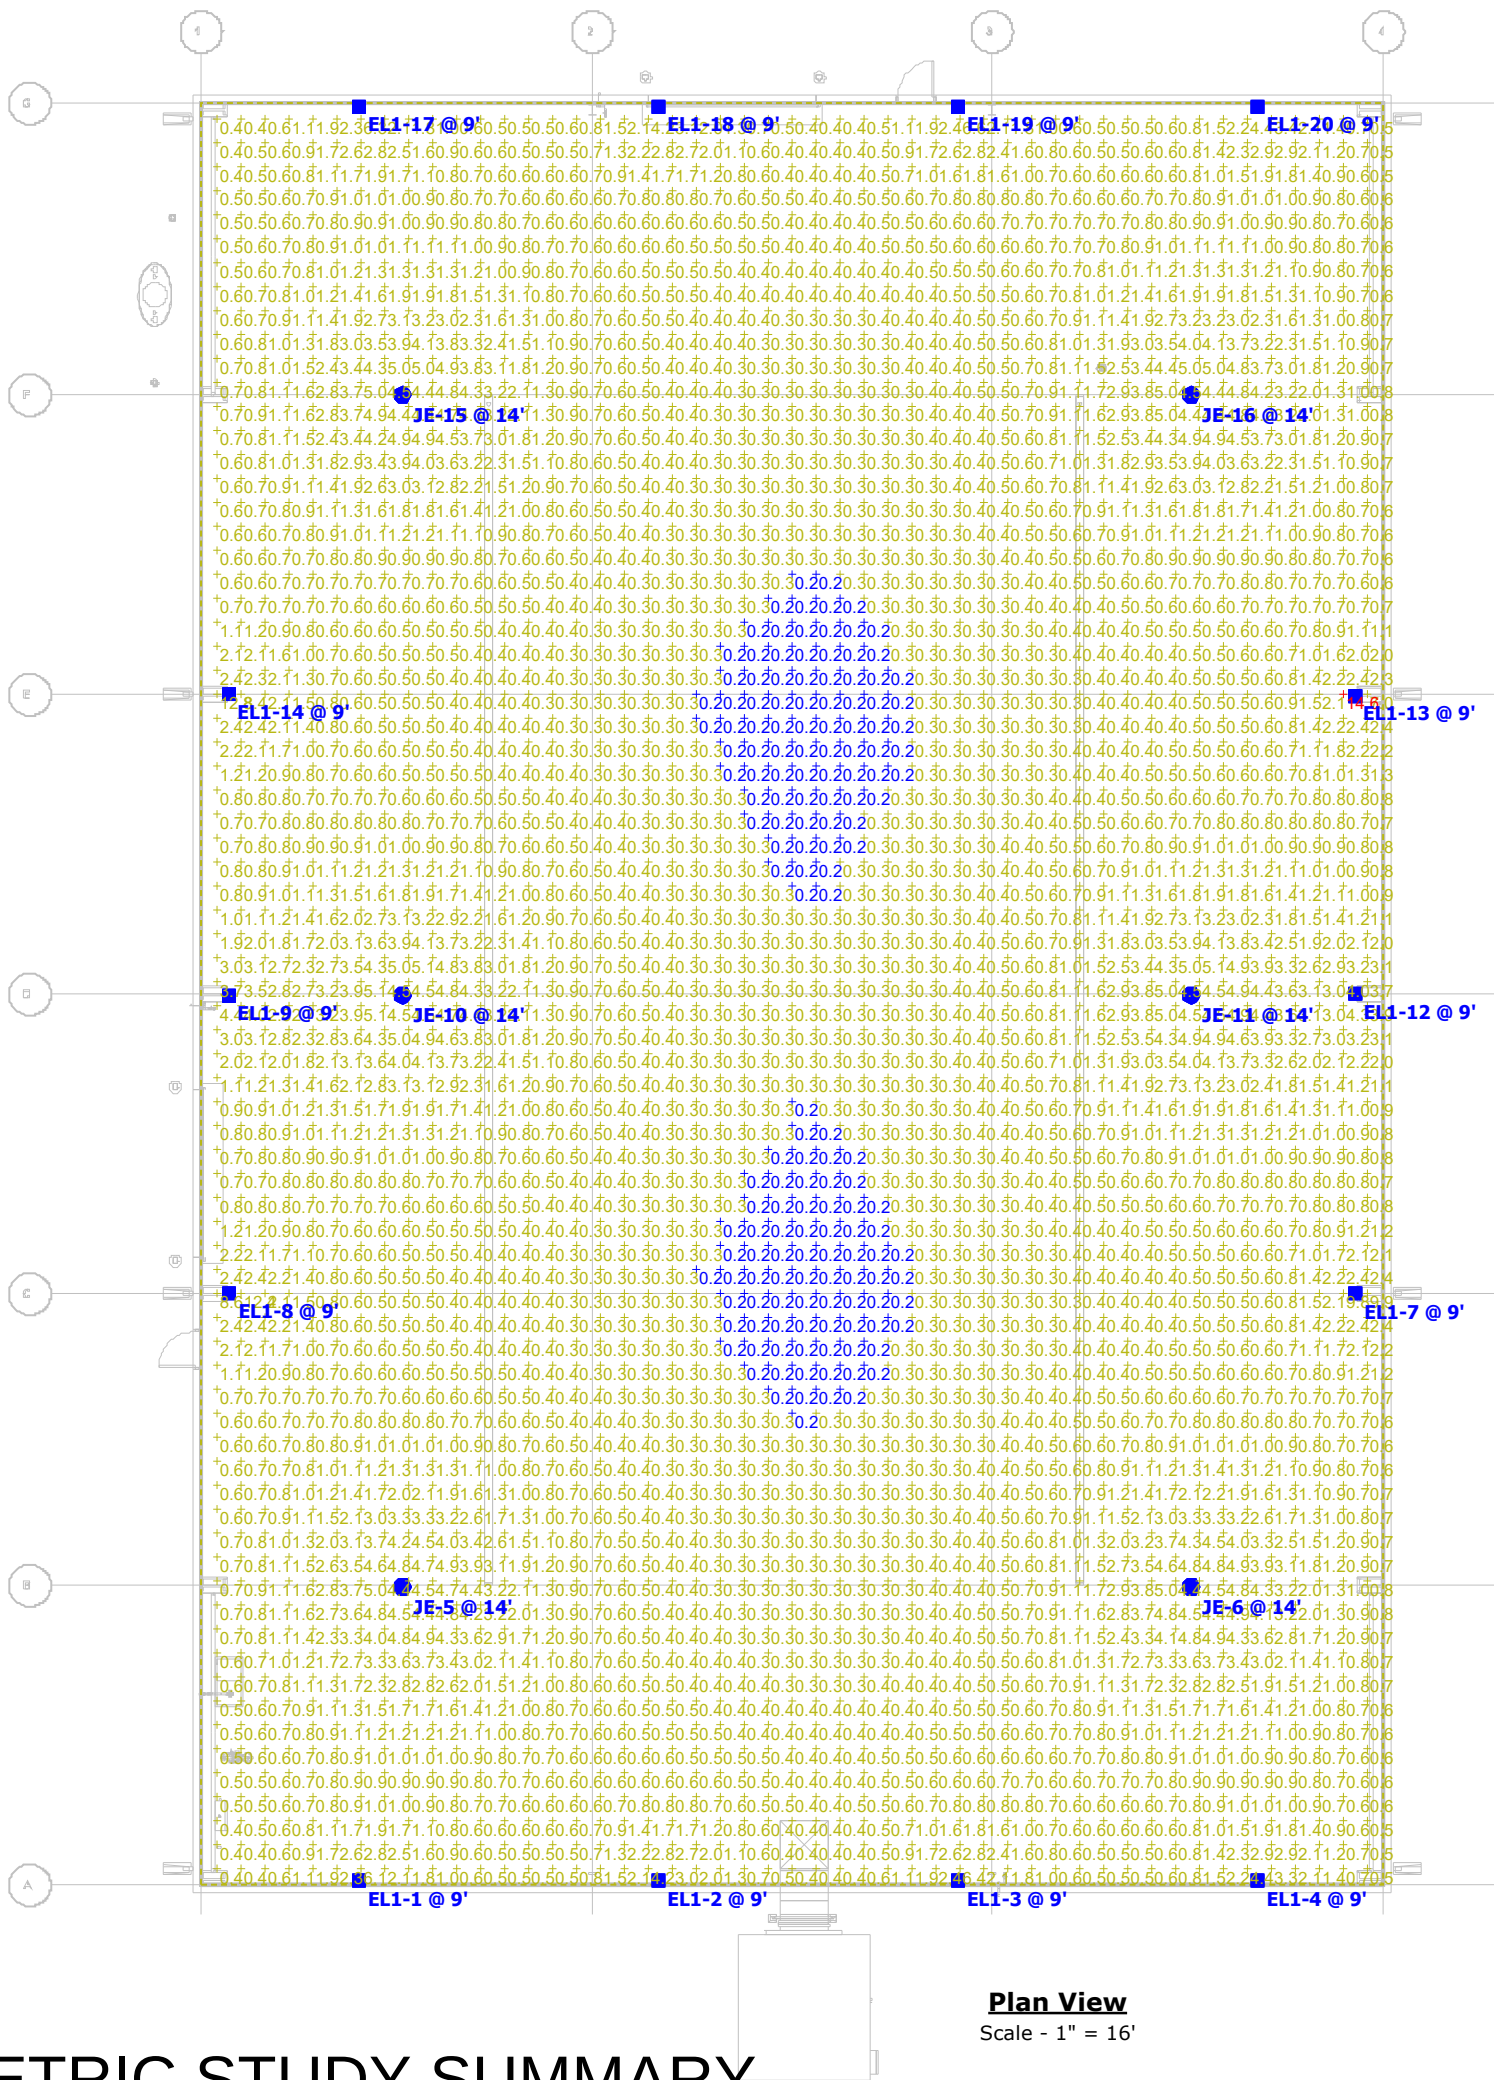

SIGNAL BUTTE WTP
EMERGENCY LIGHTING CALCULATIONS
FOR
STORAGE BUILDING

Designer
MAMTA
Date
5/31/2022
Scale
Not to Scale
Drawing No.

Summary

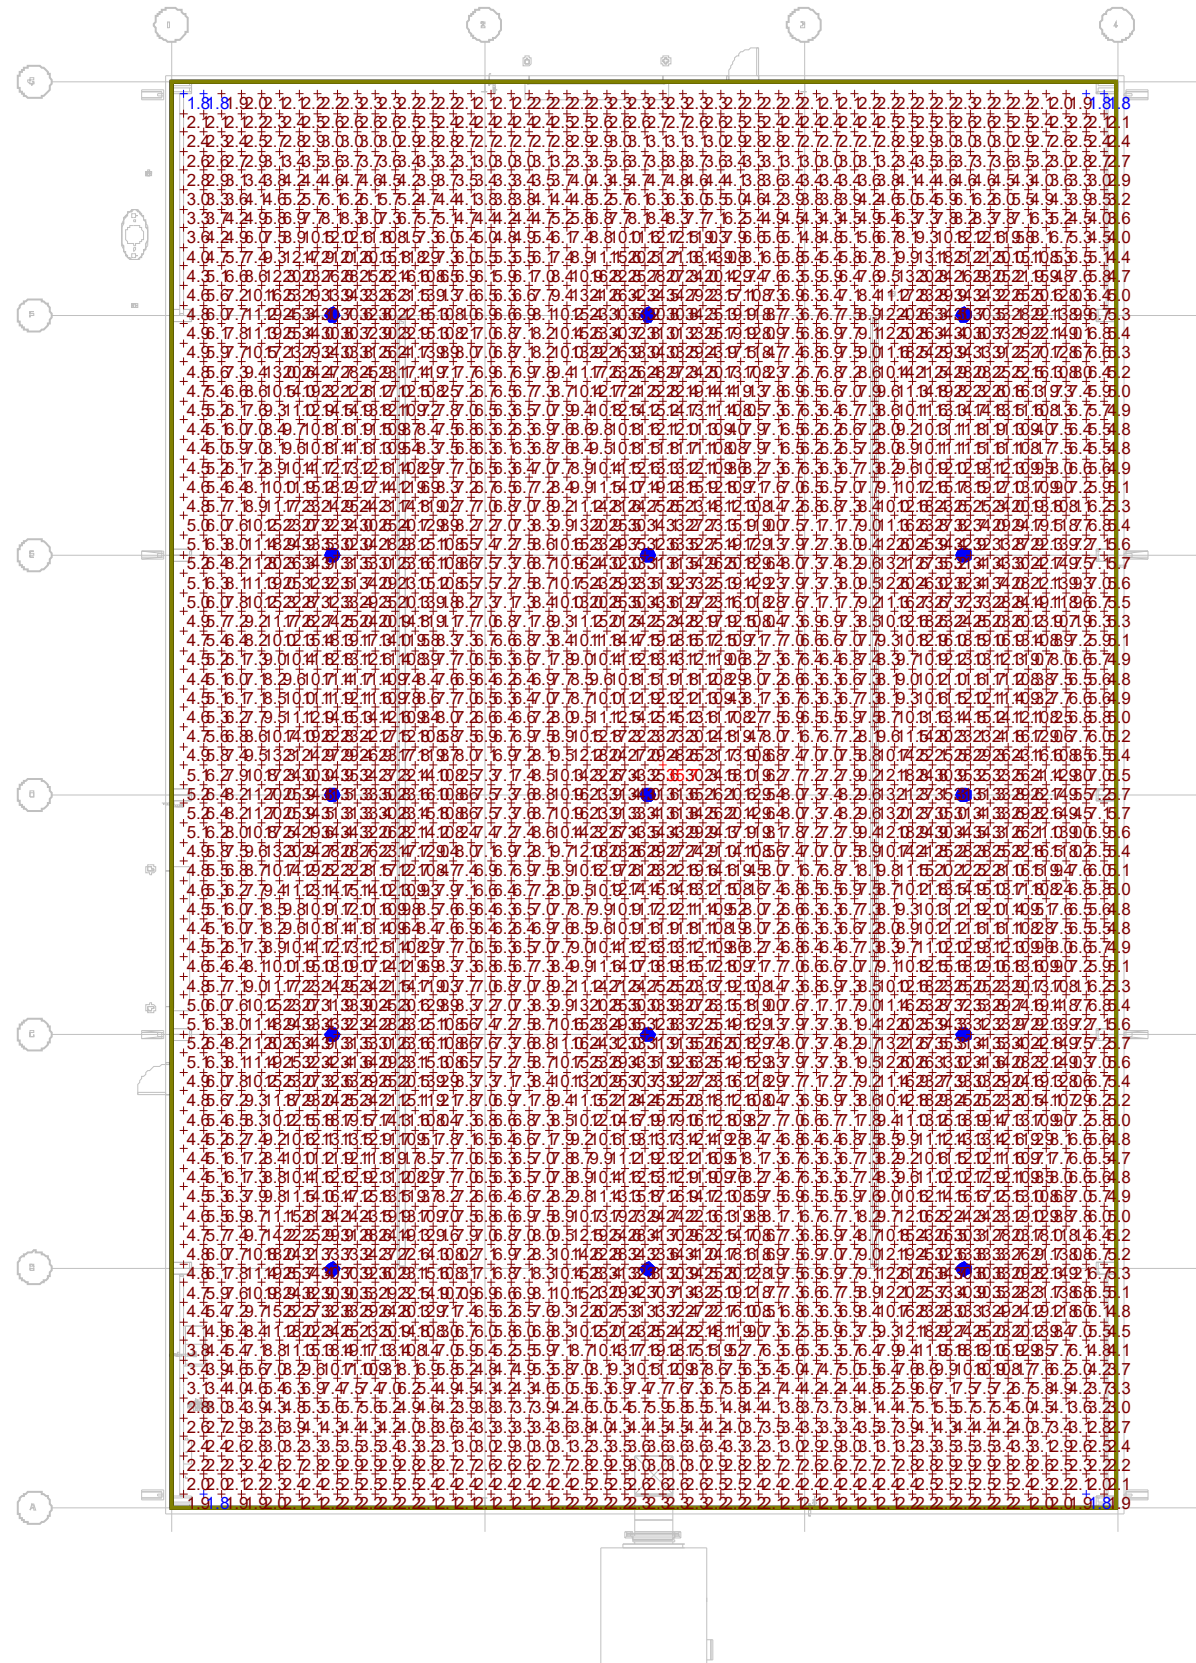

Plan View
Scale - 1" = 20"

SIGNAL BUTTE WTP
LIGHTING CALCULATIONS
FOR
STORAGE BUILDING

Designer
MAMTA
Date
5/31/2022
Scale
Not to Scale
Drawing No.

Summary

Schedule											
Symbol	Label	Quantity	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens Per Lamp	Light Loss Factor	Wattage
	C	15	Lithonia Lighting	JCBL 12000LM ACCR 40K 80CRI	JCBL, 12,000 Lumens, Acrylic Clear Reflector, 4000K Color Temperature, 80 Color Rendering Index		1	JCBL_12000LM_ACCR_40K_80CRI.ies	12328	0.85	84

Luminaire Locations										
Location								Aim		
No.	Label	X	Y	Z	MH	Orientation	Tilt	X	Y	Z
1	C	17.48	125.03	14.00	14.00	0.00	0.00	17.48	125.03	0.00
2	C	50.40	125.03	14.00	14.00	0.00	0.00	50.40	125.03	0.00
3	C	83.32	125.03	14.00	14.00	0.00	0.00	83.32	125.03	0.00
4	C	17.48	100.01	14.00	14.00	0.00	0.00	17.48	100.01	0.00
5	C	50.40	100.01	14.00	14.00	0.00	0.00	50.40	100.01	0.00
6	C	83.32	100.01	14.00	14.00	0.00	0.00	83.32	100.01	0.00
7	C	17.48	75.02	14.00	14.00	0.00	0.00	17.48	75.02	0.00
8	C	50.40	75.02	14.00	14.00	0.00	0.00	50.40	75.02	0.00
9	C	83.32	75.02	14.00	14.00	0.00	0.00	83.32	75.02	0.00
10	C	17.48	49.96	14.00	14.00	0.00	0.00	17.48	49.96	0.00
11	C	50.40	49.96	14.00	14.00	0.00	0.00	50.40	49.96	0.00
12	C	83.32	49.96	14.00	14.00	0.00	0.00	83.32	49.96	0.00
13	C	17.48	25.56	14.00	14.00	0.00	0.00	17.48	25.56	0.00
14	C	50.40	25.56	14.00	14.00	0.00	0.00	50.40	25.56	0.00
15	C	83.32	25.56	14.00	14.00	0.00	0.00	83.32	25.56	0.00

Power Statistics				
Description	# Luminaires	Total Watts	Area	Density
Storage Building Power	15	1260.0 W	14662.9 ft²	0.1 W/ft²

Statistics						
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
Storage Building	+	11.8 fc	35.7 fc	1.8 fc	19.8:1	6.6:1

SIGNAL BUTTE WTP
LIGHTING CALCULATIONS
FOR
STORAGE BUILDING

Designer
MAMTA
Date
5/31/2022
Scale
Not to Scale
Drawing No.

Summary

Schedule											
Symbol	Label	Quantity	Manufacturer	Catalog Number	Description	Lamp	Number Lamps	Filename	Lumens Per Lamp	Light Loss Factor	Wattage
	8	25	DIALIGHT - HIGH BAY LUMINAIRE	HB2C4M	WITH WHITE INTERIOR AND CLEAR FLAT PLASTIC LENS	EIGHTY FOUR LEDS. LUMINAIRE OUTPUT = 11274 LM	1	HB2C4M_LM 79.IES	11287	0.85	134

Luminaire Locations										
Location								Aim		
No.	Label	X	Y	Z	MH	Orientation	Tilt	X	Y	Z
1	8	14.48	125.03	14.00	14.00	0.00	0.00	14.48	125.03	0.00
2	8	14.48	100.01	14.00	14.00	0.00	0.00	14.48	100.01	0.00
3	8	14.48	75.02	14.00	14.00	0.00	0.00	14.48	75.02	0.00
4	8	14.48	49.96	14.00	14.00	0.00	0.00	14.48	49.96	0.00
5	8	14.48	25.56	14.00	14.00	0.00	0.00	14.48	25.56	0.00
6	8	32.48	125.03	14.00	14.00	0.00	0.00	32.48	125.03	0.00
7	8	32.48	100.01	14.00	14.00	0.00	0.00	32.48	100.01	0.00
8	8	32.48	75.02	14.00	14.00	0.00	0.00	32.48	75.02	0.00
9	8	32.48	49.96	14.00	14.00	0.00	0.00	32.48	49.96	0.00
10	8	32.48	25.56	14.00	14.00	0.00	0.00	32.48	25.56	0.00
11	8	50.48	125.03	14.00	14.00	0.00	0.00	50.48	125.03	0.00
12	8	50.48	100.01	14.00	14.00	0.00	0.00	50.48	100.01	0.00
13	8	50.48	75.02	14.00	14.00	0.00	0.00	50.48	75.02	0.00
14	8	50.48	49.96	14.00	14.00	0.00	0.00	50.48	49.96	0.00
15	8	50.48	25.56	14.00	14.00	0.00	0.00	50.48	25.56	0.00
16	8	68.48	125.03	14.00	14.00	0.00	0.00	68.48	125.03	0.00
17	8	68.48	100.01	14.00	14.00	0.00	0.00	68.48	100.01	0.00
18	8	68.48	75.02	14.00	14.00	0.00	0.00	68.48	75.02	0.00
19	8	68.48	49.96	14.00	14.00	0.00	0.00	68.48	49.96	0.00
20	8	68.48	25.56	14.00	14.00	0.00	0.00	68.48	25.56	0.00
21	8	86.48	125.03	14.00	14.00	0.00	0.00	86.48	125.03	0.00
22	8	86.48	100.01	14.00	14.00	0.00	0.00	86.48	100.01	0.00
23	8	86.48	75.02	14.00	14.00	0.00	0.00	86.48	75.02	0.00
24	8	86.48	49.96	14.00	14.00	0.00	0.00	86.48	49.96	0.00
25	8	86.48	25.56	14.00	14.00	0.00	0.00	86.48	25.56	0.00


Power Statistics				
Description	# Luminaires	Total Watts	Area	Density
Storage Building Power	25	3350.0 W	14662.9 ft²	0.2 W/ft²

Statistics						
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min
Storage Building	+	18.2 fc	31.4 fc	2.9 fc	10.8:1	6.3:1

SIGNAL BUTTE WTP
LIGHTING CALCULATIONS
FOR
STORAGE BUILDING

Designer
MAMTA
Date
5/31/2022
Scale
Not to Scale
Drawing No.

Summary

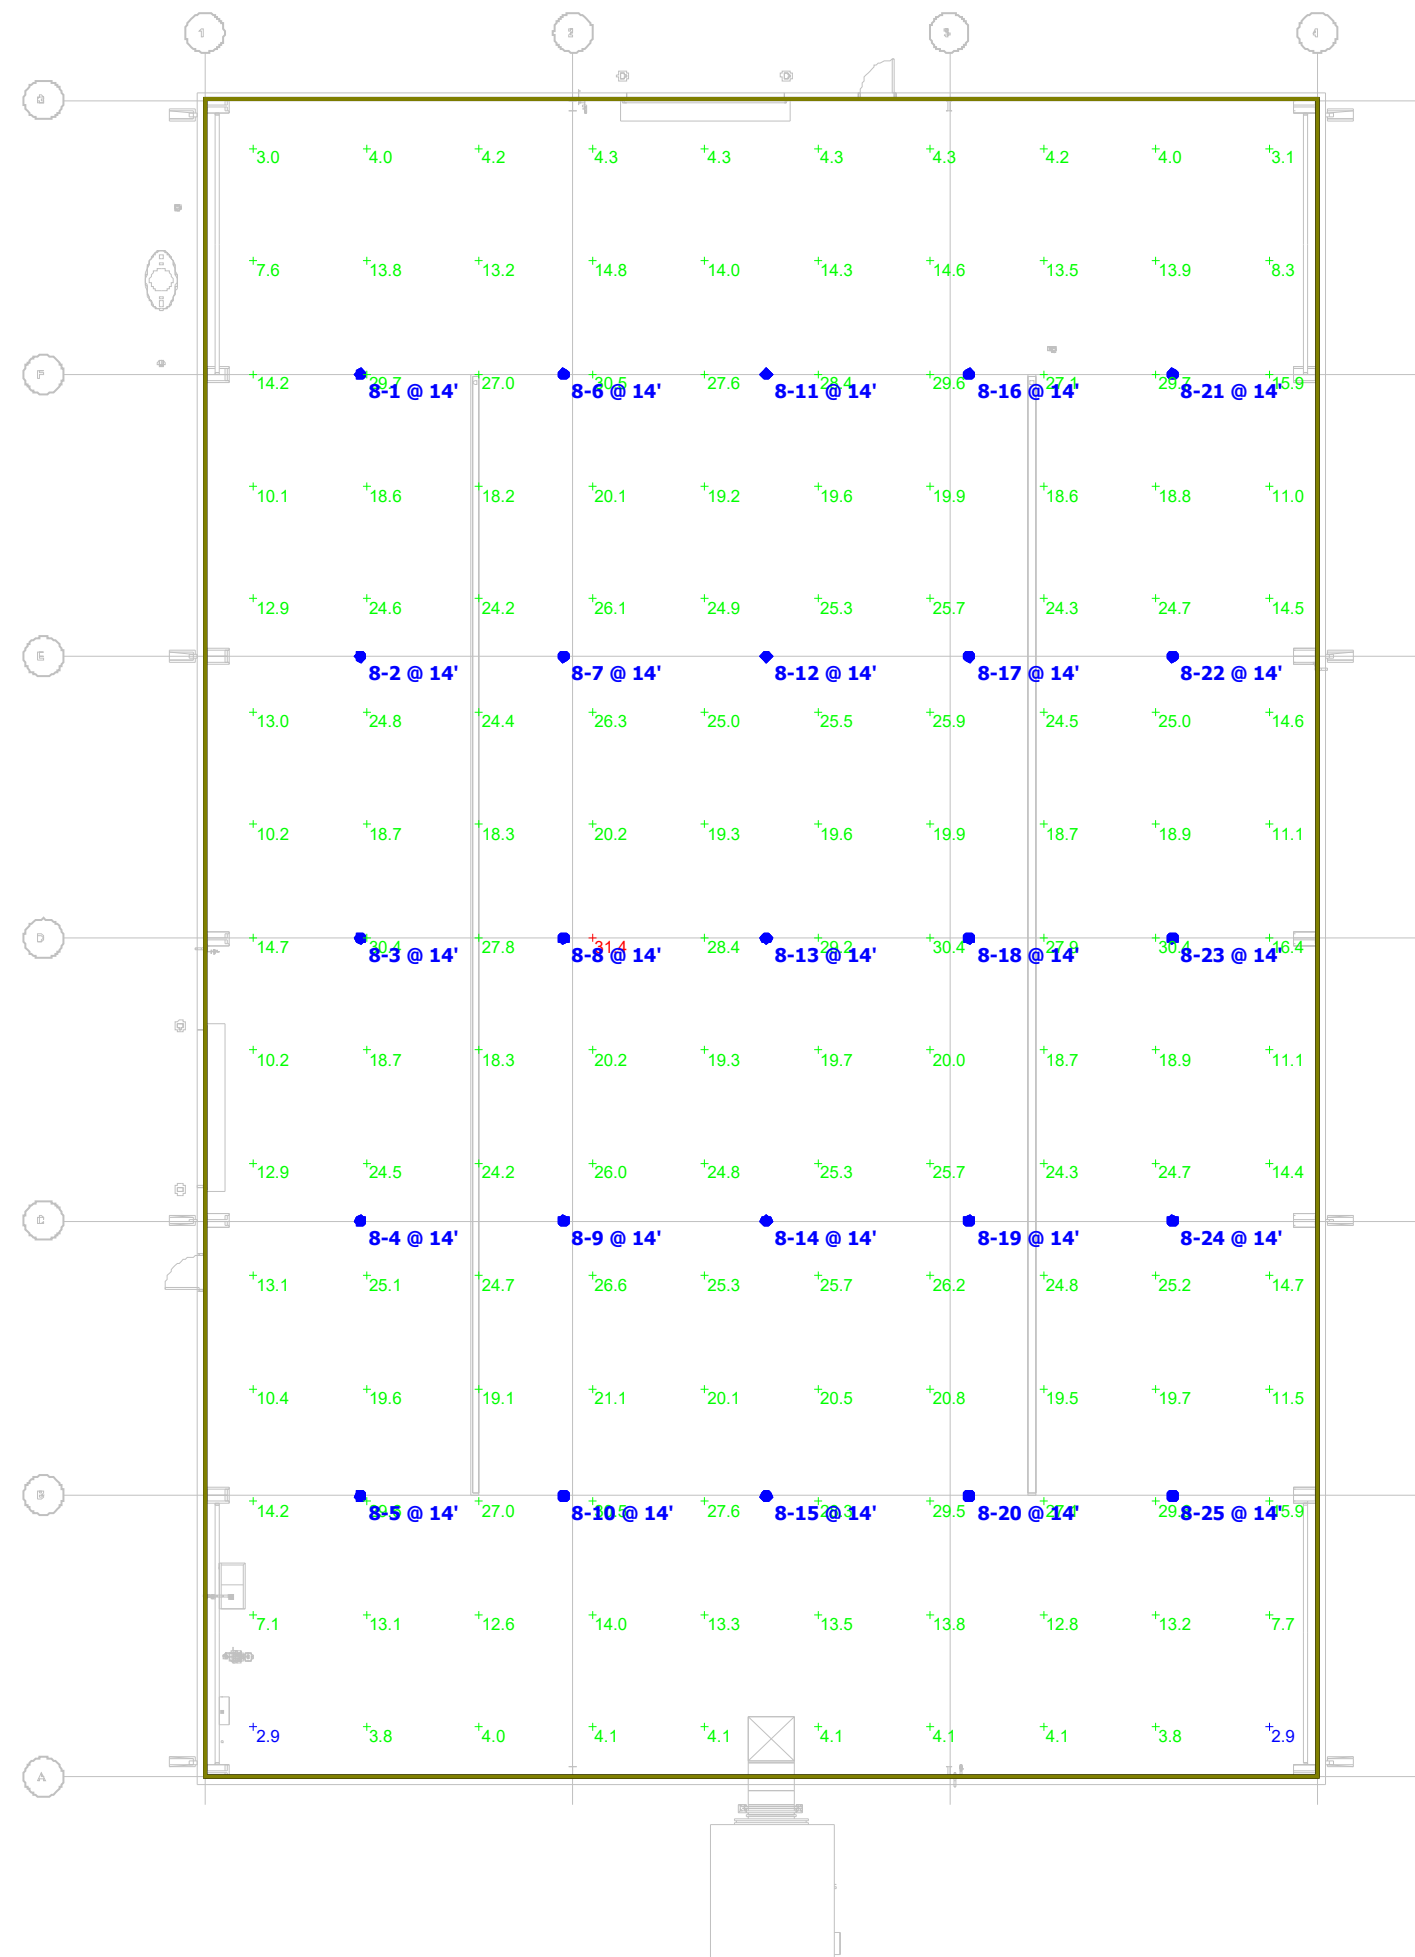

Plan View
Scale - 1" = 17'

PHOTOMETRIC STUDY SUMMARY


SIGNAL BUTTE WTP LIGHTING CALCULATIONS FOR STORAGE BUILDING

Designer
MAMTA
Date
5/31/2022
Scale
Not to Scale
Drawing No.

Summary

On when it matters most.

Products and solutions that protect your business

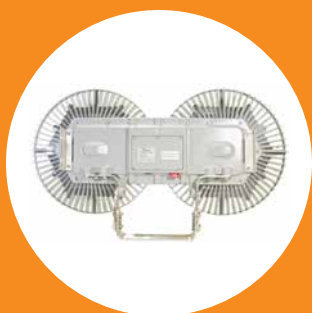



Features & Benefits

- 10 year full performance warranty available on specific models
- 5 year full performance warranty standard
- L70 rated for >100,000 hours @ 25°C
- Instant on/off
- No UV or IR
- Produces minimal heat compared to traditional fixtures
- Resistant to shock and vibration
- Temperature compensation technology for long life

Application


Dialight's DuroSite® LED High Bay fixture was designed specifically to replace conventional lighting in a wide variety of industrial applications; both indoor and outdoor. Its low profile light weight design and versatile mounting options make it ideal for many applications such as warehouse, garage, aisle, cold storage, bridge, tunnel and general area lighting.

DuroSite LED High Bay - 25,000 Lumens - UL

25,000 Lumens Standard Models



Patent pending

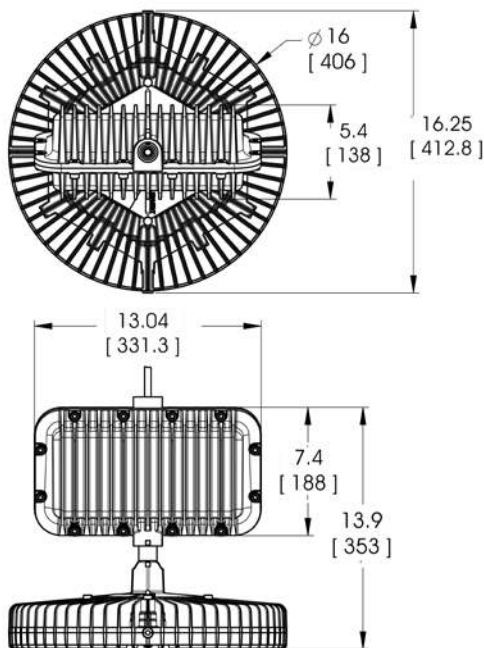

Dimensions in inches [mm]

Certifications & Ratings

- UL 1598/A
- CSA 22 #250
- ABS Design Assessed: #13-HS104321D
- NEMA 4X (Pending)
- IP66

Mechanical Information:

Fixture weight:	30 lbs (13.6 kg)
Shipping weight:	35 lbs (15.88 kg)
Mounting:	(1) 3/4" NPT - top (2) 5/16"-18 x .75" UNC - side
Entries:	10' (3.05m) STOOOW Power Cord

Electrical specifications:

Operating Voltage:	100 - 277V AC 347 - 480V AC (consult with factory)
Total system power consumption:	See table
Operating Temp:	-40°F to +149°F (-40°C to +65°C)
Harmonics:	IEC 61000-3-2
Noise requirement /EMC:	FCC Title 47, Subpart B, Section 15, class A device. RF Immunity; 10V/m, 80MHz-1GHz
Transient protection:	10kV/2 ohm, 1.2/50us, 8/20us combination wave, as per IEEE C62.41, line-line and line-ground
THD:	<20%
Power Factor:	> 0.9
Fusing:	Internal on black wire
Construction:	
Housing:	Copper free aluminum
Finish:	Superior dual coat finish - sealed polyester topcoat - chemical resistant epoxy primer
Lens:	Tempered glass

Photometric Information:

CRI:	75
CCT:	5000K (cool white) 4000K (neutral white)



All values typical unless otherwise stated
Lumen values are typical (tolerance +/- 10%)

DuroSite LED High Bay - UL

8,500 - 17,000 Lumens Standard Models



Patent pending

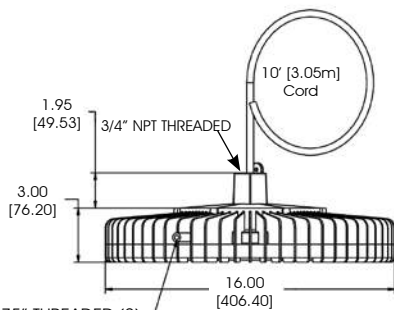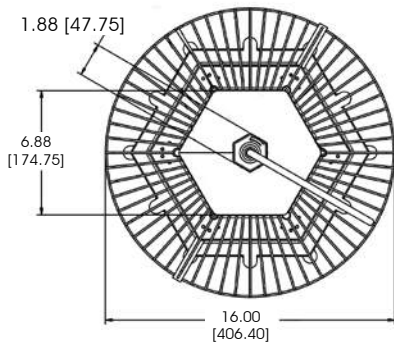

5/16"-18 X .75" THREADED (2) Dimensions in Inches [mm]

Certifications & Ratings

- UL 1598 (acrylic lens models)
- UL 1598A (polycarbonate lens and tempered glass)
- CSA 22 #250
- ABS Design Assessed: #12-HS950618-PDA
- NEMA 4X
- IP66

Mechanical Information:

Fixture weight:	17 lbs (7.7 kg)
Shipping weight:	23 lbs (10.43 kg)
Mounting:	(1) 3/4" NPT - top (2) 5/16"-18 x .75" UNC - side
Entries:	10' (3.05m) STOOOW Power Cord

Electrical specifications:

Operating Voltage:	100 - 277V AC 347 - 480V AC (consult with factory)
---------------------------	---

Total system power consumption:	See table
--	-----------

Operating Temp:	-40°F to +149°F (-40°C to +65°C)
------------------------	----------------------------------

Harmonics:	IEC 61000-3-2
-------------------	---------------

Noise requirement /EMC:	FCC Title 47, Subpart B, Section 15, class A device. RF Immunity; 10V/m, 80MHz-1GHz
--------------------------------	---

Transient protection:	Protection devices capable of handling up to 6kV. Tested for 6kV/2 ohm combination wave, as per IEEE C62.41, line-line and line-ground
------------------------------	--

THD:	<20%
-------------	------

Power Factor:	> 0.9
----------------------	-------

Fusing:	Internal on black wire
----------------	------------------------

Construction:

Housing:	Copper free aluminum
Finish:	Superior dual coat finish - sealed polyester topcoat - chemical resistant epoxy primer

Lens:	Acrylic - UL 1598 dry location only Polycarbonate - UL1598A wet location Polycarbonate dome lens Tempered glass
--------------	--

Photometric Information:

CRI:	75
CCT:	5000K (cool white) 4000K (neutral white)



All values typical unless otherwise stated
Lumen values are typical (tolerance +/- 10%)

DuroSite LED High Bay - UL

Occupancy Sensor Models



Patent pending

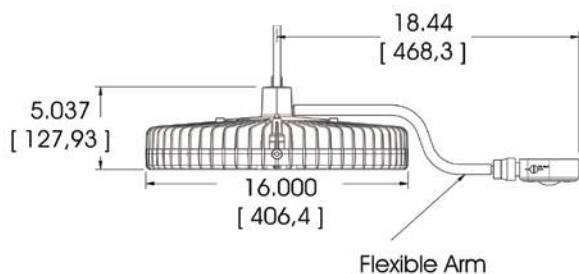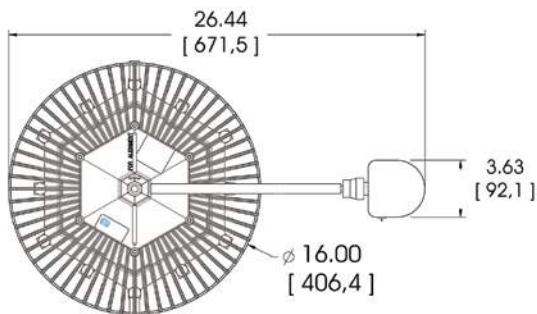

Dimensions in Inches [mm]

Certifications & Ratings

- IP65

Features & Benefits

- No additional electrical connections required for installation
- Flexible conduit permitting the positioning of the occupancy sensor for optimal coverage
- Interchangeable sensor lens for high bay, low bay, or aisle application

Mechanical Information:

Fixture weight:	20 lbs (13.34kg)
Shipping weight:	27 lbs (9.62kg)
Mounting:	(1) 3/4" NPT - top (2) 5/16"-18 x .75" UNC - side
Entries:	10' (3.05m) STOOW Power Cord

Sensor:

Sensor Mounting:	Attached to the base of the neck using a semi-rigid flexible conduit
Occupancy Sensor:	Wet location wattstopper
Sensor Lens Options:	30 seconds to 20 minutes
Operating Temperature:	Interchangeable lenses for multiple mounting heights and sensor patterns

Electrical specifications for High Bay:

Operating Voltage:	100 - 277V AC 347 - 480V AC (consult with factory)
Total system power consumption:	See table
Operating Temp:	-40°F to +149°F (-40°C to +65°C)
Harmonics:	IEC 61000-3-2
Noise requirement /EMC:	FCC Title 47, Subpart B, Section 15, class A device. RF Immunity; 10V/m, 80MHz-1GHz
Transient protection:	Protection devices capable of handling up to 6kV. Tested for 6kV/2 ohm combination wave, as per IEEE C62.41, line-line and line-ground
THD:	<20%
Power Factor:	> 0.9

Construction:

Housing:	Copper free aluminum
Finish:	Superior dual coat finish - sealed polyester topcoat - chemical resistant epoxy primer
Lens:	Tempered glass


Photometric Information:

CRI:	75
CCT:	5000K (cool white) 4000K (neutral white)

All values typical unless otherwise stated
Lumen values are typical (tolerance +/- 10%)

DuroSite LED High Bay - UL

Variable Dimming (0-10V DC) & STEP Dimming High Bays

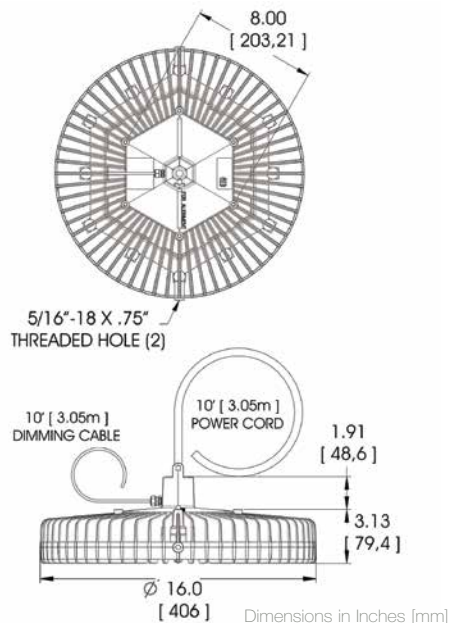

Features & Benefits

- 10' plenum rated dimming control cable pre-installed
- Dimming cabling independent of fixture wiring
- Multiple High Bays can be connected to the same dimmer

Mechanical Information:

Fixture weight:	20 lbs (13.34kg)
Shipping weight:	27 lbs (9.62kg)
Mounting:	(1) 3/4" NPT - top (2) 5/16"-18 x .75" UNC - side
Entries:	10' (3.05m) STOOOW Power Cord

Variable Dimming:

Variable Dimming Cable:	Two conductor cable
Power Cable:	Three conductor cable
Dimming Cable Position:	Side of the neck through a cable gland
Variable Dimming Control:	0-10V DC
Dimming Range:	10V DC = 100% light output 0V DC = 30% light output

Electrical specifications for High Bay:

Operating Voltage:	100 - 277V AC 347 - 480V AC (consult with factory)
Total system power consumption:	See table
Operating Temp:	-40°F to +149°F (-40°C to +65°C)
Harmonics:	IEC 61000-3-2
Noise requirement /EMC:	FCC Title 47, Subpart B, Section 15, class A device. RF Immunity; 10V/m, 80MHz-1GHz
Transient protection:	Protection devices capable of handling up to 6kV. Tested for 6kV/2 ohm combination wave, as per IEEE C62.41, line-line and line-ground
THD:	<20%
Power Factor:	> 0.9

Construction:

Housing:	Copper free aluminum
Finish:	Superior dual coat finish - sealed polyester topcoat - chemical resistant epoxy primer
Lens:	Tempered glass

Photometric Information:

CRI:	75
CCT:	5000K (cool white) 4000K (neutral white)

All values typical unless otherwise stated
Lumen values are typical (tolerance +/- 10%)

DuroSite LED High Bay - UL

Ordering Information

Part Number	Fixture Lumen	Wattage	LPW	Warranty	Voltage	CCT	Lens		Optical Pattern
							Clear	Diffused	
Standard Models - 100 - 277V AC									
HLGC4KN10YR	25,000	270	93	10yr	100 - 277V AC	5000K (cool white)	Tempered Glass		Circular
HBGCOMP	17,500	170	103	10yr	100 - 277V AC	5000K (cool white)	Tempered Glass		Circular
HBGC4P	15,000	146	99	10yr	100 - 277V AC	5000K (cool white)	Tempered Glass		Circular
HBEC4P	13,000	150	90	10yr	100 - 277V AC	5000K (cool white)	Tempered Glass		Aisle
HB2C4P	13,000	146	90	10yr	100 - 277V AC	5000K (cool white)	Polycarbonate		Circular
HB6C4M	11,750	146	80	5yr	100 - 277V AC	5000K (cool white)	Tempered Glass		Aisle
HB7C4M	11,750	146	80	5yr	100 - 277V AC	5000K (cool white)	Tempered Glass		Aisle
HB1C4J	11,000	146	75	5yr	100 - 277V AC	5000K (cool white)	Acrylic		Circular
HB2C4M	10,750	146	74	5yr	100 - 277V AC	5000K (cool white)	Polycarbonate		Circular
HB2C4K	10,500	146	72	5yr	100 - 277V AC	5000K (cool white)	Polycarbonate		Circular
HB4C4L	8,500	124	69	5yr	100 - 277V AC	5000K (cool white)		Polycarbonate	Circular
HBWC4L	8,500	107	79	10yr	100 - 277V AC	5000K (cool white)		Polycarbonate Dome	Wide
Occupancy Sensor models*									
HLGC1KS10YR	25,000	270	93	5yr	100 - 277V AC	5000K (cool white)	Tempered Glass		Circular
HB6C4T	11,750	146	80	5yr	100 - 277V AC	5000K (cool white)	Tempered Glass		Aisle
HB7C1T	11,750	146	80	5yr	100 - 277V AC	5000K (cool white)	Tempered Glass		Aisle
HB1C4T	11,500	146	79	5yr	100 - 277V AC	5000K (cool white)	Acrylic		Circular
HB2C4T	10,750	146	74	5yr	100 - 277V AC	5000K (cool white)	Polycarbonate		Circular
Variable Dimming models									
HB7C4Y	11,750	146	80	5yr	100 - 277V AC	5000K (cool white)	Tempered Glass		Aisle
HB6C4Y	11,750	146	80	5yr	100 - 277V AC	5000K (cool white)	Tempered Glass		Aisle
HBGCQQ	17,500	170	103	5yr	100 - 277V AC	5000K (cool white)	Tempered Glass		Circular
HBGC1Q	15,000	146	103	5yr	100 - 277V AC	5000K (cool white)	Tempered Glass		Circular

All values typical unless otherwise stated, Lumen values are typical (tolerance +/- 10%).

¹ Polycarbonate and tempered glass lens units meet IP 66 when installed using conduit or an IP66 approved cable gland at the 3/4 NPT. Dialight offers IP66 approved cable glands as part of accessories HBXW2 and HBXCG.

² Part numbers with occupancy sensor that will be installed with Hook or Loop (HBXH or HBXL) accessories will require a counter balance installed prior to shipment. Consult factory. For Dialight's complete list of DLC qualified products, please click this link: www.dialight.com/DLC

DuroSite LED High Bay - UL

Mounting Accessories for 8,500 - 17,000 Lumens Standard Models



HBXW3-SSL-316
HBXW3-SSL-304

- Stainless steel bracket



HBXCAB48

- 48" long stainless steel safety rope (for use with safety bracket)



HBXDC

- 21° slope dust cover

HBXDC45

- 45° slope dust cover

HBXDC60

- 60° slope dust cover



FLX1HBXSS

- 304 Stainless steel forward throw bracket



HBXTH347480

- Top hat with 347-480V AC step down transformer (consult factory when using with hook or loop)



HBXHH

- Hook



HBXW2

- Swivel bracket and cable gland

HBXW3

- Swivel bracket



HBXHL

- Loop




HBXDUALBRCKT

- Dual bracket



HBXCU

- Ceiling / wall mount



HBXREF22

- 22" Acrylic reflector (must be ordered with high bay, not a retrofit option)



HBXCG

- Cable gland



HBXLENGC

- Clear tempered glass

HBXLENAC

- Acrylic lens, clear

HBXLENAD

- Acrylic lens, diffused

HBXLENPC

- Polycarbonate lens, clear

HBXLENPD

- Polycarbonate lens, diffused

DuroSite LED High Bay - UL

Mounting Accessories for 25,000 Lumens Standard Models

**HBXCU**

- Ceiling / wall mount

**HBXL**

- Loop

**HLXW2**

- Swivel bracket and cable gland

HLXW3

- Swivel bracket

**HBXCG**

- Cable Gland

**HBXLENGC**

- Clear tempered glass


**HBXH**

- Hook


DuroSite LED High Bay - UL

Options and Accessories Drawings


HBXW2 - Swivel Bracket and Cable Gland (8,000 - 17,000lm)

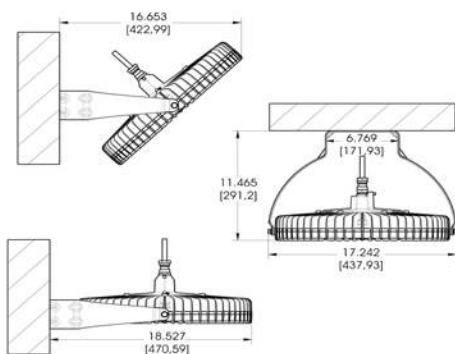


HLXW3 - Swivel Bracket (25,000lm)

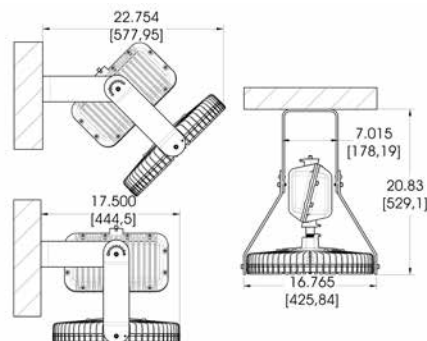


HBXCU - Ceiling Mount

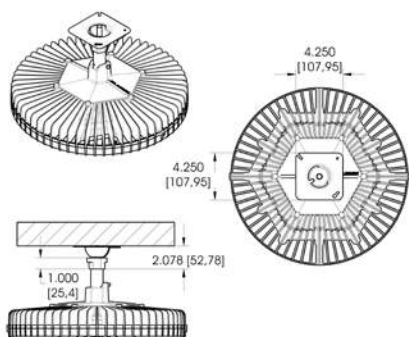


LBXLENP - Dome Lens

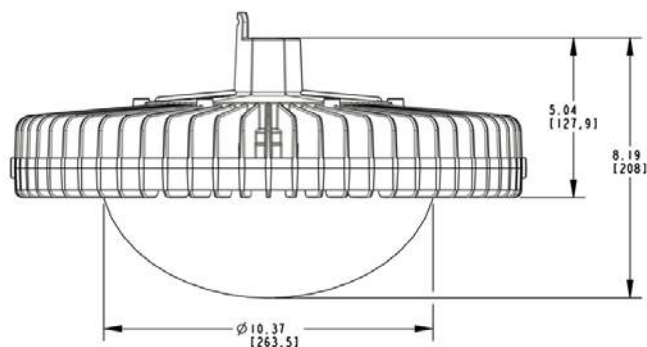


HBXREF22 - 22" Acrylic Reflector

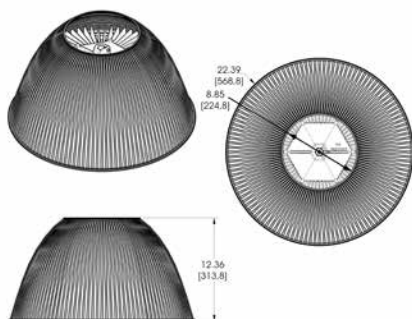


HBXDUALBRCKT - Dual Bracket

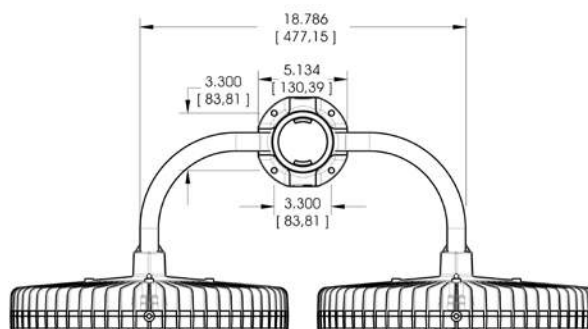

HBXREF22 - 22" Acrylic Reflector

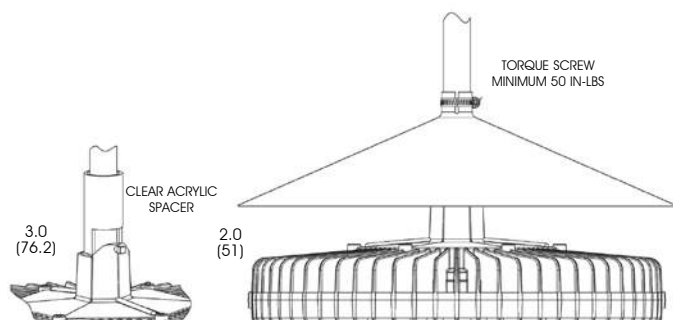

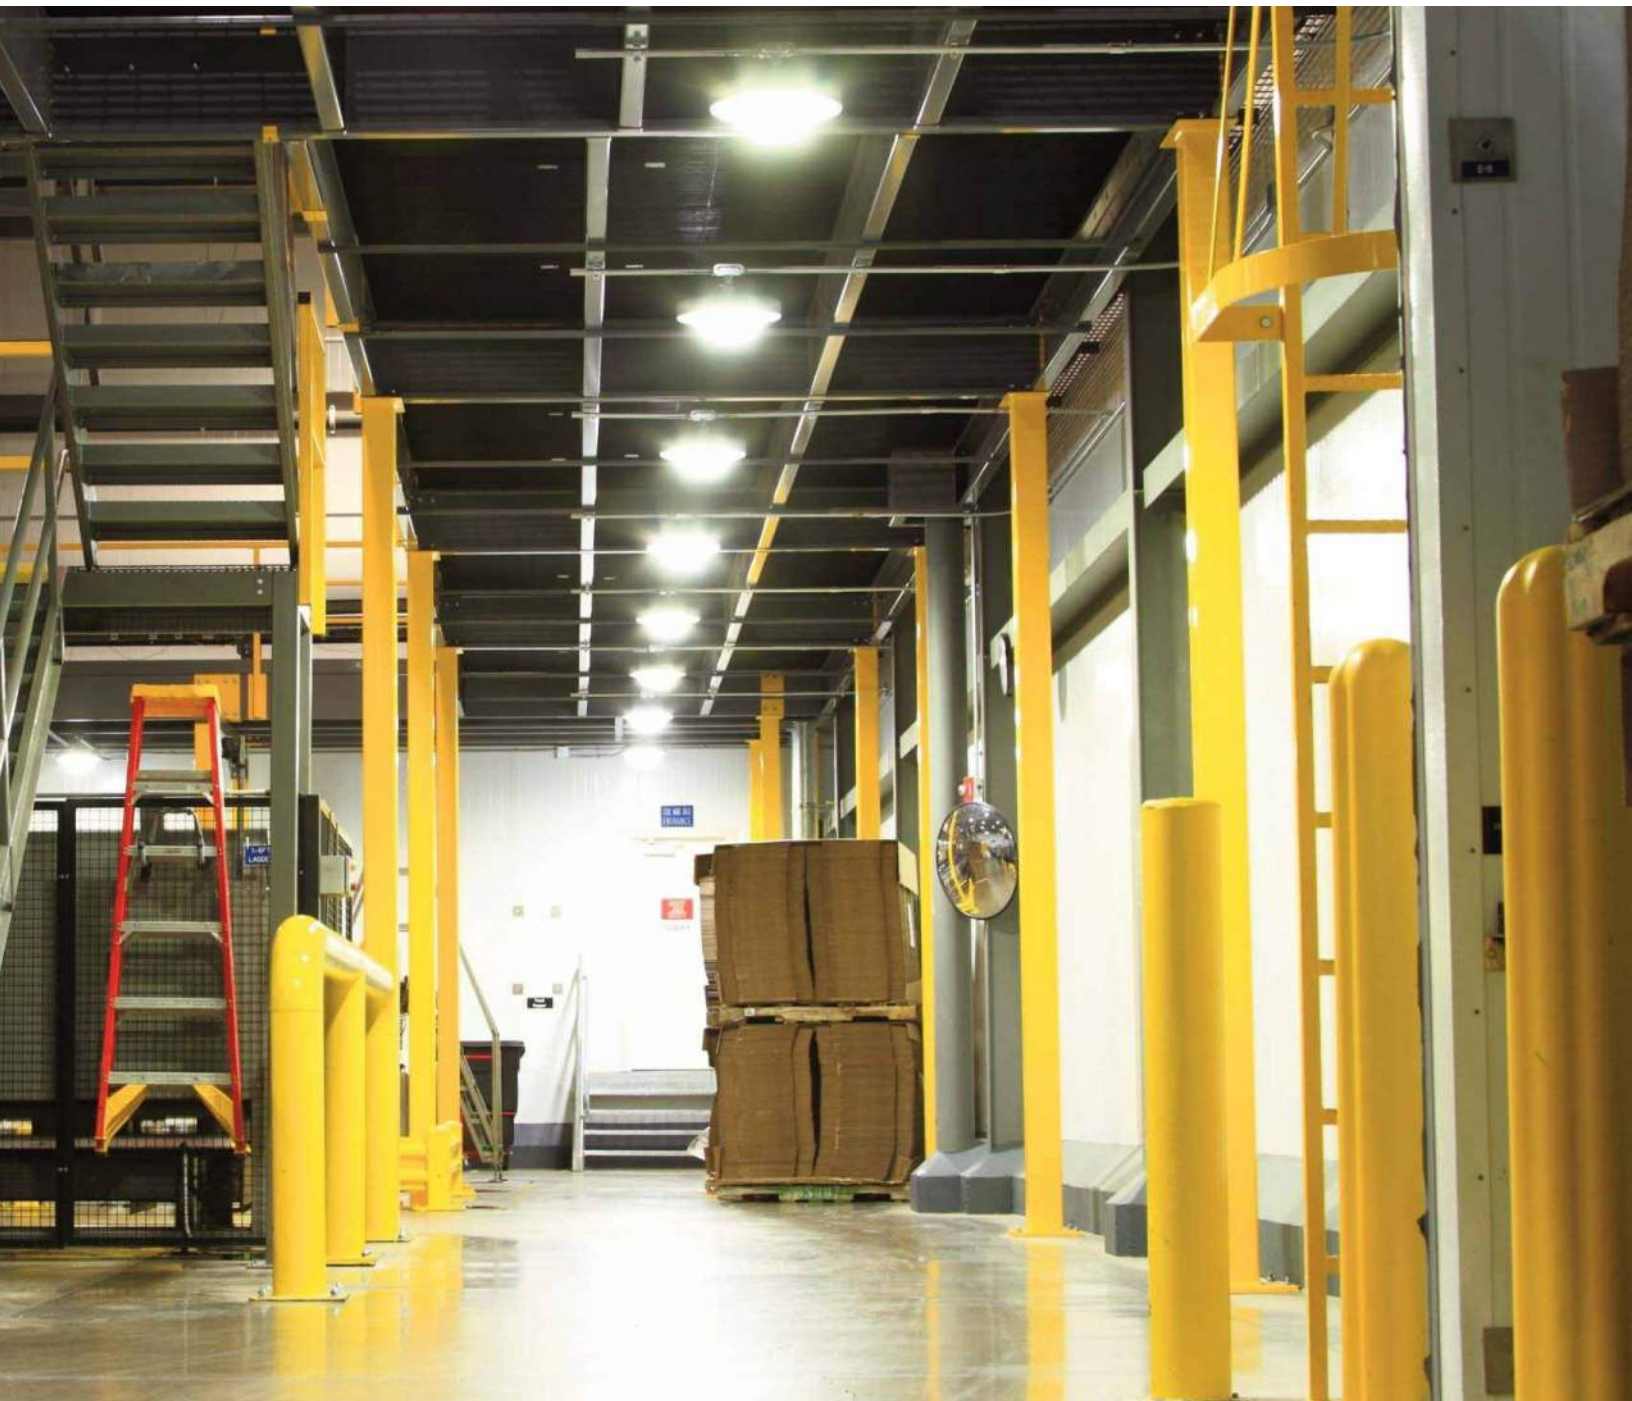

Patent Pending

DuroSite® LED Low Bay
for Indoor and Outdoor Applications



DuroSite® LED Low Bay



Features & Benefits

- L70 rated for >100,000 hours @ 25°C ambient
- 5 year full performance warranty
- Up to 84 lm/W
- Significant energy savings
- Low profile versus traditional HID fixtures
- Instant on/off
- Maintenance free
- Mercury free
- No UV or IR
- Produces minimal heat compared to traditional fixtures
- Reflector based optics for precise light control
- Resistant to shock and vibration
- Temperature compensation technology for long life
- Copper free aluminum
- Typical payback < 2 years

Typical Applications

- Parking Structures
- Cold Storage
- Warehouse
- Walkways
- Manufacturing
- Fuel Pump Canopy



Meets Buy American
For projects requiring Buy American
certification, consult factory for additional
information and details

View the full case studies at:

FOX3 Parking Garage - www.dialight.com/News/Details/fox31_case_study

City of London Parking Garage - www.dialight.com/News/Details/city_of_london_corp

Milwaukee Airport - www.dialight.com/Assets/Brochures_And_Catalogs/Illumination/Case_study_Milwaukee_Airport.pdf


Lanxess - www.dialight.com/Assets/Brochures_And_Catalogs/Illumination/LANXESS_Case_Study.pdf

Complete your own Return on Investment calculation at: www.dialight.com/tcoCalculator/Durosite_LowBay

www.dialight.com



DuroSite® LED Low Bay Fixture

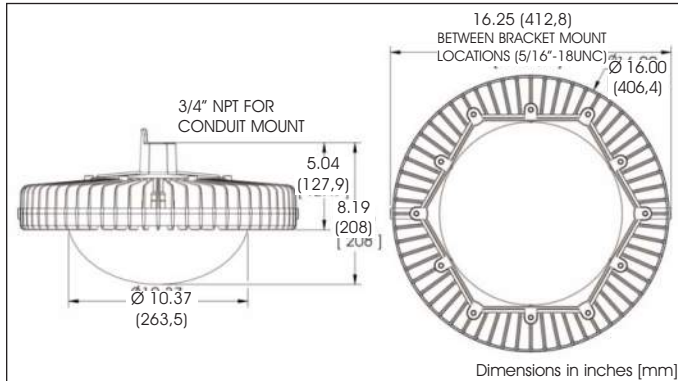

Certifications and Ratings

- UL1598/A (suitable for wet locations)
- CSA C22.2 No. 250.0-08
- UL8750

Compliances

- IEC 60529 (IP 66)
- NEMA 4X
- ANSI C 136.15-2011

Test Reports

- LM-79
- LM-80

Application:

Dialight's DuroSite® LED low bay fixture was designed specifically to replace conventional lighting in a wide variety of industrial applications, both indoor and outdoor. Its low profile, light weight design and versatile mounting options make it ideal for many applications such as parking decks, garages, cold storage and other applications with mounting heights up to 20 feet.

All of Dialight's long life LED luminaires are designed to meet the most demanding specification criteria while offering maximum energy savings, reduced maintenance costs, and a superior quality of light.

Mechanical Information

Fixture Weight:	18 lbs (8.2 kg)
Shipping Weight:	24 lbs (10.92 kg)
Mounting:	(1) 3/4" NPT or (2) 5/16"-18 x .75" UNC

Electrical specifications

Operating Voltage:	100-277V AC, 50/60 Hz
Total System Power Consumption:	45W / 80W / 140W
Operating Temp:	-40°F to +149°F (-40°C to +65°C)
Noise Requirements/ EMC:	FCC Title 47, Subpart B, Section 15, class A device. RF Immunity: 10V/m, 80MHz-1GHz
Harmonics:	EN61000-3-2
Transient Protection:	1 kV line to line 2 kV line to ground

THD:	<15%
Power Factor:	> 0.9

Construction

Body:	Powder coated aluminum
EPA:	0.60
Finish:	Epoxy polyester powder coated for superior corrosion resistance
Lens:	Polycarbonate

Photometric Information

CRI:	70
CCT:	5,000K (cool white) 4,000K (neutral white)

All values typical unless otherwise stated
All lumen values are typical (tolerance +/- 10%)

Ordering Code:

Part Number ¹	Lumens	Wattage	Lumens Per Watt	CCT	Occupancy Sensor	Variable Dimming
LBW1C1A	3,800	45	84	Cool White		
LBW1N1A	3,800	45	84	Neutral White		
LBW1C2A	3,800	45	84	Cool White	•	
LBW1N2A	3,800	45	84	Neutral White	•	
LBW1C5A	3,800	45	84	Cool White		•
LBW1N5A	3,800	45	84	Neutral White		•
LBW1C1D	6,000	80	75	Cool White		
LBW1N1D	6,000	80	75	Neutral White		
LBW1C2D	6,000	80	75	Cool White	•	
LBW1N2D	6,000	80	75	Neutral White	•	
LBW1C5D	6,000	80	75	Cool White		•
LBW1N5D	6,000	80	75	Neutral White		•
HBWC4L	8,500	107	79	Cool White		
HBWN4L	8,500	107	79	Neutral White		

Part numbers with occupancy sensor that will be installed with Hook or Loop (HBXH or HBXL) accessories will require a counter balance installed prior to shipment. Add – **CB** to the end of the part number. Example LBW1C2D will become LBW1C2D-**CB**. Please consult with customer service when ordering


For Dialight's complete list of DLC qualified products, please click this link: www.dialight.com/DLC

DuroSite® LED Low Bay Fixture

Options and Accessories

		Part Number	Description	Kit Includes
		No Part Number	3/4" NPT Pendant Mount (Conduit supplied by installer)	Conduit supplied by installer
		HBXW2	Swivel Bracket and Cable Gland	Swivel Bracket Bracket to fixture hardware Cable Gland (1/2") Reducer (3/4" to 1/2")
		HBXW3	Swivel Bracket	Swivel Bracket Bracket to Fixture Hardware
		HBXCU	Ceiling Mount	Swivel Hanger Cover 3" Conduit Nipple
		HBXCG	Cable Gland	Cable Gland (1/2") Reducer (3/4" to 1/2")
		HBXL	Loop	Hanger Loop (GE LOOPM353)
		HBXH	Hook	Hanger Hook (GE HOOKM353)
		LBXLENP	Replacement Dome Lens	Lens Replacement screws Gasket

Candela Plot - LBW1N1D

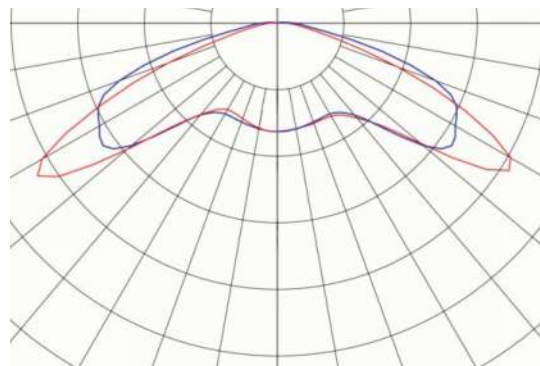

Dialight reserves the right to make changes at any time in order to supply the best product possible. The most current version of this document will always be available at: www.dialight.com/Assets/Brochures_And_Catalogs/Illumination/MDEXLBX001.pdf. Warranty Statement: EXCEPT FOR THE WARRANTY EXPRESSLY PROVIDED FOR [HEREIN/ABOVE/BELOW], DIALIGHT DISCLAIMS ANY AND ALL OTHER WARRANTIES, EXPRESS OR IMPLIED, INCLUDING, WITHOUT LIMITATION, ANY WARRANTIES OF MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE, TITLE, AND NON-INFRINGEMENT.




DuroSite® LED Linear Fixture - UL / CSA
for Indoor and Outdoor Industrial Applications





DuroSite® LED Linear Fixture

Low profile

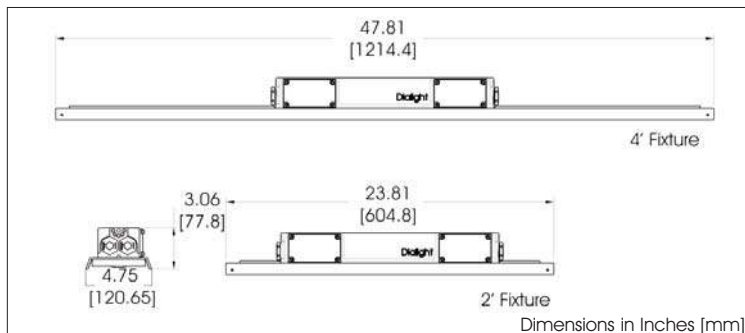

Certifications & Ratings

- UL 1598/A
- UL 8750
- CSA 22.2 No.250.0
- IP 66/67
- NEMA 4X

Features & Benefits

- 5 year full performance warranty
- L70 rated for > 100,000 hours @ 25°C
- Instant on/off operation
- Resistant to water, salt, dust & vibration
- Resistant up to 20 PSI of hose directed water
- Universal input (100-277V AC), 50/60Hz
- Mercury free
- Temperature compensation technology for longer life
- Factory sealed
- Integrated wiring box
- Low profile housing for limited space applications
- Dual NPT entries for in / out wiring
- Thru wiring capability

Application

Dialight's DuroSite® LED linear fixture replaces HID and fluorescent lighting fixtures in industrial applications. The DuroSite® LED Linear fixture's rugged solid state design makes it highly resistant to shock and vibration. Its fully gasketed IP 66 rated enclosure makes it suitable for dusty & wet locations, its 1598/A rating guarantees added protection from salt water spray. The DuroSite® LED Linear's superior design allows for wiring and mounting versatility and ease of installation for many lighting applications.

Mechanical Information

Fixture Weight:	10 lbs (4.50 kg) 4'
	7 lbs (3.13 kg) 2'
Shipping Weight:	11 lbs (4.90 kg) 4'
	8 lbs (3.64 kg) 2'
Mounting:	(4) 3/4" NPT openings
	Optional swivel bracket - LPXW4
	Optional low profile bracket - LPXW4LP

Electrical Specifications

Operating Voltage:	100 - 277V AC 50/60Hz
Power Consumption:	See ordering information
Operating Temp:	-40°F to +149°F (-40°C to +65°C)
Harmonics:	IEC 61000-3-2
Noise Requirements/ EMC:	FCC Title 47, Subpart B, Section 15, class A device. RF Immunity; 10V/m, 80MHz-1GHz
Surge Protection:	EN 61000-4-5
	4 kV line to line
	4 kV line to ground
THD:	< 20%
Power Factor:	> 0.9

Power supply equipped with inline fuse

Construction

Body:	Powder coated aluminum
Lens:	Polycarbonate

Photometric Information

CRI:	75
CCT:	5,000K (cool white)
IES Files:	Available upon request

All values typical unless otherwise stated
All lumen values are typical (tolerance +/- 10%)
*Consult factory for 80 min CRI

Mounting Options

LPXW4LP



Side Mount - LPXW4




Top Mount - LTXW4





DuroSite® LED Linear Fixture

Top Conduit Mounting

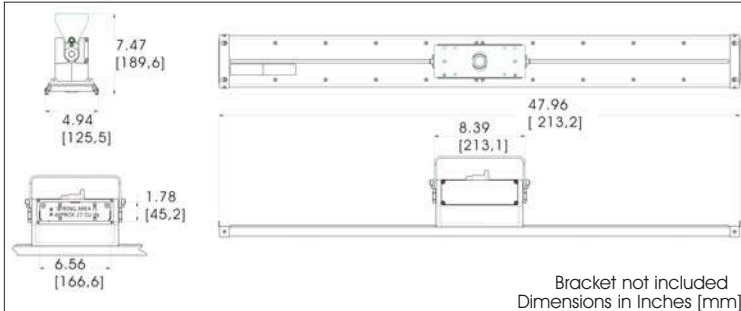

Certifications & Ratings

- UL 1598/A
- UL 8750
- CSA 22.2 No.250.0
- IP 66
- NEMA 4X

Features & Benefits

- 5 year full performance warranty
- L70 rated for > 100,000 hours @ 25°C
- Instant on/off operation
- Resistant to water, salt, dust & vibration
- Resistant up to 20 PSI of hose directed water
- Universal input (100-277V AC), 50/60Hz
- Mercury free
- Temperature compensation technology for longer life
- Factory sealed
- Integrated wiring box

Application

Dialight's DuroSite® LED linear fixture replaces HID and fluorescent lighting fixtures in industrial applications. The DuroSite® LED Linear fixture's rugged solid state design makes it highly resistant to shock and vibration. Its fully gasketed IP 66 rated enclosure makes it suitable for dusty & wet locations, its 1598/A rating guarantees added protection from salt water spray. The DuroSite® LED Linear's superior design allows for mounting versatility and ease of installation for many lighting applications.

Mechanical Information

Fixture Weight:	11 lbs (4.99 kg) 4'
	10 lbs (4.53 kg) 2'
Shipping Weight:	13 lbs (5.90 kg) 4'
	12 lbs (5.44 kg) 2'
Mounting:	(3) 3/4" NPT openings
	Optional swivel bracket - LTXW4
	Optional low profile bracket - LTXW4LP

Electrical Specifications

Operating Voltage:	100 - 277V AC 50/60Hz
Power Consumption:	See ordering information
Operating Temp:	-40°F to +149°F (-40°C to +65°C)
Harmonics:	IEC 61000-3-2
Noise Requirements/ EMC:	FCC Title 47, Subpart B, Section 15, class A device. RF Immunity; 10V/m, 80MHz-1GHz
Surge Protection:	EN 61000-4-5 4 kV line to line 4 kV line to ground
THD:	< 20%
Power Factor:	> 0.9

Power supply equipped with inline fuse

Construction

Body:	Powder coated aluminum
Lens:	Polycarbonate

Photometric Information

CRI:	75
CCT:	5,000K (cool white)
IES Files:	Available upon request

All values typical unless otherwise stated
All lumen values are typical (tolerance +/- 10%)
*Consult factory for 80 min CRI

Mounting Options

Conduit Top Mount




Conduit Side Mount



LTXW4




LTXW4LP

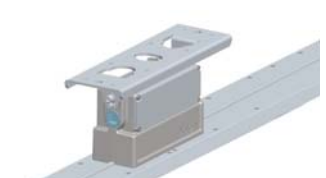



DuroSite® LED Linear Fixture

Battery Backup

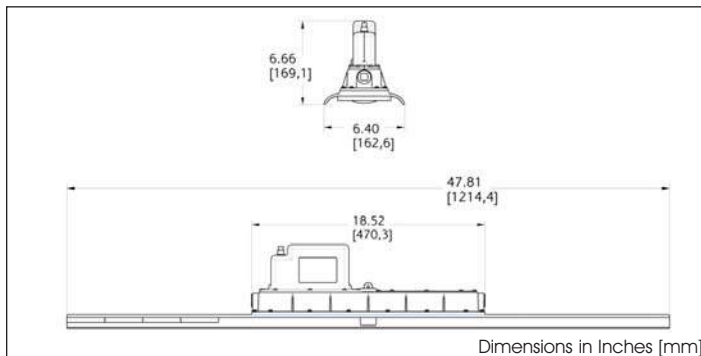

Certifications

- UL 1598/A
- UL 924
- CSA C22.2 #250.0
- IP66
- NEMA 4X

Features & Benefits

- L70 rated for >100,000 hours @ 25°C
- 3 year warranty (excluding battery)
- 450 lumens in battery backup mode consistent throughout life of battery
- Low power consumption
- Battery status indication light
- Instant on/off operation
- Push to test button
- Superior color rendition index compared to HPS, LPS, MV
- Mercury Free
- Resistant to shock and vibration
- Temperature compensation technology for longer life

Application:

Dialight's DuroSite® LED linear fixture replaces HID and fluorescent lighting fixtures in industrial applications. The DuroSite® LED Linear fixture's rugged solid state design makes it highly resistant to shock and vibration. Its fully gasketed IP 66 rated enclosure makes it suitable for dusty & wet locations, its 1598 rating guarantees added protection from salt water spray. The DuroSite LED Linear's superior design allows for mounting versatility and ease of installation for many lighting applications.

This fixture is offered in sustained and maintained configurations.

Sustained has a single AC input and battery backup mode is entered upon any loss of power. Fixture cannot be turned off without entering battery backup mode.

Maintained has two AC inputs. The fixture can be turned on and off via AC-1 and Fixture only enters battery backup mode when AC-2 is lost or low.

Mechanical Information

Fixture Weight:	18.0 lbs (8.16 kg)
Shipping Weight:	21.0 lbs (9.53 kg)
Mounting:	(1) Threaded 3/4" NPT Side (2) Threaded 3/4" NPT Ends

Electrical specifications:

Operating Voltage:	100-277V AC 50/60 Hz
Power Consumption:	85W
Operating Temp:	-20°F to +149°F (-20°C to +65°C)
Battery:	3.6V 10Ah Nimh
Battery Life:	4 years
Battery Duration:	>3 hours
Harmonics:	IEC 61000-3-2
Noise Requirements/ EMC:	FCC Title 47, Subpart B, Section 15, class A device. RF Immunity; 10V/m, 80MHz-1GHz
Surge Protection:	EN 61000-4-5 1 kV line to line 2 kV line to ground
THD:	< 20%
Power Factor:	> 0.9

Construction

Body:	Powder Coated Aluminum
Lens:	Polycarbonate

Photometric Information

CRI:	75
CCT:	5,650K (cool white)
IES Files:	Available upon request

All values typical unless otherwise state
All lumen values are typical (tolerance +/- 10%)

Mounting Options

In-line Conduit Mount



Overhead Conduit Mount




LSXW4




DuroSite® LED Linear Fixtures

Candela Plots

Standard models

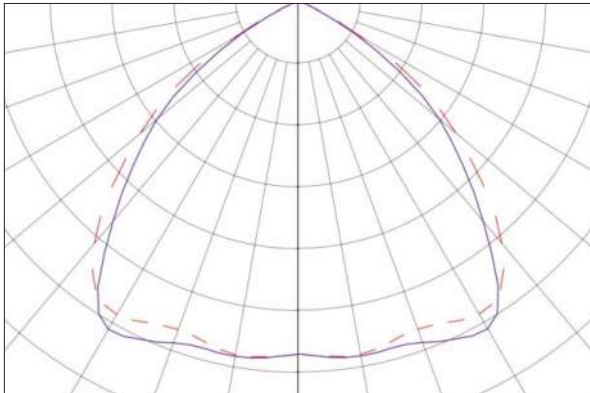

Battery Backup models

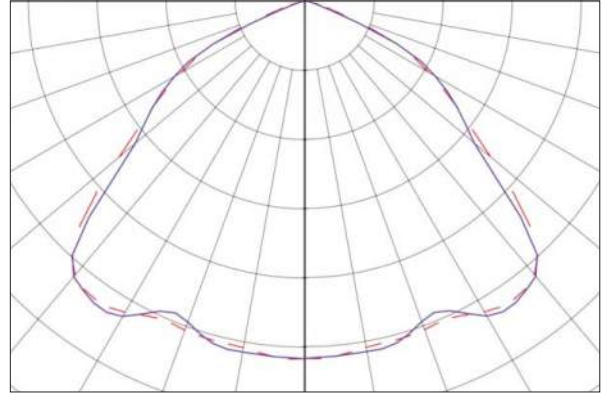

Ordering Information

Part Number	Length	Type	Lens	Initial Fixture Lumens ^{1,2,3,4}	Wattage	Lumens Per Watt
Low profile Models						
LPM3C4D2P	2'	Low profile	Clear	3,500	33	106
LPM3C4M2P	4'	Low profile	Clear	7,000	66	106
LPM3C4B2D	2'	Low profile	Diffused	3,300	33	100
LPM3C4H2D	4'	Low profile	Diffused	6,600	66	100
Top Conduit Mounting Models						
LTM3C4D2P	2'	Top Conduit	Clear	3,500	33	106
LTM3C4M2P	4'	Top Conduit	Clear	7,000	66	106
LTM3C4B2D	2'	Top Conduit	Diffused	3,300	33	100
LTM3C4H2D	4'	Top Conduit	Diffused	6,600	66	100
Battery Backup Models						
LSM3C4MEP	4'	Sustained	Clear	7,000	85	85
LSM3C4MNP	4'	Maintained	Clear	7,000	85	85

Notes:

¹Part numbers listed in the above table are cool white. For neutral white models replace the 5th character with **N**. Ex. LTM3C4D2P becomes LTM3N4D2P

²450 Lumens in Battery Backup mode

³Expect a 10% reduction in Lumens for 80 CRI minimum fixtures

⁴All lumen values are typical (tolerance +/- 10%)

For Dialight's complete list of DLC qualified products, please click this link: www.dialight.com/DLC

Battery Backup Wiring Configurations (Optional)



Add one of the following suffixes to the above Part Numbers for factory wired and installed 10' cable and cable gland:

- GS added for installed on one of the side entries (shown to the left)
- GT added for installed on the top entry (not shown)

Ex. LSM3C4D2P becomes LSM3C4D2P**GS**



Add one of the following suffixes to the above Part Numbers for factory wired and installed 10' cable and 3/4" conduit fitting.:

- CT added for installed on the top entry (shown to the left)
- CS added for installed on one the side entries (not shown)

Ex. LSM3C4D2P becomes LSM3C4D2P**CT**

DuroSite® LED Linear Fixtures

Options and Accessories

Low Profile Models

	Part Number	Material	Description	Kit Includes
Class I, Div. 2 / Class II - Low Profile Models				
				
	LPXW4	316 Stainless Steel	Mounting bracket Can be angled at 0°, 30°, 45°, 60° & 90°	Mounting bracket Mounting hardware
	LPXW4LP	316 Stainless Steel	Low profile mounting bracket Can be angled at 0° and 15°	Mounting bracket Mounting hardware
	LTXENDCAPKIT	304 Stainless Steel	Chain mount and secondary retention bracket	2 Brackets Mounting hardware
	LTXSAFEKIT	304 Stainless Steel	Safety Cable Kit for secondary retention	2 brackets 2 53" Safety cables Mounting hardware

Top Conduit Mount Models

	Part Number	Material	Description	Kit Includes
Class I, Div. 2 / Class II - Standard Models				
				
	LTXW4	6061 Aluminum	Mounting bracket Can be angled at 0°, 30°, 45°, 60° & 90°	Mounting bracket Mounting hardware
	LTXW4LP	5052 Aluminum	Low profile mounting bracket Can be angled at 0° and 15°	Mounting bracket Mounting hardware
	LTXENDCAPKIT	304 Stainless Steel	Chain mount and secondary retention bracket	2 Brackets Mounting hardware
	LTXSAFEKIT	304 Stainless Steel	Safety Cable Kit for secondary retention	2 brackets 2 53" Safety cables Mounting hardware
	LTXLSXW4	6061 Aluminum	Retrofit bracket adapter (used to connect LTM model fixtures to an existing LSXW4 bracket)	2 Bracket adapters Mounting hardware

DuroSite® LED Linear Fixtures

Options and Accessories

Battery Back up Models

	Part Number	Material	Description	Kit Includes
Battery Back up Models				
				
	LSXW4	6061 Aluminum	Mounting bracket Can be angled at 0°, 30°, 45°, 60° & 90°	Mounting bracket Mounting hardware
	LSXENDCAPKIT	304 Stainless Steel	Chain mount brackets	2 Mounting brackets Mounting hardware
	HZXSAFEKIT	316 Stainless Steel	Safety Cable Kit	2 Eyelets 2 53" Safety cables Mounting hardware

Dialight reserves the right to make changes at any time in order to supply the best product possible. The most current version of this document will always be available at: www.dialight.com/Assets/Brochures_And_Catalogs/Illumination/MDTDLINX001.pdf

Warranty Statement: EXCEPT FOR THE WARRANTY EXPRESSLY PROVIDED FOR [HEREIN/ABOVE/BELOW], DIALIGHT DISCLAIMS ANY AND ALL OTHER WARRANTIES, EXPRESS OR IMPLIED, INCLUDING, WITHOUT LIMITATION, ANY WARRANTIES OF MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE, TITLE, AND NONINFRINGEMENT.

DuroSite® LED Linear Fixture - UL / CSA
for Indoor and Outdoor Industrial Applications





Patent Pending


DuroSite® LED Area Light - **UL / CSA**





Patent Pending

DuroSite® LED Area Light

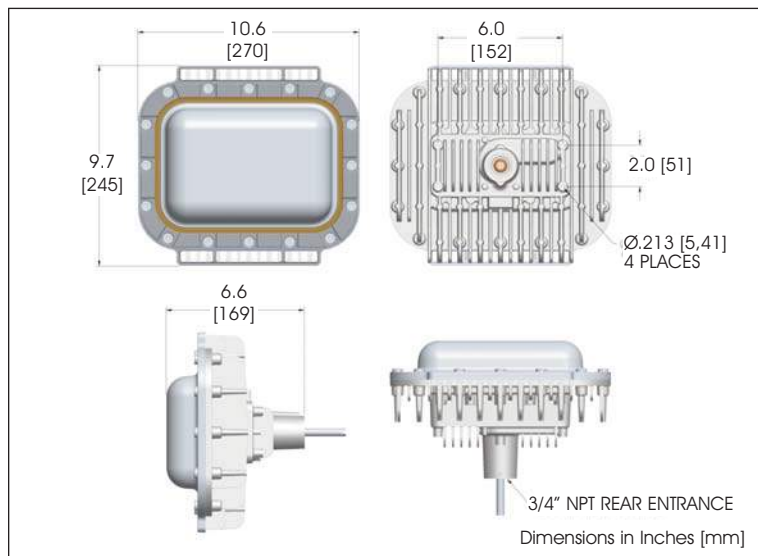

Certifications

- UL 1598/A
- CSA22.2
- ABS Design Assessed: # 12-HS942957-PDA
- Nema 4X
- IP 66

Features & Benefits

- L70 rated for >100,000 hours @ 25°C ambient
- 5 year full performance warranty
- Instant on/off operation
- Superior color rendering index compared to HPS, LPS, MV
- Mercury free
- Resistant to shock and vibration
- Temperature compensation technology for longer life
- Factory sealed
- Wide Throw (Aisle Way) Optic model available

Application:

The DuroSite® LED Area Light represents the future of energy efficient facility illumination for industrial applications worldwide. The lighting fixture consumes at least 50% less energy than traditional HID light sources, while reducing maintenance and carbon emissions. This light incorporates cutting edge LED technology along with proprietary optics to achieve area lighting comparable with other traditional light sources. Whether your application is in a work area or any other application, this fixture offers improved performance across the board.

Mechanical Information

Fixture Weight:	10 lbs (4.5 kg) - Polycarbonate lens models 12 lbs (5.5 kg) - Glass lens models
Shipping Weight:	12 lbs (5.5 kg) - Polycarbonate lens models 14 lbs (6.3 kg) - Glass lens models
Mounting:	(1) Threaded 3/4" NPT rear (Units with retrofit adapter also available)
Cabling:	10' (3.5m) STOOW Power Cord

Electrical specifications

Operating Voltage:	100 - 277V AC, 50/60 Hz or 347 - 480V AC, 50/60 Hz
Power Consumption:	See ordering information
Operating Temp:	-40°F to +149°F (-40°C to +65°C)
Noise Requirements/ EMC:	FCC Title 47, Subpart B, Section 15, class A device. RF Immunity; 10V/m, 80MHz-1GHz

Surge Protection	
100 - 277V AC 50/60Hz:	1 kV line to line, 2 kV line to ground
347 - 480V AC 50/60Hz:	6 kV line to line, 6 kV line to ground

THD: <20%

Power Factor: > 0.9

Construction

Housing:	Powder coated copper free aluminum
Finish:	Polyester / epoxy powder coat for superior corrosion resistance, gray RAL 7040
Lens:	Hard coated polycarbonate (Glass lens also available)

Photometric Information

CRI:	70
CCT Standard:	5,000K (cool white) 4,000K (neutral white)
Optics:	180° forward throw 360° circular pattern Wide Throw (Aisle Way) pattern
IES Files:	Available upon request

All values typical unless otherwise stated
All Lumen Values are typical (tolerance +/- 10%)

Ordering Information

Part Number	Voltage	Lens	Optical Pattern ¹	CCT ²	Lumens	Wattage	LPW
100 - 277V AC models							
STWFC2G	100 - 277V AC	Glass	360	CW	7,250	69	105
STW9C2G	100 - 277V AC	Glass	360	CW	6,000	58	103
STW5C2G	100 - 277V AC	Glass	360	CW	5,200	48	108
STW3C2G	100 - 277V AC	Glass	360	CW	4,100	38	108
STW1C2G	100 - 277V AC	Glass	360	CW	2,200	21	105
STWFC2N	100 - 277V AC	Polycarbonate	360	CW	7,000	68	103
STW9C2N	100 - 277V AC	Polycarbonate	360	CW	6,000	58	103
STW5C2N	100 - 277V AC	Polycarbonate	360	CW	5,000	48	104
STW3C2N	100 - 277V AC	Polycarbonate	360	CW	4,000	38	105
STW1C2N	100 - 277V AC	Polycarbonate	360	CW	2,200	21	105
STWEC2G	100 - 277V AC	Glass	180	CW	6,750	69	98
STW8C2G	100 - 277V AC	Glass	180	CW	5,700	58	97
STW4C2G	100 - 277V AC	Glass	180	CW	4,700	48	98
STW2C2G	100 - 277V AC	Glass	180	CW	3,700	38	97
STW0C2G	100 - 277V AC	Glass	180	CW	2,200	21	105
STWEC2N	100 - 277V AC	Polycarbonate	180	CW	7,000	68	103
STW8C2N	100 - 277V AC	Polycarbonate	180	CW	6,000	58	103
STW4C2N	100 - 277V AC	Polycarbonate	180	CW	4,700	48	98
STW2C2N	100 - 277V AC	Polycarbonate	180	CW	4,000	38	105
STW0C2N	100 - 277V AC	Polycarbonate	180	CW	2,200	21	105
STWWC2N	100 - 277V AC	Polycarbonate	Wide Throw	CW	4,100	60	68

¹180° optical pattern models are optimized for a 45° mounting angle

²Part numbers listed in the above table are cool white. For neutral white model replace the 5th character with **N** Ex: STW2**C**2N becomes STW2**N**2N

Part numbers listed in the above table are 100-277V AC. For 347-480V AC model replace the 6th character with **2** Ex: STW2C2N becomes STW2C**2**N

For Dialight's complete list of DLC qualified products, please click this link: www.dialight.com/Assets/News_And_Events/DLC_Part_Number_List.xls



FEATURES & SPECIFICATIONS

INTENDED USE — The Lithonia Lighting JCBL LED Highbay is the affordable LED solution for users who prefer a luminaire with the look and feel of a round form factor. Gymnasiums, warehouses, packaging facilities and other industrial applications all benefit from JCBL's highly efficient design that saves over traditional sources. **Certain airborne contaminants can diminish the integrity of acrylic and/or polycarbonate.** [Click here for Acrylic-Polycarbonate Compatibility table for suitable uses.](#)

Certain airborne contaminants may adversely affect the functioning of LEDs and other electronic components, depending on various factors such as concentrations of the contaminants, ventilation, and temperature at the end-user location. [Click here for a list of substances that may not be suitable for interaction with LEDs and other electronic components.](#)

CONSTRUCTION — JCBL features an aluminum heat sink to maximize heat dissipation and extend the life of the luminaire by maximizing contact with the LEDs. A glass optical enclosure (IP65 rated) protects the LEDs from dust and other air contaminants. Reflector options including aluminum, prismatic acrylic and polycarbonate ship together and easily mount to the heatsink for quick installation.

OPTICS — Reflector and lens options provide maximum versatility and uniformity. Conical, flat or acrylic drop lenses offer enhanced aesthetics, minimize glare at lower mounting heights when paired with acrylic reflectors.

ELECTRICAL — Utilizes 90°C case temperature for maximum life at high temperatures. Less than 20% THD and PF >90. Luminaire Surge Protection Level: Designed to withstand up to 6kV/3kA per ANSI C82.77-5-2015 with MVOLT. Luminaire Surge Protection Level: Designed to withstand up to 10kV/5kA per ANSI C82.77-5-2015 with HVOLT. Input voltages include 120-277, 347/480 without the use of a step down transformer. 0-10V dimming standard for a dimming range of 100% to 10%. Suitable for 50/60Hz.

WIRELESS NETWORKING — Integrated Sensor (nLight Wired Networking): This sensor is nLight-enabled, meaning it has the ability to communicate over an nLight network. When wired, using CAT-5 cabling, with other nLight-enabled sensors, power packs, or WallPods, an nLight control zone is created. Once linked to a Gateway, directly or via a Bridge, the zone becomes capable of remote status monitoring and control via SensorView software.

Integrated Smart Sensor (nLight AIR Wireless Platform): The rSBOR sensor is nLight AIR enabled, meaning it has the ability to communicate over the wireless nLight control platform. It is available with an automatic dimming photocell, and either a digital PIR or dual technology occupancy sensor. It pairs to other luminaires and wall switches through our mobile app, CLAIRITY PRO, which allows for simple sensor adjustment.

INSTALLATION — Mounting options include steel hook & cord or 3/4" NPT threaded hub to accommodate stem or cast hook options.

LISTINGS — UL1598/C SA C22 .2 250, Damp location listed. Suitable for use in ambient temperatures from -40°C up to 55°C.

DesignLights Consortium® (DLC) Premium qualified product and DLC qualified product. Not all versions of this product may be DLC Premium qualified or DLC qualified. Please check the DLC Qualified Products List at www.designlights.org/QPL to confirm which versions are qualified.

WARRANTY — 5-year limited warranty. This is the only warranty provided and no other statements in this specification sheet create any warranty of any kind. All other express and implied warranties are disclaimed. Complete warranty terms located at: www.acuitybrands.com/support/warranty/terms-and-conditions

Note: Actual performance may differ as a result of end-user environment and application.

All values are design or typical values, measured under laboratory conditions at 25 °C.

Specifications subject to change without notice.

Catalog Number
Notes
Type



LED Damp Rated High Bay

JCBL

9000, 12000, 15000, 18000,
24000, 30000 or 36000 lumens



A+ Capable Luminaire

This item is an A+ capable luminaire, which has been designed and tested to provide consistent color appearance and out-of-the-box control compatibility with simple commissioning.

- All configurations of this luminaire meet the Acuity Brands' specification for chromatic consistency
- This luminaire is part of an A+ Certified solution for nLight® control networks marked by a [shaded background](#)*

To learn more about A+, visit www.acuitybrands.com/aplus.



*See ordering tree for details

DIMENSIONS


All dimensions are in inches (centimeters) unless otherwise indicated.
Dimensions may vary with options or accessories.

Typical weight:

A cartoned luminaire weighs 23 lbs.;
unboxed it weighs 16 lbs.

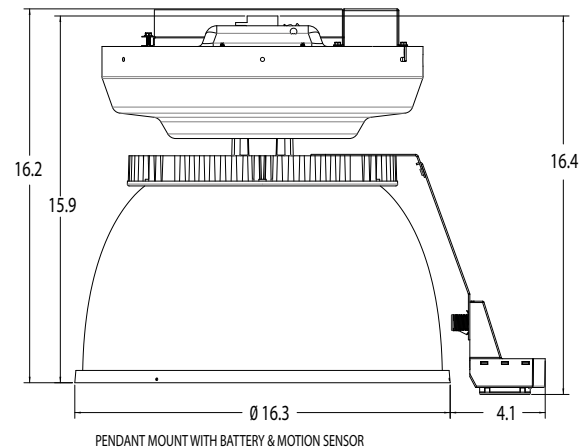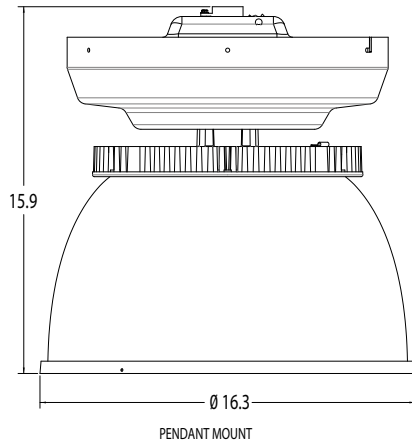

shown with LSXR motion sensor

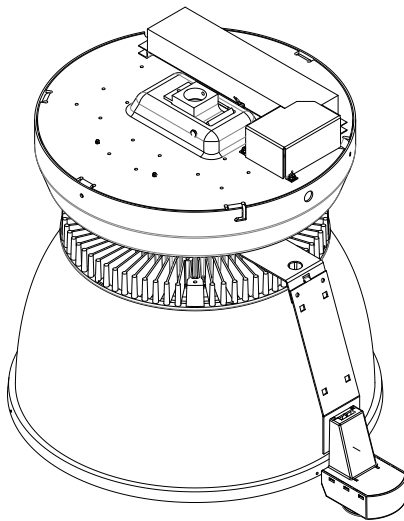

JCBL LED Damp Rated High Bay



A+ Capable options indicated by this color background.

ORDERING INFORMATION

Lead times will vary depending on options selected. Consult with your sales representative.

Example: JCBL 24000LM DALR MVOLT GZ10 40K 80CRI SC6W DWHXD

JCBL				
Series	Lumens	Reflector	Lens ‡	Voltage
JCBL	9000LM 9,000 lumens 12000LM 12,000 lumens 15000LM 15,000 lumens 18000LM 18,000 lumens 24000LM 24,000 lumens 30000LM 30,000 lumens 36000LM 36,000 lumens	DALR Diffuse aluminum SALR Specular aluminum ACFR Frosted acrylic ACCR Clear acrylic PLCR Clear polycarbonate	(blank) Open bottom For use with aluminum reflectors ALDRP Drop prismatic ALCON Conical ALFGL Flat prismatic	For use with acrylic and polycarbonate reflectors ACRDRP Drop prismatic ACRCON Conical ACRFGL Flat prismatic MVOLT 120-277V HVOLT 347/480V 120 120V 208 208V 240 240V 277 277V 347 347V 480 480V

GZ10			
Driver	Color temperature	Color rendering index	Mounting Configurations
GZ10 0-10V dimming ‡	30K 3000 K 35K 3500 K 40K 4000 K 50K 5000 K	70CRI 70 CRI 80CRI 80 CRI 90CRI 90 CRI	PM Pendant mount SC6W Steel hook & white 6' cord SC6PW Steel hook with white 6' cord and NEMA twist lock plug ‡ SC6PNW Steel hook with white 6' straight blade cordset ‡ SCS6G16WSTOW5D Steel hook with white 6' cord, 16/5, no plug, includes low voltage dimming wires ‡ SC12W Steel hook & 12' white cord SC12PW Steel hook with white 12' cord and NEMA twist lock plug ‡ SC12PNW Steel hook with white 12' straight blade cordset ‡ SCS12G16WSTOW5D Steel hook with white 12' cord, 16/5, no plug, includes low voltage dimming wires ‡

Options		Super Durable Finishes
HOCS Hook, 6' RELOC® OCS ‡ OCS 6' RELOC® OCS ‡ E10WCP EM Self-diagnostics battery pack, 10W, constant power, certified in CA title 20 MAEDBS ‡ BGTD Generator transfer device (120 or 277 only) ‡ WG Wire guard for open bottom reflectors (ships separately) FWG Full wire guard (ships separately) SCF120 Safety Cable 120" SCF240 Safety cable 240" Cordsets: C6W White 6' cord ‡ C12W White 12' cord ‡ C6PNW White 6' cord with straight blade plug ‡ CS6G16WSTOW5D White 6' cord, 16/5, no plug, includes low voltage dimming wires ‡ HK455 Safety hook, male, cast aluminum, factory installed ‡ HC6W White 6' cord with male cast hook, no plug ‡ HC6PW White 6' cord with male cast hook and NEMA twist lock plug ‡ HC6PNW White 6' cord with male cast hook and straight blade cord ‡ HC6P20W White 6' cord with male cast hook and 20-amp plug ‡ HCS6G16WSTOW5D White 6' cord with male cast hook, 16/5, no plug, includes low voltage dimming wires ‡ Controls: AO Adjustable output ‡ LCOZU Aisle motion sensor, pre-wired LCHOSZU Aisle motion sensor, pre-wired; programmable dimming LCPZU Aisle motion sensor with photocell; pre-wired LAOZU 360° motion sensor, pre-wired LAHOSZU 360° motion sensor, pre-wired; programmable dimming LAPZU 360° motion sensor with photocell, pre-wired	Controls: Individual Controls with Bluetooth Programming: LSXBTP 360° High Mount Occ Sensor, pre-wired; Bluetooth® ‡ LSXBTPHL 360° High Mount Occ Sensor w/HL Default, pre-wired; Bluetooth® ‡ LSXBTPADC 360° High Mount Occ Sensor w/ADC Default, pre-wired; Bluetooth® ‡ LSXBTPANL 360° High Mount Occ Sensor w/ANL Default, pre-wired; Bluetooth® ‡ nLight AIR Wireless Controls: ‡ NLTAIR2 RKOA nLight AIR Generation 2 enabled 360°high mount motion sensor NLTAIR2 RKOB nLight AIR Generation 2 enabled 360° low mount motion sensor NLTAIR2 rPP20D nLight AIR Generation 2 dimming and switching module ‡ NLTAIR2 rPP20DER nLight AIR Generation 2 dimming and switching module with emergency relay ‡ nLight Wired Network Controls: NPP16D nLight® switching/dimming module ‡ NPP16DER nLight® switching/dimming module with emergency relay ‡	DWHXD White DNAXD Natural aluminum DWHGXD Textured white DNATXD Textured natural aluminum DBLXD Black

NOTE: ‡ indicates option chosen has ordering restrictions. Please reference ordering restrictions chart, page 4. Options are sorted alphanumerically.

Accessories and Notes next page.

JCBL LED Damp Rated High Bay

Accessories: Order as separate catalog number.	
HK455	Safety hook, male, cast aluminum
JCBLHKF	Hook, female
JCBLSTEM12 XXX	Swivel stem kit, must specify finish.
JCBLSTEM24 XXX	Swivel stem kit, 24", must specify finish.
JCBLSTEM36 XXX	Swivel stem kit, 36", must specify finish.
WGJCBL	Wire guard for use with open bottom reflectors
FWGJCBL	Full wire guard

‡ Option Value Ordering Restrictions	
Option value	Restriction
ACRCON	Lensed fixtures are suitable for use in ambient temperatures up to 40°C.
Lens	Lensed fixtures are suitable for use in ambient temperatures up to 40°C.
AO	Not available with other controls.
BGTD	Only available with 120V or 277V. Not available with MVOLT or HVOLT. Not available with battery packs, plugs, XAD, XAD924, or NLTAIR2 RPP20DER.
C12W	PM option required.
C6W	PM option required.
C6PNW	PM option required. Not available with E10WCP, BGTD, NPP16DER or NLTAIR2 rPP20DER. Must specify voltage. Not available with MVOLT, HVOLT, 347V or 480V. Not available with battery packs.
CS6G16WSTOW5D	PM option required. Not available with E10WCP, BGTD, NPP16DER or NLTAIR2 rPP20DER.
E10WCP	Not available with 347V, 480V or HVOLT. Four conductor cordset ships standard when product is ordered with cord. Utilizes PS1055CP .
GZ10	If ordering a cord and dimming is required for your application, choose CS6G16WSTOW5D, SC12G16WSTOW5D, or HCS6G16WSTOW5D as your cord option.
HC6W	PM option required. Ships standard with HK455 option.
HC6PW	PM option required. Not available with E10WCP, BGTD, NPP16DER or NLTAIR2 rPP20DER. Must specify voltage. 120-277V utilizes a 15-amp plug, 347-480 utilizes a 20-amp plug (standard). Not available with battery packs. Ships standard with HK455 option.
HC6P20W	PM option required. Not available with E10WCP, BGTD, NPP16DER or NLTAIR2 rPP20DER. Must specify voltage. Not available with 347, 480, MVOLT or HVOLT. Not available with battery packs. Ships standard with HK455 option.
HC6PNW	PM option required. Not available with E10WCP, BGTD, NPP16DER or NLTAIR2 rPP20DER. Must specify voltage. Not available with MVOLT or HVOLT. 120-277V utilizes a 15-amp plug, 347-480 utilizes a 20-amp plug (standard). Not available with battery packs. Ships standard with HK455 option.
HCS6G16WSTOW5D	PM option required. Not available with E10WCP, BGTD, NPP16DER or NLTAIR2 rPP20DER. Ships standard with HK455 option.
HK455	PM option required.
HOCS	PM option required. Must specify voltage. Not available with MVOLT or HVOLT. Not available with cordsets. When reloc is selected fixture bears a dry location label. Fixture ships with OCS4C when ordered with battery pack. 120-277V utilizes a 15-amp plug, 347-480 utilizes a 20-amp plug (standard). Ships standard with HK455 option.
LSXBTP	Not able to order 9,000LM or 12,000LM with 347V, 480V, or HVOLT. 9,000LM and 12,000LM will not dim to off if ordered with LSXBTP, LSXBTPHL, LSXBTPADC or LSXBTPANL controls.
LSXBTPHL	Not able to order 9,000LM or 12,000LM with 347V, 480V, or HVOLT. 9,000LM and 12,000LM will not dim to off if ordered with LSXBTP, LSXBTPHL, LSXBTPADC or LSXBTPANL controls.
LSXBTPADC	Not able to order 9,000LM or 12,000LM with 347V, 480V, or HVOLT. 9,000LM and 12,000LM will not dim to off if ordered with LSXBTP, LSXBTPHL, LSXBTPADC or LSXBTPANL controls.
LSXBTPANL	Not able to order 9,000LM or 12,000LM with 347V, 480V, or HVOLT. 9,000LM and 12,000LM will not dim to off if ordered with LSXBTP, LSXBTPHL, LSXBTPADC or LSXBTPANL controls.
nLight AIR Wireless Controls	Normal luminaires (non-emergency) can be used as a normal power sensing device for nearby nLight AIR devices and luminaires with EM emergency options.
NLTAIR2 RPP20D	Not available with HVOLT, 347V, or 480V. Not available with battery or BGTD option.
NLTAIR2 RPP20DER	Not available with HVOLT, 347V, or 480V. Not available with battery or BGTD option.
NPP16D	Must specify voltage. Available with 120V-347V only. Not available with battery or BGTD option.
NPP16DER	Must specify voltage. Available with 120V-347V only. Not available with battery or BGTD option.
OCS	PM option required. Must specify voltage. Not available with MVOLT or HVOLT. Not available with cordsets. When reloc is selected fixture bears a dry location label. Fixture ships with OCS4C when ordered with battery pack. 120-277V utilizes a 15-amp plug, 347-480 utilizes a 20-amp plug (standard). Ships standard with HK455 option.
SC12PW	Not available with E10WCP, BGTD, NPP16DER or NLTAIR2 rPP20DER. Must specify voltage. Not available with MVOLT or HVOLT. 120-277V utilizes a 15-amp plug, 347-480 utilizes a 20-amp plug (standard). Not available with battery packs.
SC12PNW	Not available with E10WCP, BGTD, NPP16DER or NLTAIR2 rPP20DER. Must specify voltage. Not available with MVOLT, HVOLT, 347V or 480V. Not available with battery packs. If black cord is required, remove "W" from nomenclature. Example: SC12P.
SC6PW	Not available with E10WCP, BGTD, NPP16DER or NLTAIR2 rPP20DER. Must specify voltage. Not available with MVOLT or HVOLT. 120-277V utilizes a 15-amp plug, 347-480 utilizes a 20-amp plug (standard). Not available with battery packs.
SC6PNW	Not available with E10WCP, BGTD, NPP16DER or NLTAIR2 rPP20DER. Must specify voltage. Not available with MVOLT, HVOLT, 347V or 480V. If black cord is required, remove "W" from nomenclature. Example: SC6PN.
SCS6G16WSTOW5D	Not available with E10WCP, BGTD, NPP16DER or NLTAIR2 rPP20DER. Not available with battery packs. If black cord is required, remove "W" from nomenclature. Example: SCS6G16STOW5D.
SCS12G16WSTOW5D	Not available with E10WCP, BGTD, NPP16DER or NLTAIR2 rPP20DER. Not available with battery packs. If black cord is required, remove "W" from nomenclature. Example: SCS12G16STOW5D.

OPERATIONAL DATA

Lumen Package	Input Watts	Ambient Rating	Reflector	Lens	Delivered Lumens											
					3000K CCT, 70CRI	3500K CCT, 70CRI	4000K CCT, 70CRI	5000K CCT, 70CRI	3000K CCT, 80CRI	3500K CCT, 80CRI	4000K CCT, 80CRI	5000K CCT, 80CRI	3000K CCT, 90CRI	3500K CCT, 90CRI	4000K CCT, 90CRI	5000K CCT, 90CRI
9000LM	63	-40°F (-40°C) - 135°F (55°C)	ACCR	-	9628	10046	10186	10256	9418	9418	9558	10046	7814	8023	8163	8581
			ACFR	-	9602	10020	10159	10229	9394	9394	9533	10020	7793	8002	8141	8559
			DALR	-	8045	8395	8511	8569	7870	7870	7987	8395	6529	6704	6821	7170
			PLCR	-	8967	9357	9487	9552	8772	8772	8902	9357	7277	7472	7602	7992
			SALR	-	8811	9194	9322	9385	8619	8619	8747	9194	7151	7342	7470	7853
			ACCR	ACRCON	9014	9405	9536	9601	8818	8818	8948	9405	7315	7511	7642	8034
			ACFR	ACRCON	9069	9463	9594	9660	8872	8872	9003	9463	7360	7557	7689	8083
			PLCR	ACRCON	8422	8789	8911	8972	8239	8239	8361	8789	6836	7019	7141	7507
			ACCR	ACDRP	8900	9287	9416	9480	8706	8706	8835	9287	7223	7416	7545	7932
			ACFR	ACDRP	9082	9477	9608	9674	8884	8884	9016	9477	7371	7568	7700	8095
			PLCR	ACDRP	8350	8713	8834	8894	8168	8168	8289	8713	6777	6958	7079	7442
			ACCR	ACRFG	9042	9435	9566	9632	8845	8845	8976	9435	7338	7535	7666	8059
			ACFR	ACRFG	9102	9498	9630	9696	8904	8904	9036	9498	7387	7585	7717	8113
			PLCR	ACRFG	8378	8742	8864	8924	8196	8196	8317	8742	6800	6982	7103	7467
			DALR	ALCON	7787	7895	7949	7462	7300	7300	7408	7787	6056	6219	6327	6651
			SALR	ALCON	8529	8648	8707	8174	7996	7996	8115	8529	6634	6812	6930	7286
			DALR	ALDRP	7778	7886	7940	7453	7291	7291	7399	7778	6049	6211	6319	6643
			SALR	ALDRP	8580	8699	8758	8222	8043	8043	8162	8580	6673	6852	6971	7328
			DALR	ALFGL	7613	7719	7772	7296	7138	7138	7243	7613	5922	6080	6186	6503
			SALR	ALFGL	8564	8683	8743	8207	8029	8029	8148	8564	6661	6839	6958	7315
12000LM	84	-40°F (-40°C) - 135°F (55°C)	ACCR	-	12418	12958	13138	13228	12148	12148	12328	12958	10079	10349	10529	11069
			ACFR	-	12386	12924	13104	13193	12116	12116	12296	12924	10052	10321	10501	11039
			DALR	-	10377	10828	10978	11053	10151	10151	10301	10828	8422	8647	8798	9249
			PLCR	-	11566	12069	12236	12320	11314	11314	11482	12069	9387	9638	9806	10309
			SALR	-	11365	11859	12023	12106	11118	11118	11282	11859	9223	9471	9635	10129
			ACCR	ACRCON	11626	12132	12300	12384	11373	11373	11542	12132	9436	9688	9857	10362
			ACFR	ACRCON	11697	12206	12375	12460	11443	11443	11613	12206	9493	9748	9917	10426
			PLCR	ACRCON	10864	11336	11493	11572	10628	10628	10785	11336	8817	9053	9211	9683
			ACCR	ACDRP	11479	11978	12145	12228	11230	11230	11396	11978	9316	9566	9732	10231
			ACFR	ACDRP	11714	12223	12393	12478	11459	11459	11629	12223	9507	9762	9932	10441
			PLCR	ACDRP	10770	11238	11394	11472	10536	10536	10692	11238	8741	8975	9131	9599
			ACCR	ACRFG	11663	12170	12339	12423	11409	11409	11578	12170	9465	9719	9888	10395
			ACFR	ACRFG	11740	12251	12421	12506	11485	11485	11655	12251	9528	9784	9954	10464
			PLCR	ACRFG	10806	11276	11433	11511	10572	10572	10728	11276	8770	9005	9162	9632
			DALR	ALCON	10044	10183	10253	9625	9416	9416	9555	10044	7812	8021	8160	8579
			SALR	ALCON	11002	11155	11231	10543	10314	10314	10467	11002	8557	8786	8939	9397
			DALR	ALDRP	10032	10171	10241	9614	9405	9405	9544	10032	7803	8012	8151	8569
			SALR	ALDRP	11066	11220	11297	10605	10375	10375	10528	11066	8607	8838	8991	9452
			DALR	ALFGL	9820	9956	10025	9411	9206	9206	9343	9820	7638	7842	7979	8388
			SALR	ALFGL	11047	11200	11277	10586	10356	10356	10510	11047	8592	8822	8975	9436

OPERATIONAL DATA (continued)

Lumen Package	Input Watts	Ambient Rating	Reflector	Lens	Delivered Lumens											
					3000K CCT, 70CRI	3500K CCT, 70CRI	4000K CCT, 70CRI	5000K CCT, 70CRI	3000K CCT, 80CRI	3500K CCT, 80CRI	4000K CCT, 80CRI	5000K CCT, 80CRI	3000K CCT, 90CRI	3500K CCT, 90CRI	4000K CCT, 90CRI	5000K CCT, 90CRI
15000LM	103	-40°F (-40°C) - 135°F (55°C)	ACCR	-	14899	15547	15763	15871	14575	14575	14791	15547	12092	12416	12632	13280
			ACFR	-	14860	15506	15721	15829	14537	14537	14752	15506	12060	12383	12598	13244
			DALR	-	12449	12991	13171	13261	12179	12179	12359	12991	10104	10375	10555	11096
			PLCR	-	13876	14479	14681	14781	13575	13575	13776	14479	11262	11563	11765	12368
			SALR	-	13635	14228	14425	14524	13338	13338	13536	14228	11066	11362	11560	12153
			ACCR	ACRCON	13948	14555	14757	14858	13645	13645	13847	14555	11321	11624	11826	12432
			ACFR	ACRCON	14034	14644	14847	14949	13729	13729	13932	14644	11390	11695	11898	12508
			PLCR	ACRCON	13034	13600	13789	13884	12750	12750	12939	13600	10578	10861	11050	11617
			ACCR	ACRDRP	13772	14371	14571	14670	13473	13473	13672	14371	11177	11477	11676	12275
			ACFR	ACRDRP	14054	14665	14869	14971	13749	13749	13952	14665	11406	11712	11915	12526
			PLCR	ACRDRP	12921	13483	13670	13764	12640	12640	12828	13483	10487	10768	10955	11517
			ACCR	ACRFGL	13992	14601	14804	14905	13688	13688	13891	14601	11356	11660	11863	12471
			ACFR	ACRFGL	14085	14698	14902	15004	13779	13779	13983	14698	11432	11738	11942	12554
			PLCR	ACRFGL	12965	13529	13717	13811	12683	12683	12871	13529	10522	10804	10992	11556
			DALR	ALCON	12050	12217	12301	11548	11297	11297	11464	12050	9372	9623	9791	10293
			SALR	ALCON	13199	13383	13474	12649	12374	12374	12558	13199	10266	10541	10725	11274
			DALR	ALDRP	12036	12203	12286	11534	11283	11283	11451	12036	9361	9612	9779	10281
			SALR	ALDRP	13277	13461	13553	12724	12447	12447	12631	13277	10326	10603	10787	11341
			DALR	ALFGL	11782	11945	12027	11291	11045	11045	11209	11782	9164	9409	9573	10064
			SALR	ALFGL	13253	13437	13529	12701	12425	12425	12609	13253	10308	10584	10768	11320
18000LM	125	-40°F (-40°C) - 135°F (55°C)	ACCR	-	18253	19047	19311	19443	17856	17856	18121	19047	14814	15211	15475	16269
			ACFR	-	18205	18996	19260	19392	17809	17809	18073	18996	14775	15171	15434	16226
			DALR	-	15252	15915	16136	16247	14920	14920	15141	15915	12378	12710	12931	13594
			PLCR	-	17000	17739	17985	18109	16630	16630	16877	17739	13797	14167	14413	15152
			SALR	-	16704	17430	17672	17794	16341	16341	16583	17430	13557	13920	14162	14888
			ACCR	ACRCON	17088	17831	18079	18203	16717	16717	16965	17831	13869	14240	14488	15231
			ACFR	ACRCON	17193	17941	18190	18314	16819	16819	17068	17941	13954	14328	14577	15324
			PLCR	ACRCON	15968	16662	16894	17009	15621	15621	15852	16662	12959	13307	13538	14232
			ACCR	ACRDRP	16873	17606	17851	17973	16506	16506	16750	17606	13694	14060	14305	15039
			ACFR	ACRDRP	17218	17966	18216	18341	16844	16844	17093	17966	13974	14348	14598	15346
			PLCR	ACRDRP	15830	16518	16748	16862	15486	15486	15715	16518	12847	13192	13421	14109
			ACCR	ACRFGL	17142	17888	18136	18260	16770	16770	17018	17888	13913	14285	14534	15279
			ACFR	ACRFGL	17256	18006	18257	18382	16881	16881	17131	18006	14005	14380	14630	15381
			PLCR	ACRFGL	15884	16574	16805	16920	15538	15538	15769	16574	12891	13236	13467	14157
			DALR	ALCON	14762	14967	15070	14147	13840	13840	14045	14762	11482	11789	11995	12610
			SALR	ALCON	16171	16395	16508	15497	15160	15160	15385	16171	12577	12914	13139	13813
			DALR	ALDRP	14745	14950	15052	14131	13824	13824	14028	14745	11468	11776	11980	12595
			SALR	ALDRP	16266	16492	16605	15588	15249	15249	15475	16266	12651	12990	13216	13894
			DALR	ALFGL	14434	14634	14735	13833	13532	13532	13732	14434	11226	11527	11728	12329
			SALR	ALFGL	16237	16462	16575	15560	15222	15222	15447	16237	12628	12967	13192	13869

OPERATIONAL DATA (continued)

Lumen Package	Input Watts	Ambient Rating	Reflector	Lens	Delivered Lumens											
					3000K CCT, 70CRI	3500K CCT, 70CRI	4000K CCT, 70CRI	5000K CCT, 70CRI	3000K CCT, 80CRI	3500K CCT, 80CRI	4000K CCT, 80CRI	5000K CCT, 80CRI	3000K CCT, 90CRI	3500K CCT, 90CRI	4000K CCT, 90CRI	5000K CCT, 90CRI
24000LM	160	-40°F (-40°C) - 135°F (55°C)	ACCR	-	23693	24723	25066	25238	23178	23178	23521	24723	19229	19744	20087	21118
			ACFR	-	23630	24658	25000	25171	23117	23117	23459	24658	19178	19692	20034	21062
			DALR	-	19797	20658	20945	21089	19367	19367	19654	20658	16067	16498	16785	17646
			PLCR	-	22066	23026	23346	23505	21587	21587	21906	23026	17909	18389	18708	19668
			SALR	-	21682	22625	22939	23096	21211	21211	21525	22625	17597	18069	18383	19326
			ACCR	ACRCON	22181	23146	23467	23628	21699	21699	22021	23146	18002	18484	18806	19770
			ACFR	ACRCON	22317	23287	23611	23773	21832	21832	22155	23287	18112	18598	18921	19891
			PLCR	ACRCON	20727	21628	21928	22078	20276	20276	20577	21628	16822	17272	17573	18474
			ACCR	ACRDRP	21901	22853	23171	23329	21425	21425	21742	22853	17775	18251	18568	19520
			ACFR	ACRDRP	22349	23321	23645	23807	21863	21863	22187	23321	18138	18624	18948	19920
			PLCR	ACRDRP	20548	21441	21739	21888	20101	20101	20399	21441	16676	17123	17421	18314
			ACCR	ACRFGL	22251	23219	23541	23702	21767	21767	22090	23219	18059	18543	18865	19833
			ACFR	ACRFGL	22399	23373	23697	23860	21912	21912	22237	23373	18179	18666	18990	19964
			PLCR	ACRFGL	20617	21514	21813	21962	20169	20169	20468	21514	16733	17181	17480	18376
			DALR	ALCON	19162	19428	19561	18364	17964	17964	18231	19162	14904	15303	15569	16368
			SALR	ALCON	20990	21282	21427	20115	19678	19678	19970	20990	16326	16763	17054	17929
			DALR	ALDRP	19140	19405	19538	18342	17943	17943	18209	19140	14886	15285	15551	16348
			SALR	ALDRP	21113	21407	21553	20234	19794	19794	20087	21113	16421	16861	17155	18034
			DALR	ALFGL	18736	18996	19126	17955	17565	17565	17825	18736	14572	14962	15223	16003
			SALR	ALFGL	21076	21368	21515	20197	19758	19758	20051	21076	16392	16831	17124	18002
30000LM	204	-40°F (-40°C) - 135°F (50°C)	ACCR	-	29714	31006	31437	31652	29068	29068	29499	31006	24116	24762	25193	26484
			ACFR	-	29636	30924	31354	31569	28992	28992	29421	30924	24052	24696	25126	26414
			DALR	-	24829	25908	26268	26448	24289	24289	24649	25908	20151	20691	21051	22130
			PLCR	-	27674	28878	29279	29479	27073	27073	27474	28878	22460	23062	23463	24666
			SALR	-	27193	28375	28769	28966	26602	26602	26996	28375	22070	22661	23055	24237
			ACCR	ACRCON	27819	29028	29431	29633	27214	27214	27617	29028	22577	23182	23585	24795
			ACFR	ACRCON	27989	29206	29611	29814	27380	27380	27786	29206	22716	23324	23730	24947
			PLCR	ACRCON	25994	27124	27501	27690	25429	25429	25806	27124	21097	21662	22039	23169
			ACCR	ACRDRP	27467	28661	29059	29258	26870	26870	27268	28661	22292	22889	23287	24482
			ACFR	ACRDRP	28029	29248	29654	29857	27420	27420	27826	29248	22748	23358	23764	24982
			PLCR	ACRDRP	25770	26890	27264	27450	25209	25209	25583	26890	20915	21475	21848	22969
			ACCR	ACRFGL	27906	29119	29524	29726	27299	27299	27704	29119	22648	23255	23660	24873
			ACFR	ACRFGL	28092	29313	29720	29924	27481	27481	27888	29313	22799	23410	23817	25038
			PLCR	ACRFGL	25857	26982	27356	27544	25295	25295	25670	26982	20986	21548	21922	23047
			DALR	ALCON	24032	24366	24533	23031	22530	22530	22864	24032	18692	19192	19526	20527
			SALR	ALCON	26325	26690	26873	25228	24679	24679	25045	26325	20475	21023	21389	22486
			DALR	ALDRP	24004	24337	24504	23004	22504	22504	22837	24004	18670	19170	19503	20503
			SALR	ALDRP	26479	26847	27031	25376	24824	24824	25192	26479	20595	21147	21514	22618
			DALR	ALFGL	23497	23823	23987	22518	22029	22029	22355	23497	18276	18765	19091	20070
			SALR	ALFGL	26432	26799	26982	25330	24780	24780	25147	26432	20558	21109	21476	22577

OPERATIONAL DATA (continued)

Lumen Package	Input Watts	Ambient Rating	Reflector	Lens	Delivered Lumens											
					3000K CCT, 70CRI	3500K CCT, 70CRI	4000K CCT, 70CRI	5000K CCT, 70CRI	3000K CCT, 80CRI	3500K CCT, 80CRI	4000K CCT, 80CRI	5000K CCT, 80CRI	3000K CCT, 90CRI	3500K CCT, 90CRI	4000K CCT, 90CRI	5000K CCT, 90CRI
36000LM	249	-40°F (-40°C) - 135°F (45°C)	ACCR	-	34589	36093	36594	36845	33837	33837	34338	36093	28072	28824	29325	30829
			ACFR	-	34497	35997	36497	36747	33747	33747	34247	35997	27998	28748	29248	30748
			DALR	-	28902	30158	30577	30787	28274	28274	28692	30158	23457	24085	24504	25760
			PLCR	-	32214	33615	34082	34315	31514	31514	31981	33615	26145	26845	27312	28713
			SALR	-	31654	33030	33489	33718	30966	30966	31424	33030	25690	26378	26837	28213
			ACCR	ACRCON	32382	33790	34259	34494	31678	31678	32147	33790	26281	26985	27454	28862
			ACFR	ACRCON	32580	33997	34469	34705	31872	31872	32344	33997	26442	27150	27622	29039
			PLCR	ACRCON	30259	31574	32013	32232	29601	29601	30039	31574	24558	25215	25654	26970
			ACCR	ACRDRP	31973	33363	33826	34058	31278	31278	31741	33363	25949	26644	27107	28498
			ACFR	ACRDRP	32627	34046	34519	34755	31918	31918	32391	34046	26480	27189	27662	29081
			PLCR	ACRDRP	29997	31301	31736	31953	29345	29345	29780	31301	24345	24998	25432	26737
			ACCR	ACRFGL	32484	33896	34367	34602	31778	31778	32249	33896	26364	27070	27541	28953
			ACFR	ACRFGL	32700	34122	34595	34832	31989	31989	32463	34122	26539	27250	27724	29145
			PLCR	ACRFGL	30099	31408	31844	32062	29445	29445	29881	31408	24428	25083	25519	26827
			DALR	ALCON	27974	28363	28557	26809	26226	26226	26614	27974	21758	22341	22729	23895
			SALR	ALCON	30643	31069	31281	29366	28728	28728	29153	30643	23833	24472	24897	26174
			DALR	ALDRP	27941	28329	28524	26777	26195	26195	26583	27941	21732	22314	22702	23867
			SALR	ALDRP	30823	31251	31465	29539	28896	28896	29325	30823	23973	24615	25044	26328
			DALR	ALFGL	27352	27732	27922	26212	25642	25642	26022	27352	21274	21843	22223	23363
			SALR	ALFGL	30768	31195	31409	29486	28845	28845	29272	30768	23930	24571	24999	26281

UPLIGHT PERCENTAGES (*Based on 24,000LM 40K 80CRI)

Reflector Option	Flat Lens	Conical Lens	Drop Lens	L/Lens
ACFR	18.0%	17.0%	17.4%	13.1%
ACCR	7.2%	5.8%	7.4%	2.7%
PLCR	6.6%	5.0%	6.8%	2.2%
SALR	0.1%	0.1%	1.7%	0.0%
DALR	0.1%	0.1%	1.8%	0.1%

AO CHART

	AO Position	% Lumen Output	% Wattage
9000LM	1	37%	38%
	2	50%	49%
	3	63%	62%
	4	76%	74%
	5	89%	87%
	6	100%	100%
	7	100%	100%
	8	100%	100%
12000LM	1	38%	36%
	2	51%	48%
	3	64%	60%
	4	76%	74%
	5	89%	87%
	6	100%	100%
	7	100%	100%
	8	100%	100%
18000LM	1	38%	36%
	2	51%	48%
	3	64%	61%
	4	77%	74%
18000LM	5	89%	87%
	6	100%	100%
	7	100%	100%
	8	100%	100%
24000LM	1	38%	36%
	2	51%	48%
	3	64%	61%
	4	77%	74%
	5	89%	87%
30000LM	1	38%	35%
	2	51%	48%
	3	64%	61%
	4	77%	74%
	5	89%	87%
30000LM	6	100%	100%
	7	100%	100%
	8	100%	100%
30000LM	1	39%	37%
	2	52%	49%
	3	65%	62%
	4	77%	75%
	5	89%	88%
	6	100%	100%
	7	100%	100%
	8	100%	100%
36000LM	1	39%	36%
	2	53%	49%
	3	66%	61%
	4	78%	74%
	5	90%	87%
	6	100%	100%
	7	100%	100%
	8	100%	100%

OPERATIONAL DATA (continued)

LUMEN MAINTENANCE TABLE

Lumen Package	25,000	35,000	50,000	60,000
9000LM	0.97	0.96	0.95	0.94
12000LM	0.97	0.96	0.95	0.94
15000LM	0.96	0.95	0.94	0.93
18000LM	0.96	0.95	0.94	0.93
24000LM	0.96	0.95	0.93	0.93
30000LM	0.95	0.94	0.93	0.92
36000LM	0.95	0.93	0.91	0.90

LAT TABLE VS. AMBIENT TEMPERATURE (C)

Lumen Package	25	30	35	40	45	50	55
9000LM	1.00	1.00	0.99	0.99	0.98	0.98	0.97
12000LM	1.00	1.00	0.99	0.98	0.98	0.97	0.97
15000LM	1.00	0.99	0.99	0.98	0.98	0.97	0.96
18000LM	1.00	0.98	0.98	0.97	0.96	0.96	0.95
24000LM	1.00	0.99	0.99	0.98	0.97	0.97	0.96
30000LM	1.00	0.99	0.99	0.98	0.97	0.97	
36000LM	1.00	0.99	0.99	0.98			

REFLECTORS AND LENSES



Aluminum reflector
Available specular (SALR) or diffuse (DALR)



Acrylic frosted reflector (ACFR)



Clear acrylic (ACCR) or polycarbonate reflector (PLCR)



Acrylic drop lens (ACDRDP)




Flat prismatic lens (ALFGL)




Conical lens (ALCON)


OPTIONS AND ACCESSORIES



Full Wire Guard (FWG)
All dimensions are in inches.



Wire Guard (WG)

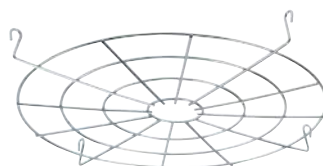

Safety Cable (JCBLS120 or JCBLS240)



Cast Hook Female (JCBLHKF)

SELECTIONS BELOW WILL EXTEND ORDER LEAD TIME. CONSULT YOUR SALES REPRESENTATIVE FOR DETAILS.

SINGLE RELAY

ORDERING INFORMATION

Example: LAHOSZU

Series	Lens option	Dimming/Photocell	Max. dim level	Min. dim level	Temp/Humidity	Default occupancy time delay
L LSXR passive infrared indoor occupancy sensor	A High mount, 360° B Low mount, 360° C High mount aisleway	O None ¹ H High/low occupancy operation P Switching photocell (on/off) ¹ M Dimming and switching photocell G Dimming and switching photocell with high/low occupancy operation	0 10 VDC 9 9 VDC 8 8 VDC 7 7 VDC	S Minimum dim level of ballast 1 1 VDC 2 2 VDC 3 3 VDC 4 4 VDC 5 5 VDC 6 6 VDC	Z None T Low temperature ²	I 30 sec D 2.5 min X 5.0 min R 7.5 min U 10.0 min (with minimum 15 minute on time) V 15.0 min W 20.0 min Y 30.0 min

Notes

¹ Max and min dim levels not applicable with this option.

² Ambient temperature rating of -4°F (-20°C) to 131°F (55°C).

Example: LENS 50 J100

Replacement lenses: Order as separate catalog number.		
Series	Lens type	Package quantity
LENS	6 High mount 360° 10 Low mount 360° 50 High mount aisleway	[blank] Single Lens J10 10-pack J100 100-pack

Bluetooth Sensor

Model	Default Operation	LSXR Equivalent	Occupancy Time Delay	Photocell Mode	Photocell Set-point	Low Trim	High Trim	Dim to Off Time Delay
LSXBTP	On/Off Occupancy Only Disabled	LSXR 10 LT or LBOOSTU	10 minutes	Disabled	n/a	n/a	100%	Disabled
LSXBTPHL	Occupancy w/ 0-10V Dimming (High/Low/Off)	LSXR 10 HL LT or LBHOSTU	10 minutes	Disabled	n/a	10%	100%	2.5 minutes
LSXBTPADC	Occupancy w/ Dim & Switch Photocell	LSXR 10 ADC LT or LBMOSTU	10 minutes	On/Off & Auto Dim	50 fc	10%	100%	0 seconds
LSXBTPANL	Dim & Switch Photocell with High/Low Occupancy Operation	LSXR 10 ANL LT or LBGOSTU	10 minutes	On/Off & Auto Dim	50 fc	10%	100%	Stay Dim/Never Off

SBG BTP Wireless Sensor: [Web Page](#) | [Presentation](#)

VLP Mobile App: [Web Page](#) | [Sell Sheet](#) | [FAQ](#) | [User Guide](#) | [Configuration Video](#)


PHOTOMETRICS

See www.lithonia.com.

SCALE: 1" = 100' HORZ



BENCHMARK:
BRASS TAG AT THE NW CORNER OF
MERIDIAN & ELLIOT ROAD
ELEVATION=1496.81 (C.O.M. DATUM)

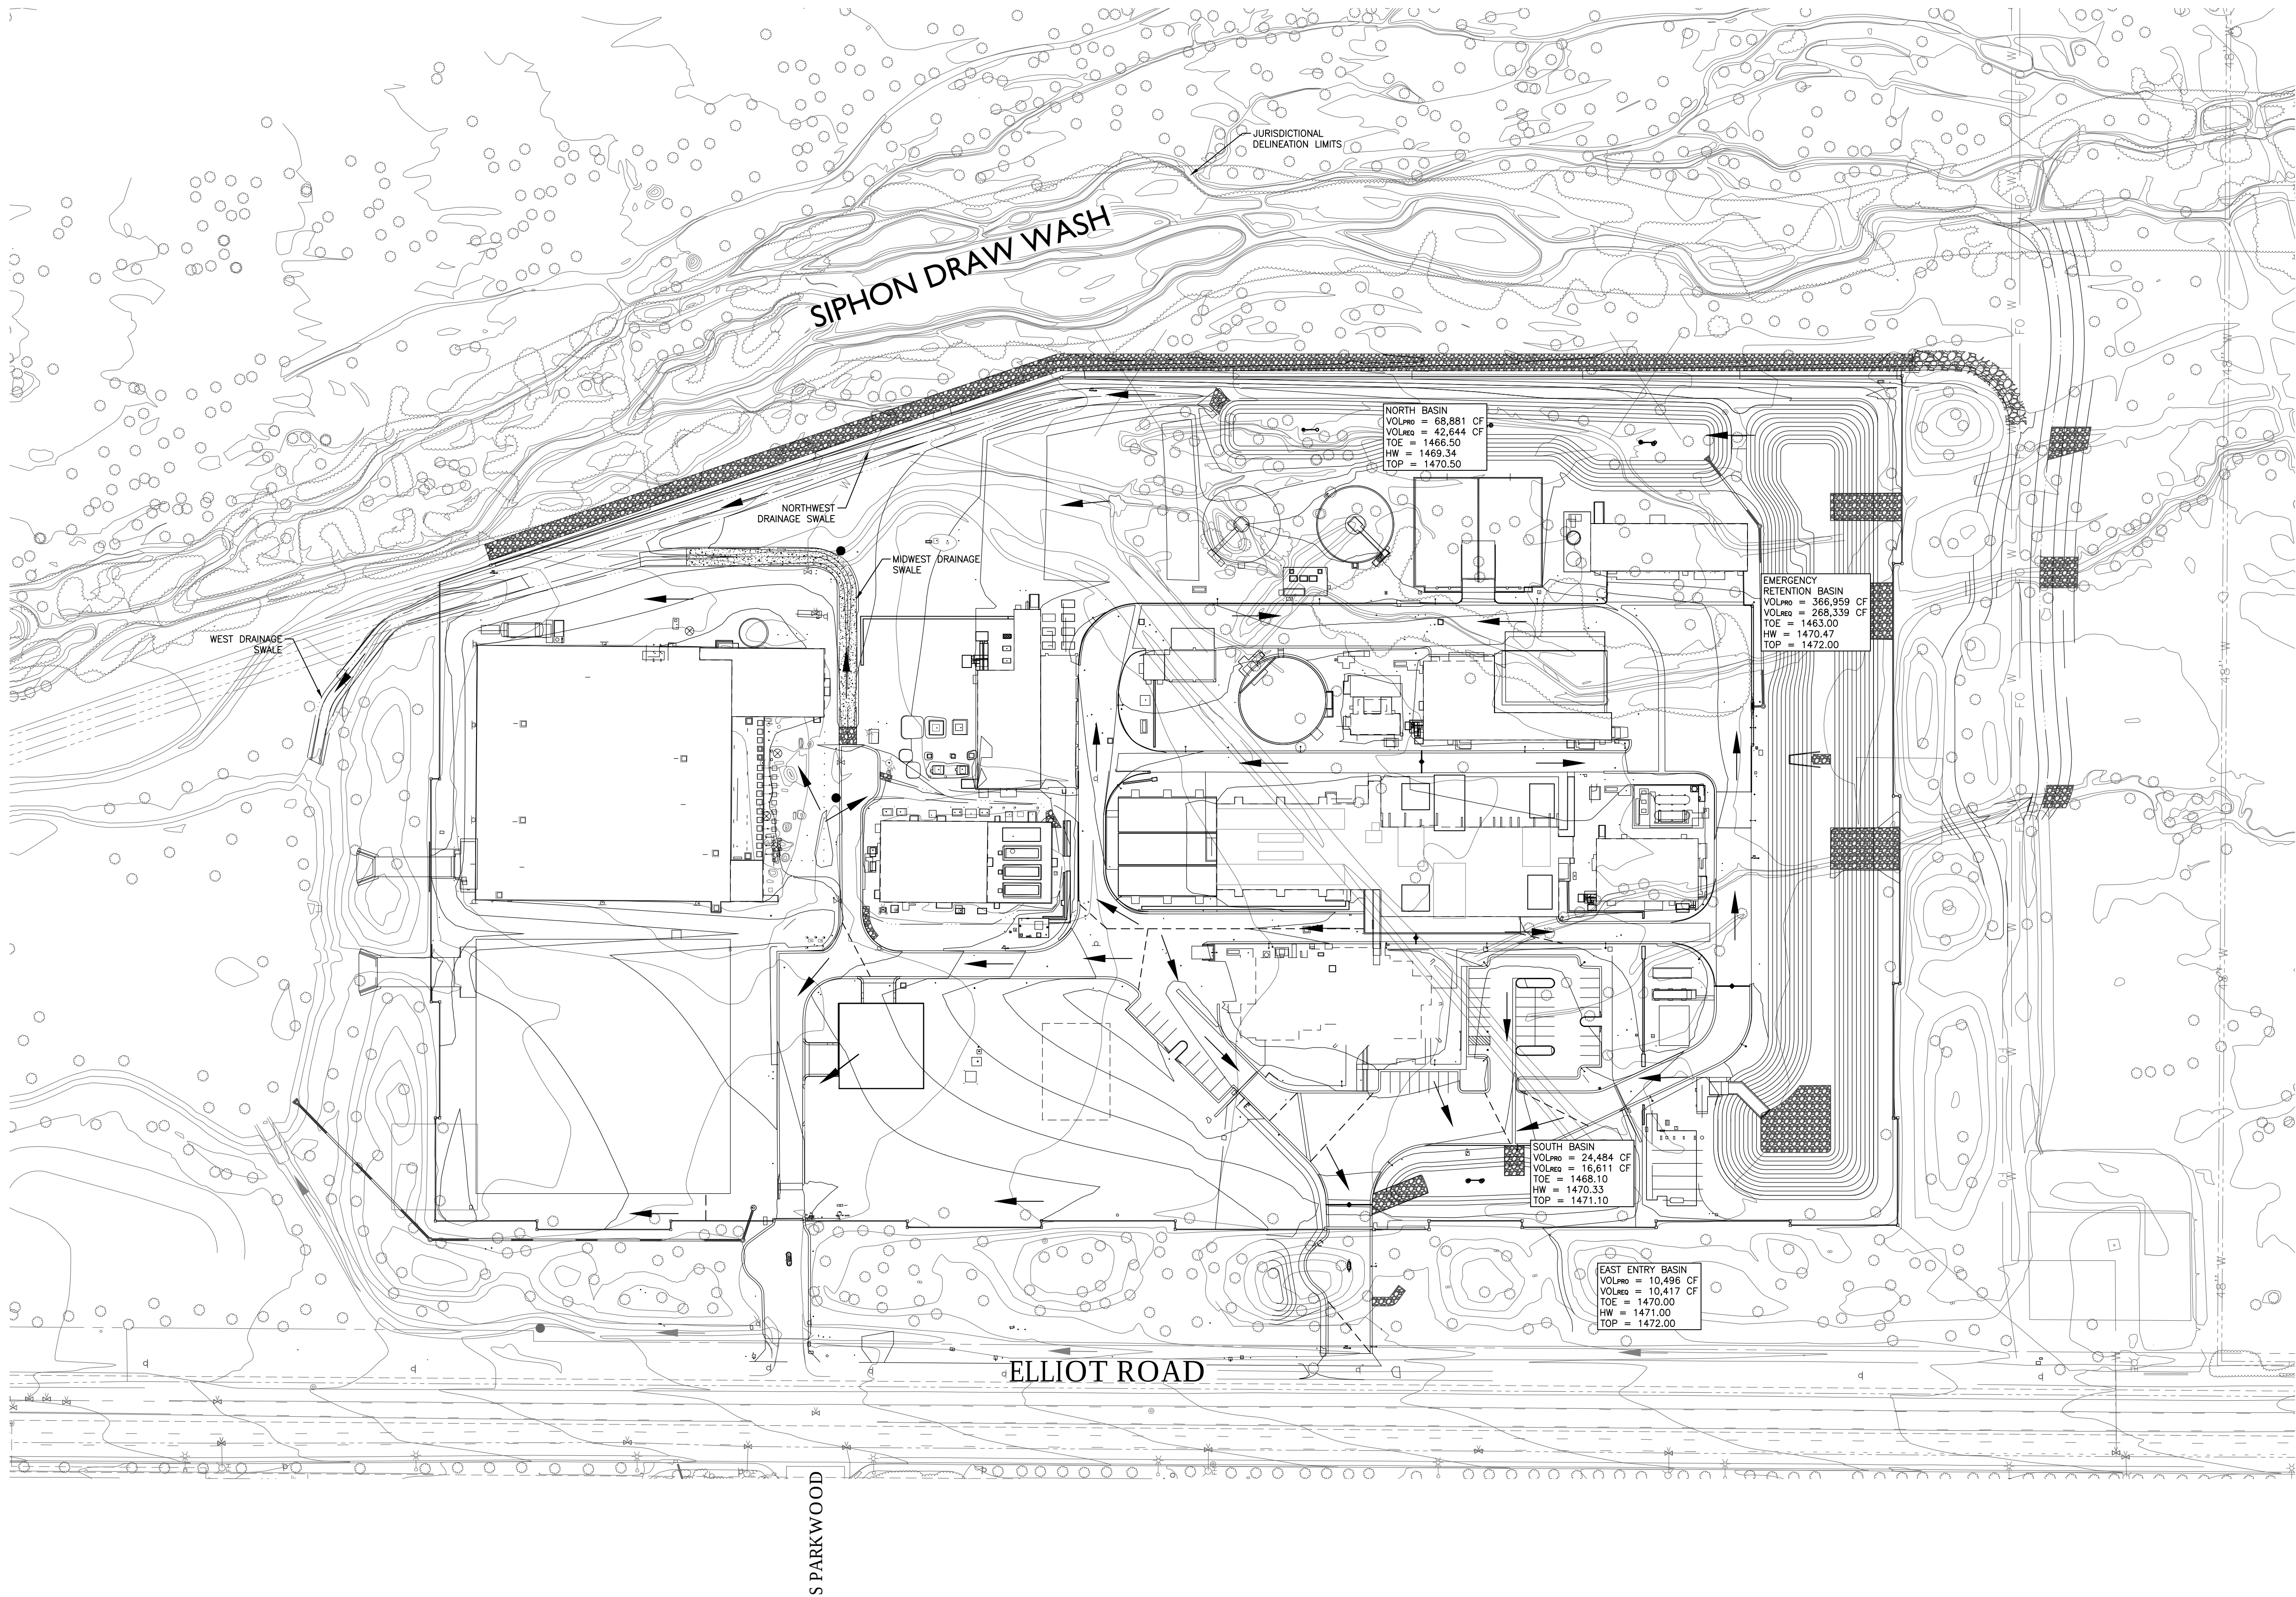

DESIGN REVIEW BOARD



1130 N Alma School Road
Suite 120
Mesa, AZ 85201

T:480.503.2250 | F:480.503.2258
www.epsgroupinc.com



Preliminary
Not For
Construction
Or
Recording

DRAWN BY: RW
ENGINEER: BJH
APPROVED BY: BJH

ACTIVITY:
PROJ. NO.: CP0372

CITY OF MESA
ENGINEERING DEPARTMENT

SIGNAL BUTTE
WATER TREATMENT PLANT

CIVIL - DRAINAGE
& RETENTION
OVERALL PLAN

DRAWING
FIGURE 3


SHEET
4 OF 28

CATALOG NUMBER:

SCALE: 1" = 100' HORZ



BENCHMARK:
BRASS TAG AT THE NW CORNER OF
MERIDIAN & ELLIOT ROAD
ELEVATION=1496.81 (C.O.M. DATUM)

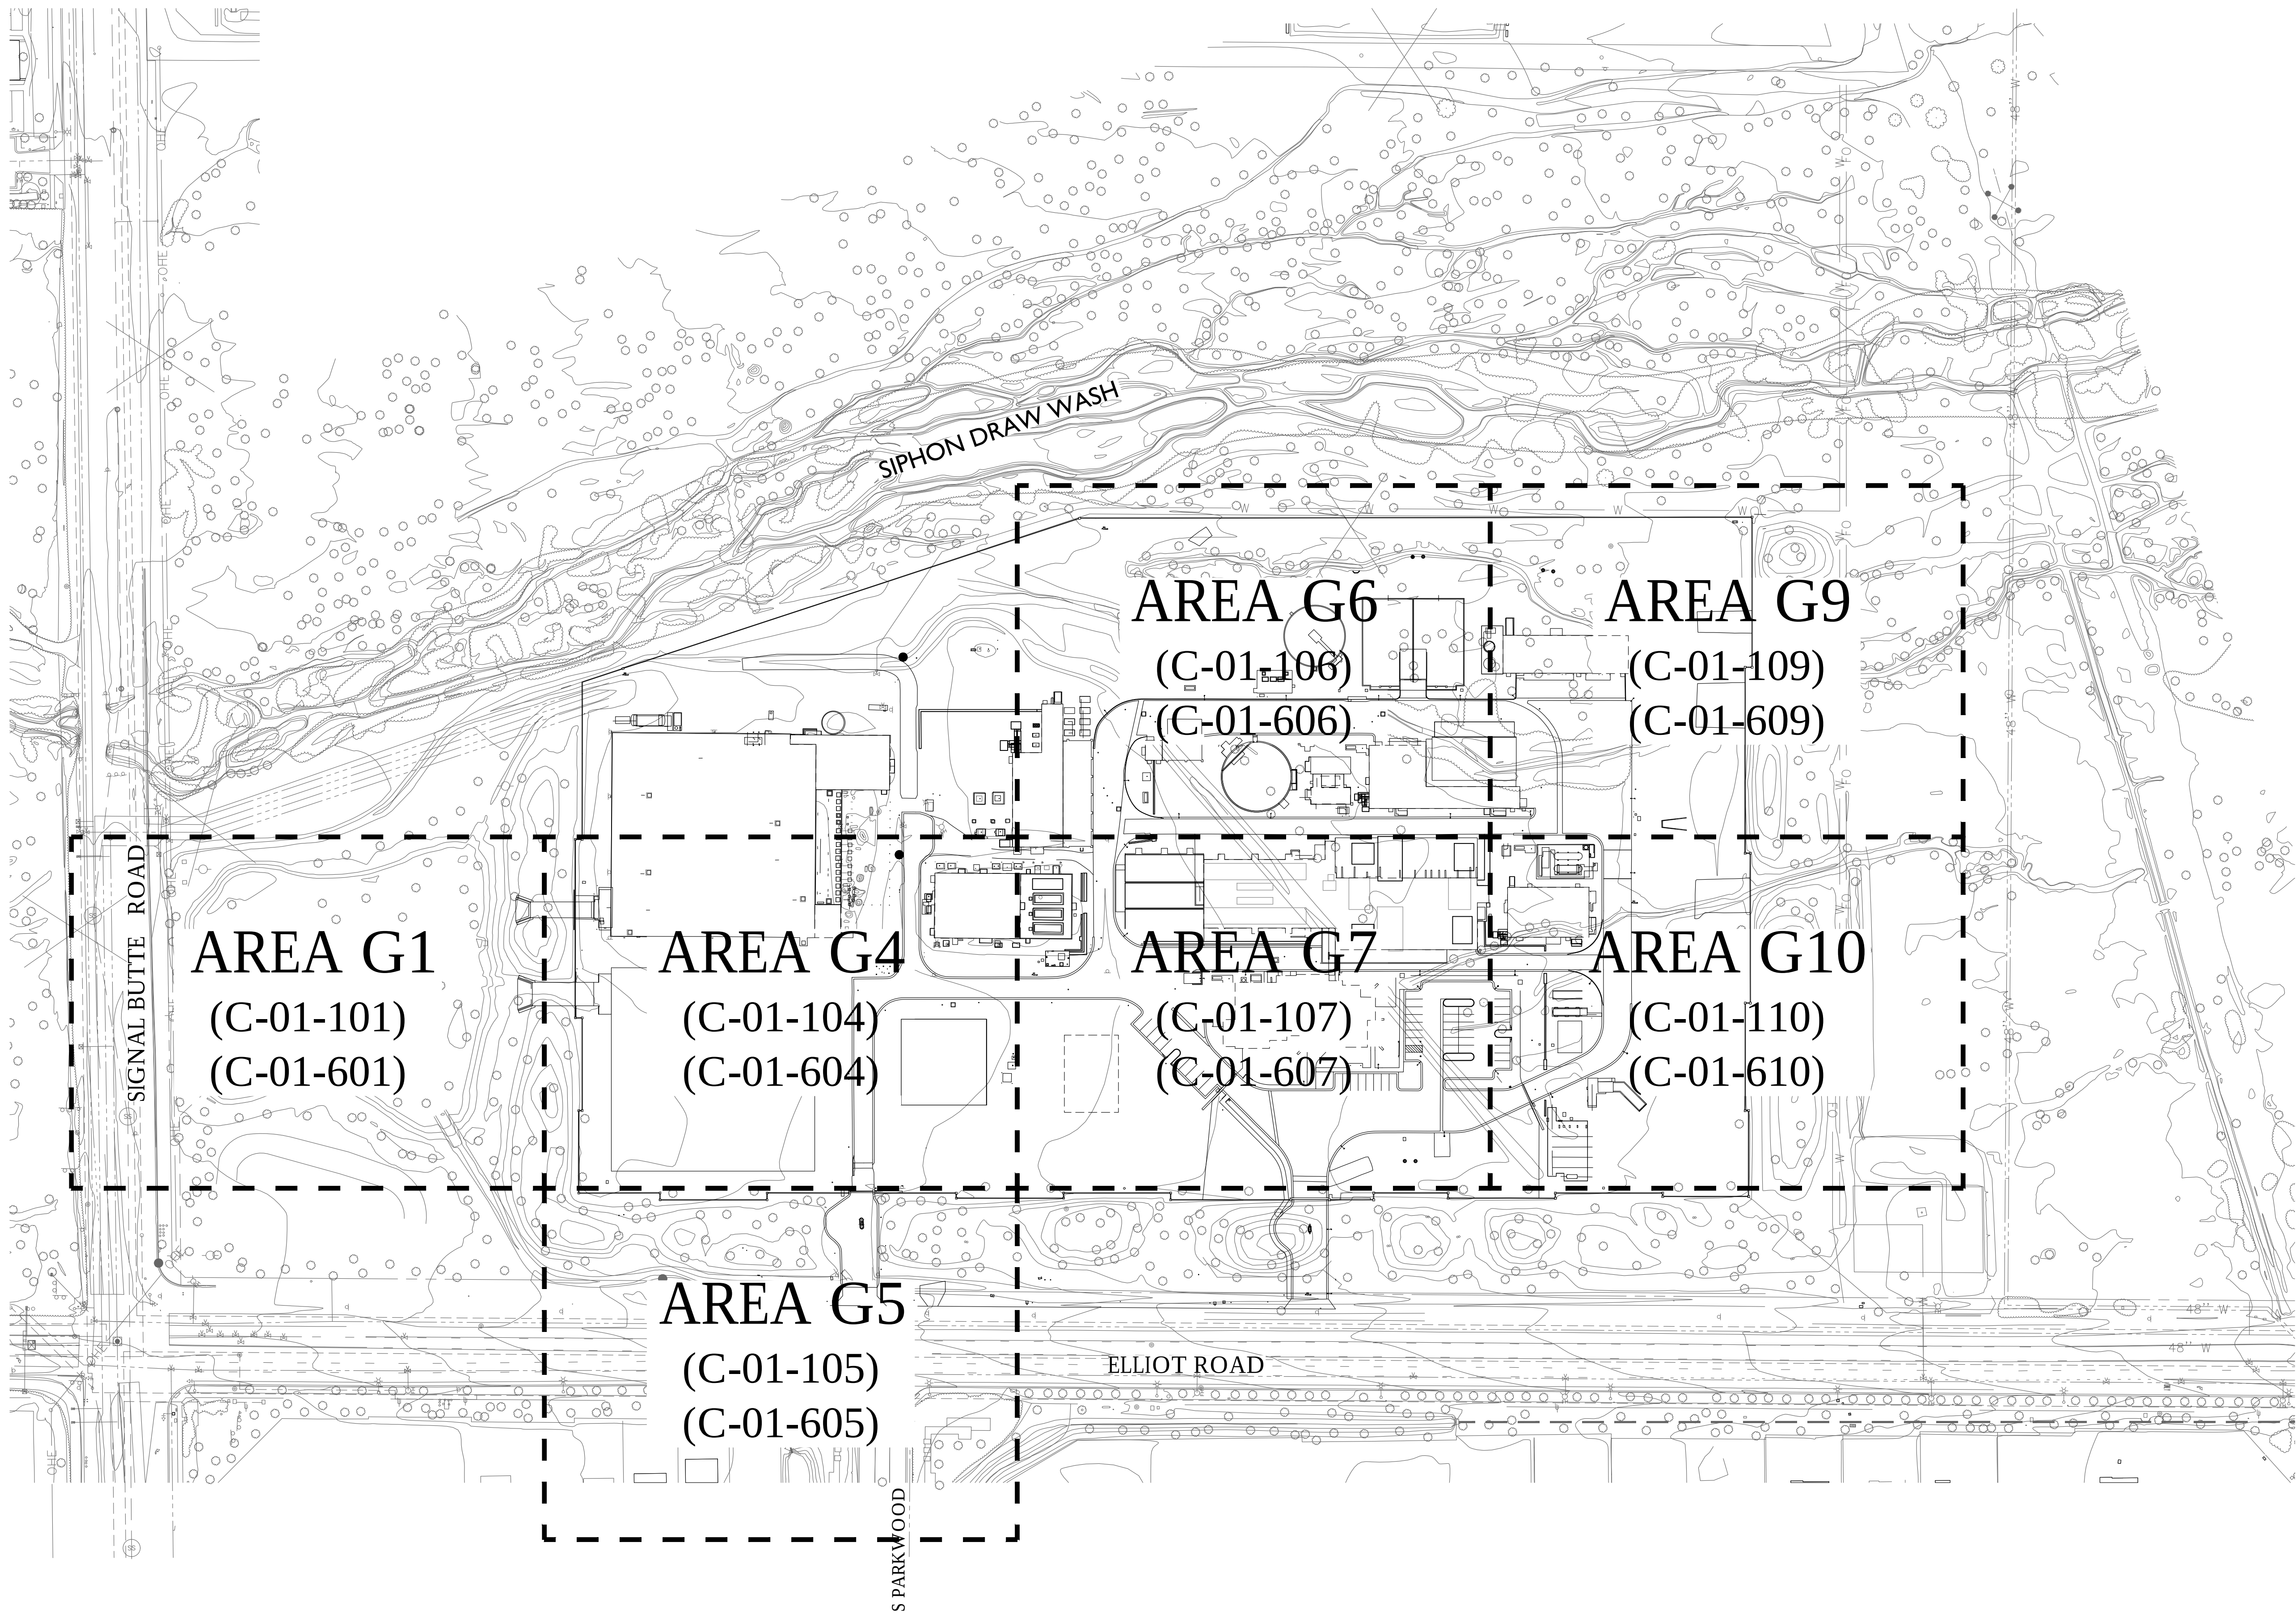

DESIGN REVIEW BOARD



1130 N Alma School Road
Suite 120
Mesa, AZ 85201
T:480.503.2250|F:480.503.2258
www.epsgroupinc.com



Preliminary
Not For
Construction
Or
Recording

DRAWN BY: RW
ENGINEER: BJH
APPROVED BY: BJH

ACTIVITY:
PROJ. NO.: CP0372

CITY OF MESA
ENGINEERING DEPARTMENT

SIGNAL BUTTE
WATER TREATMENT PLANT


CIVIL
GRADING & PAVING
KEY PLAN

DRAWING

FIGURE 5

SHEET
5 OF 28

CATALOG NUMBER:

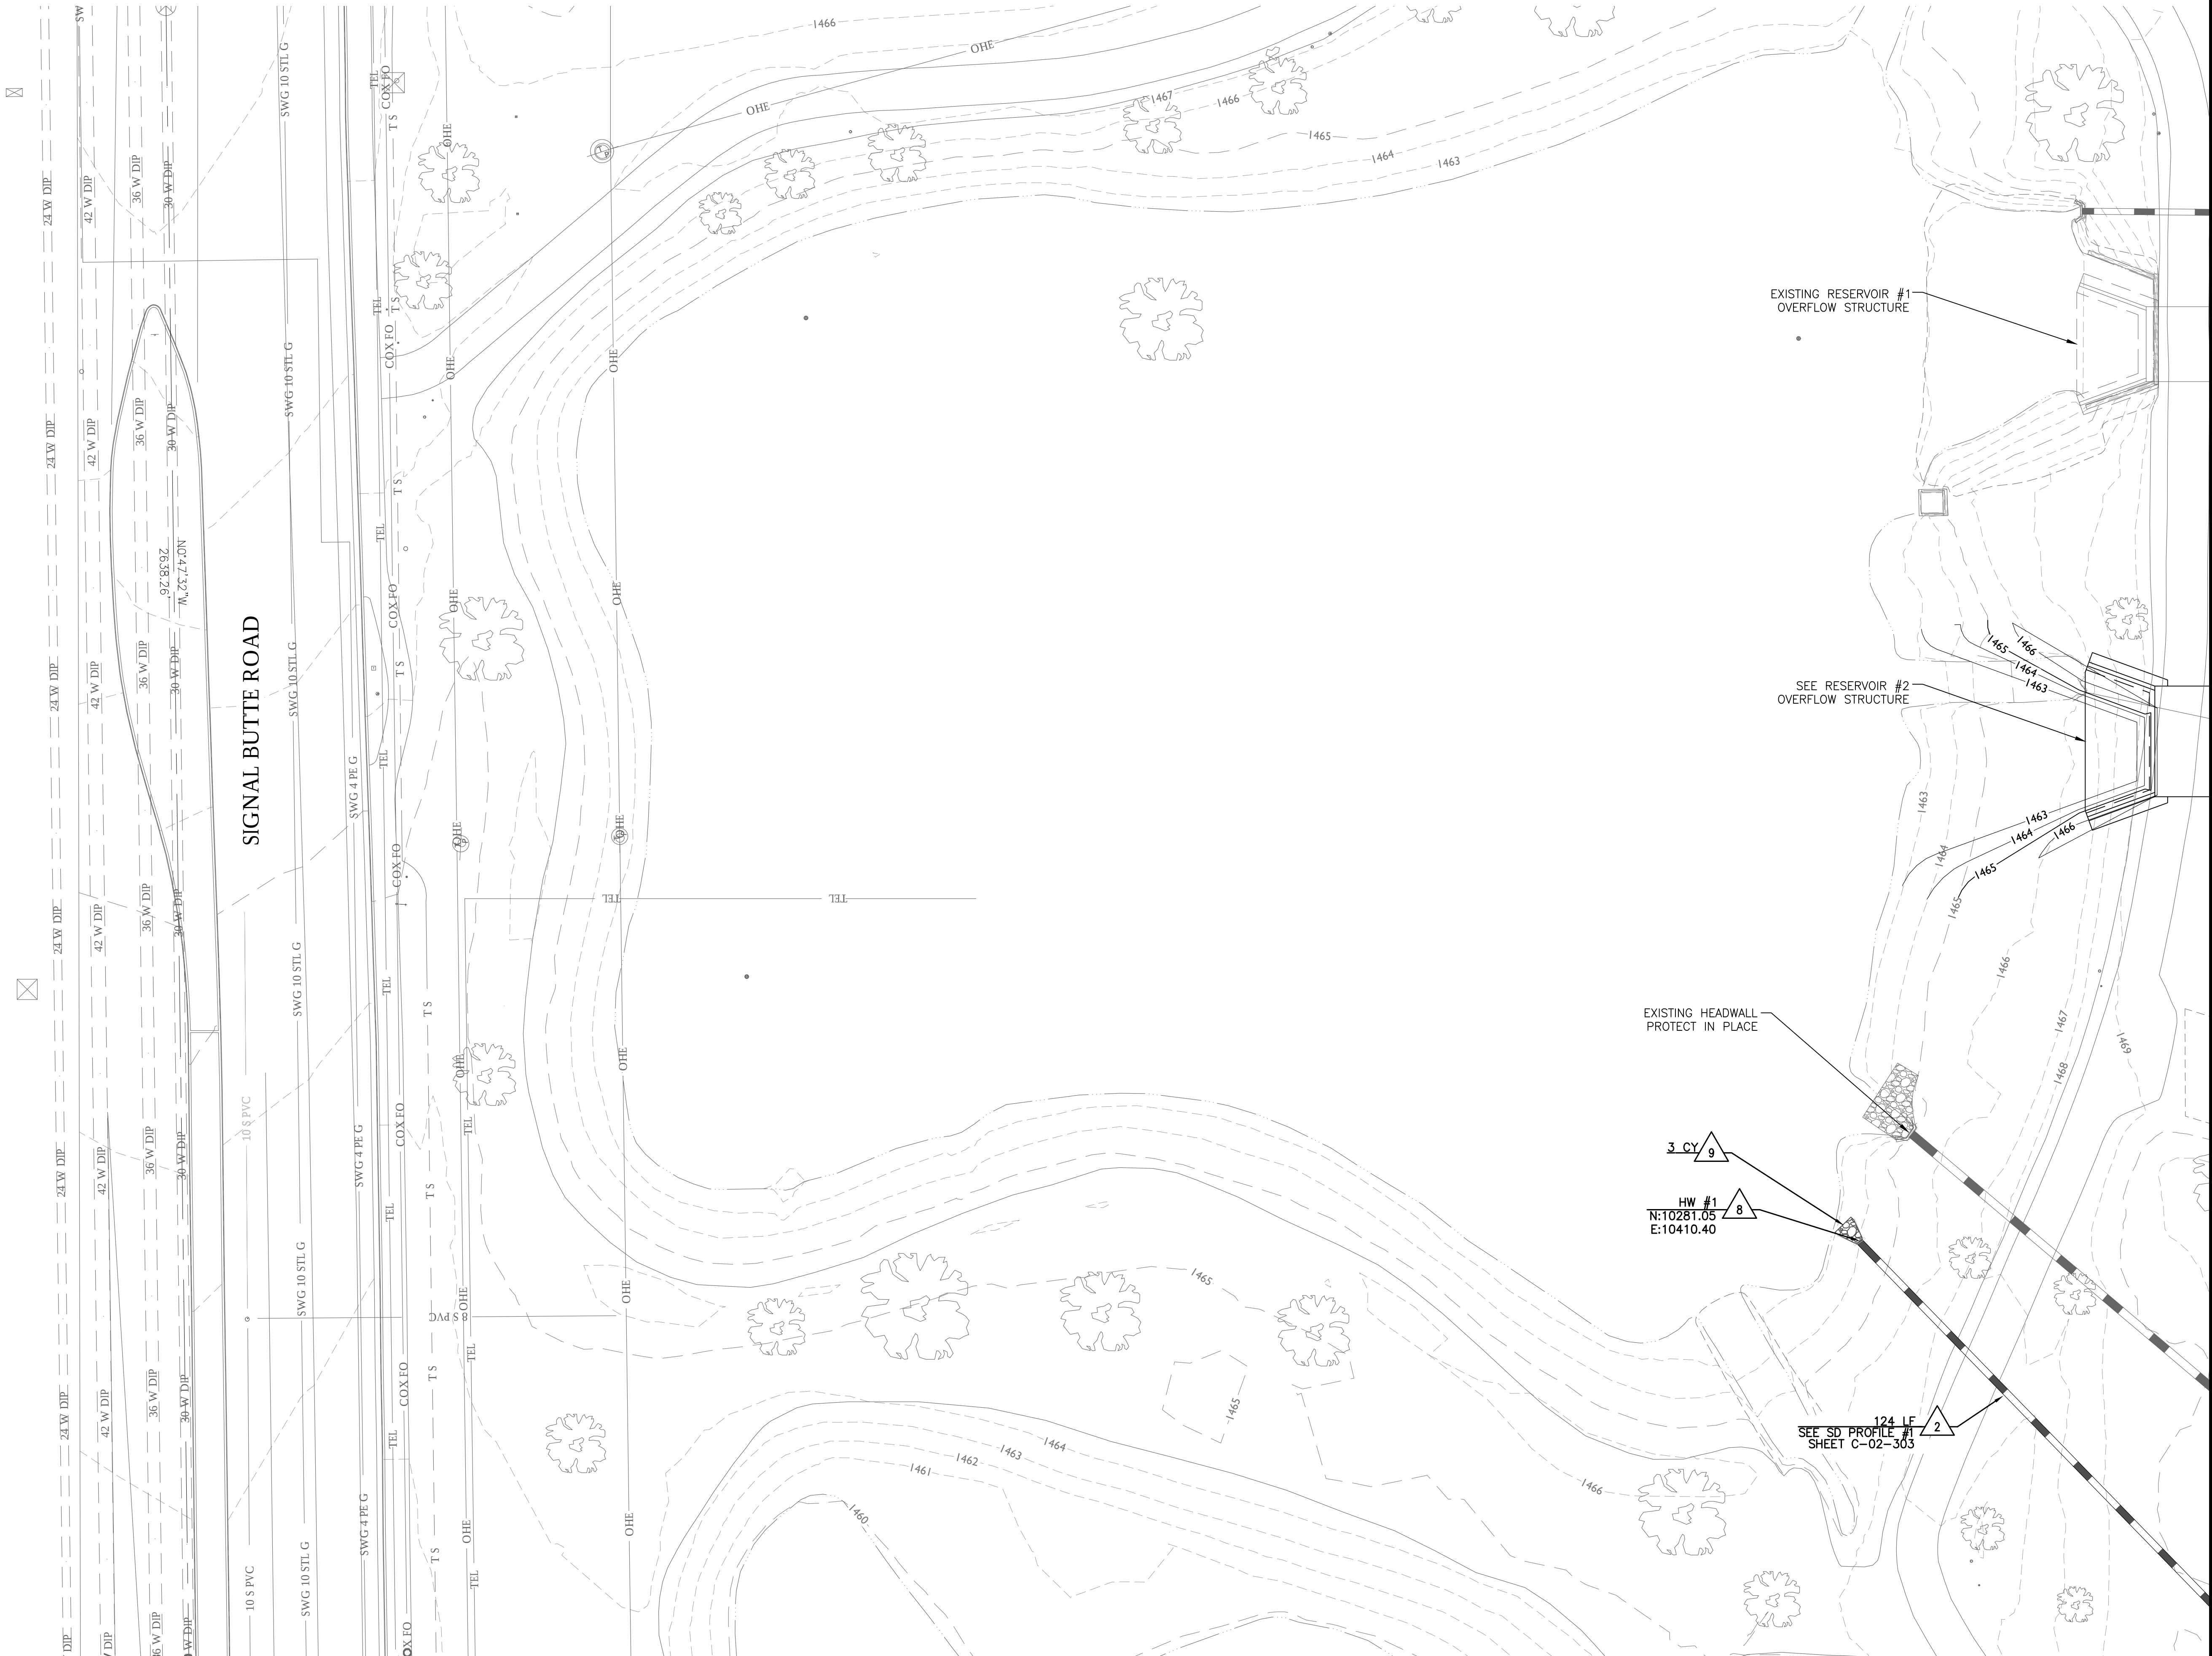

SCALE: 1" = 20' HORZ



BENCHMARK:
BRASS TAG AT THE NW CORNER OF
MERIDIAN & ELLIOT ROAD
ELEVATION=1496.81 (C.O.M. DATUM)

STORM DRAIN	
2 24" RGRCP or HDPE Storm Drain Pipe See SHT C-02-303	124 LF
8 Headwall per MAG Detail 501-1, 'U' Type with Safety Rail per COM Detail M-65	1 EA
9 Dumped Rip Rap (D50=6")	3 CY

Match Sheet C-01-104



1130 N Alma School Road
Suite 120
Mesa, AZ 85201
T:480.503.2250 F:480.503.2258
www.epsgroupinc.com



60%
Preliminary
Not For
Construction
Or
Recording

DRAWN BY: RW
ENGINEER: BJH
APPROVED BY: BJH

ACTIVITY:
PROJ. NO.: CP0372

CITY OF MESA
ENGINEERING DEPARTMENT

SIGNAL BUTTE
WATER TREATMENT PLANT

CIVIL
GRADING & PAVING
PLAN - AREA G1

DRAWING

C-01-101

SHEET
6 OF 26

CATALOG NUMBER:

Match Sheet C-01-101



Match Sheet C-01-105

SCALE: 1" = 20' HORZ





BENCHMARK:
BRASS TAG AT THE NW CORNER OF
MERIDIAN & ELLIOT ROAD
ELEVATION=1496.81 (C.O.M. DATUM)

△	STORM DRAIN	
2	24" RGRCP or HDPE Storm Drain Pipe	39 LF
5	Storm Drain Manhole per MAG Details 520 & 522	1 EA
11	Connect to New Storm Drain Manhole	NPI
○	ROADWAY	
1	Prepare Subgrade & Install 3" AC Pavement	20 SY
	over 6" ABC per Structural Section #1	
2	Prepare Subgrade & Install 6" PCCP Pavement	182 SY
	over 4" ABC per Structural Section #2	
6	Ribbon Curb per MAG Detail 220-1, Type B	20 LF
7	Roll Curb per MAG Detail 220-1, Type C	96 LF
9	Curb Transition, Roll Curb To Ribbon Curb per	4 EA
	Detail on Sheet C-01-301	
	REMOVALS	
1	Sawcut & Remove Existing AC Pavement	20 SY
3	Sawcut & Remove Existing Concrete Curb	77 LF
10	Remove Existing Storm Drain Pipe	271 LF
12	Remove Existing Storm Drain Manhole	1 EA

Match Sheet C-01-107

PAVEMENT LEGEND

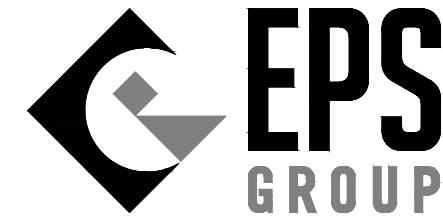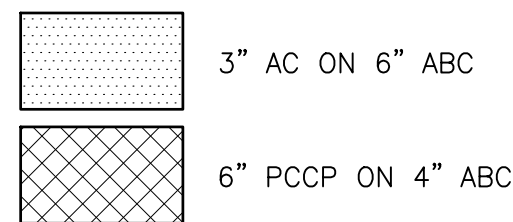


1130 N Alma School Road
Suite 120
Mesa, AZ 85201
T:480.503.2250 | F:480.503.2258
www.epsgroupinc.com



Preliminary Not For Construction Or Recording	CITY OF MESA ENGINEERING DEPARTMENT	
	SIGNAL BUTTE WATER TREATMENT PLANT	
	CIVIL GRADING & PAVING PLAN - AREA G4	DRAWING C-01-104
	SHEET 7 OF 28	CATALOG NUMBER:
DRAWN BY: RW ENGINEER: BJH APPROVED BY: BJH	ACTIVITY: PROJ. NO.: CP0372	

S:\PROJECTS\2020\20-1290\CIVIL\CAD\DWG\C-01-106.DWG
DATE SAVED: 8/11/22

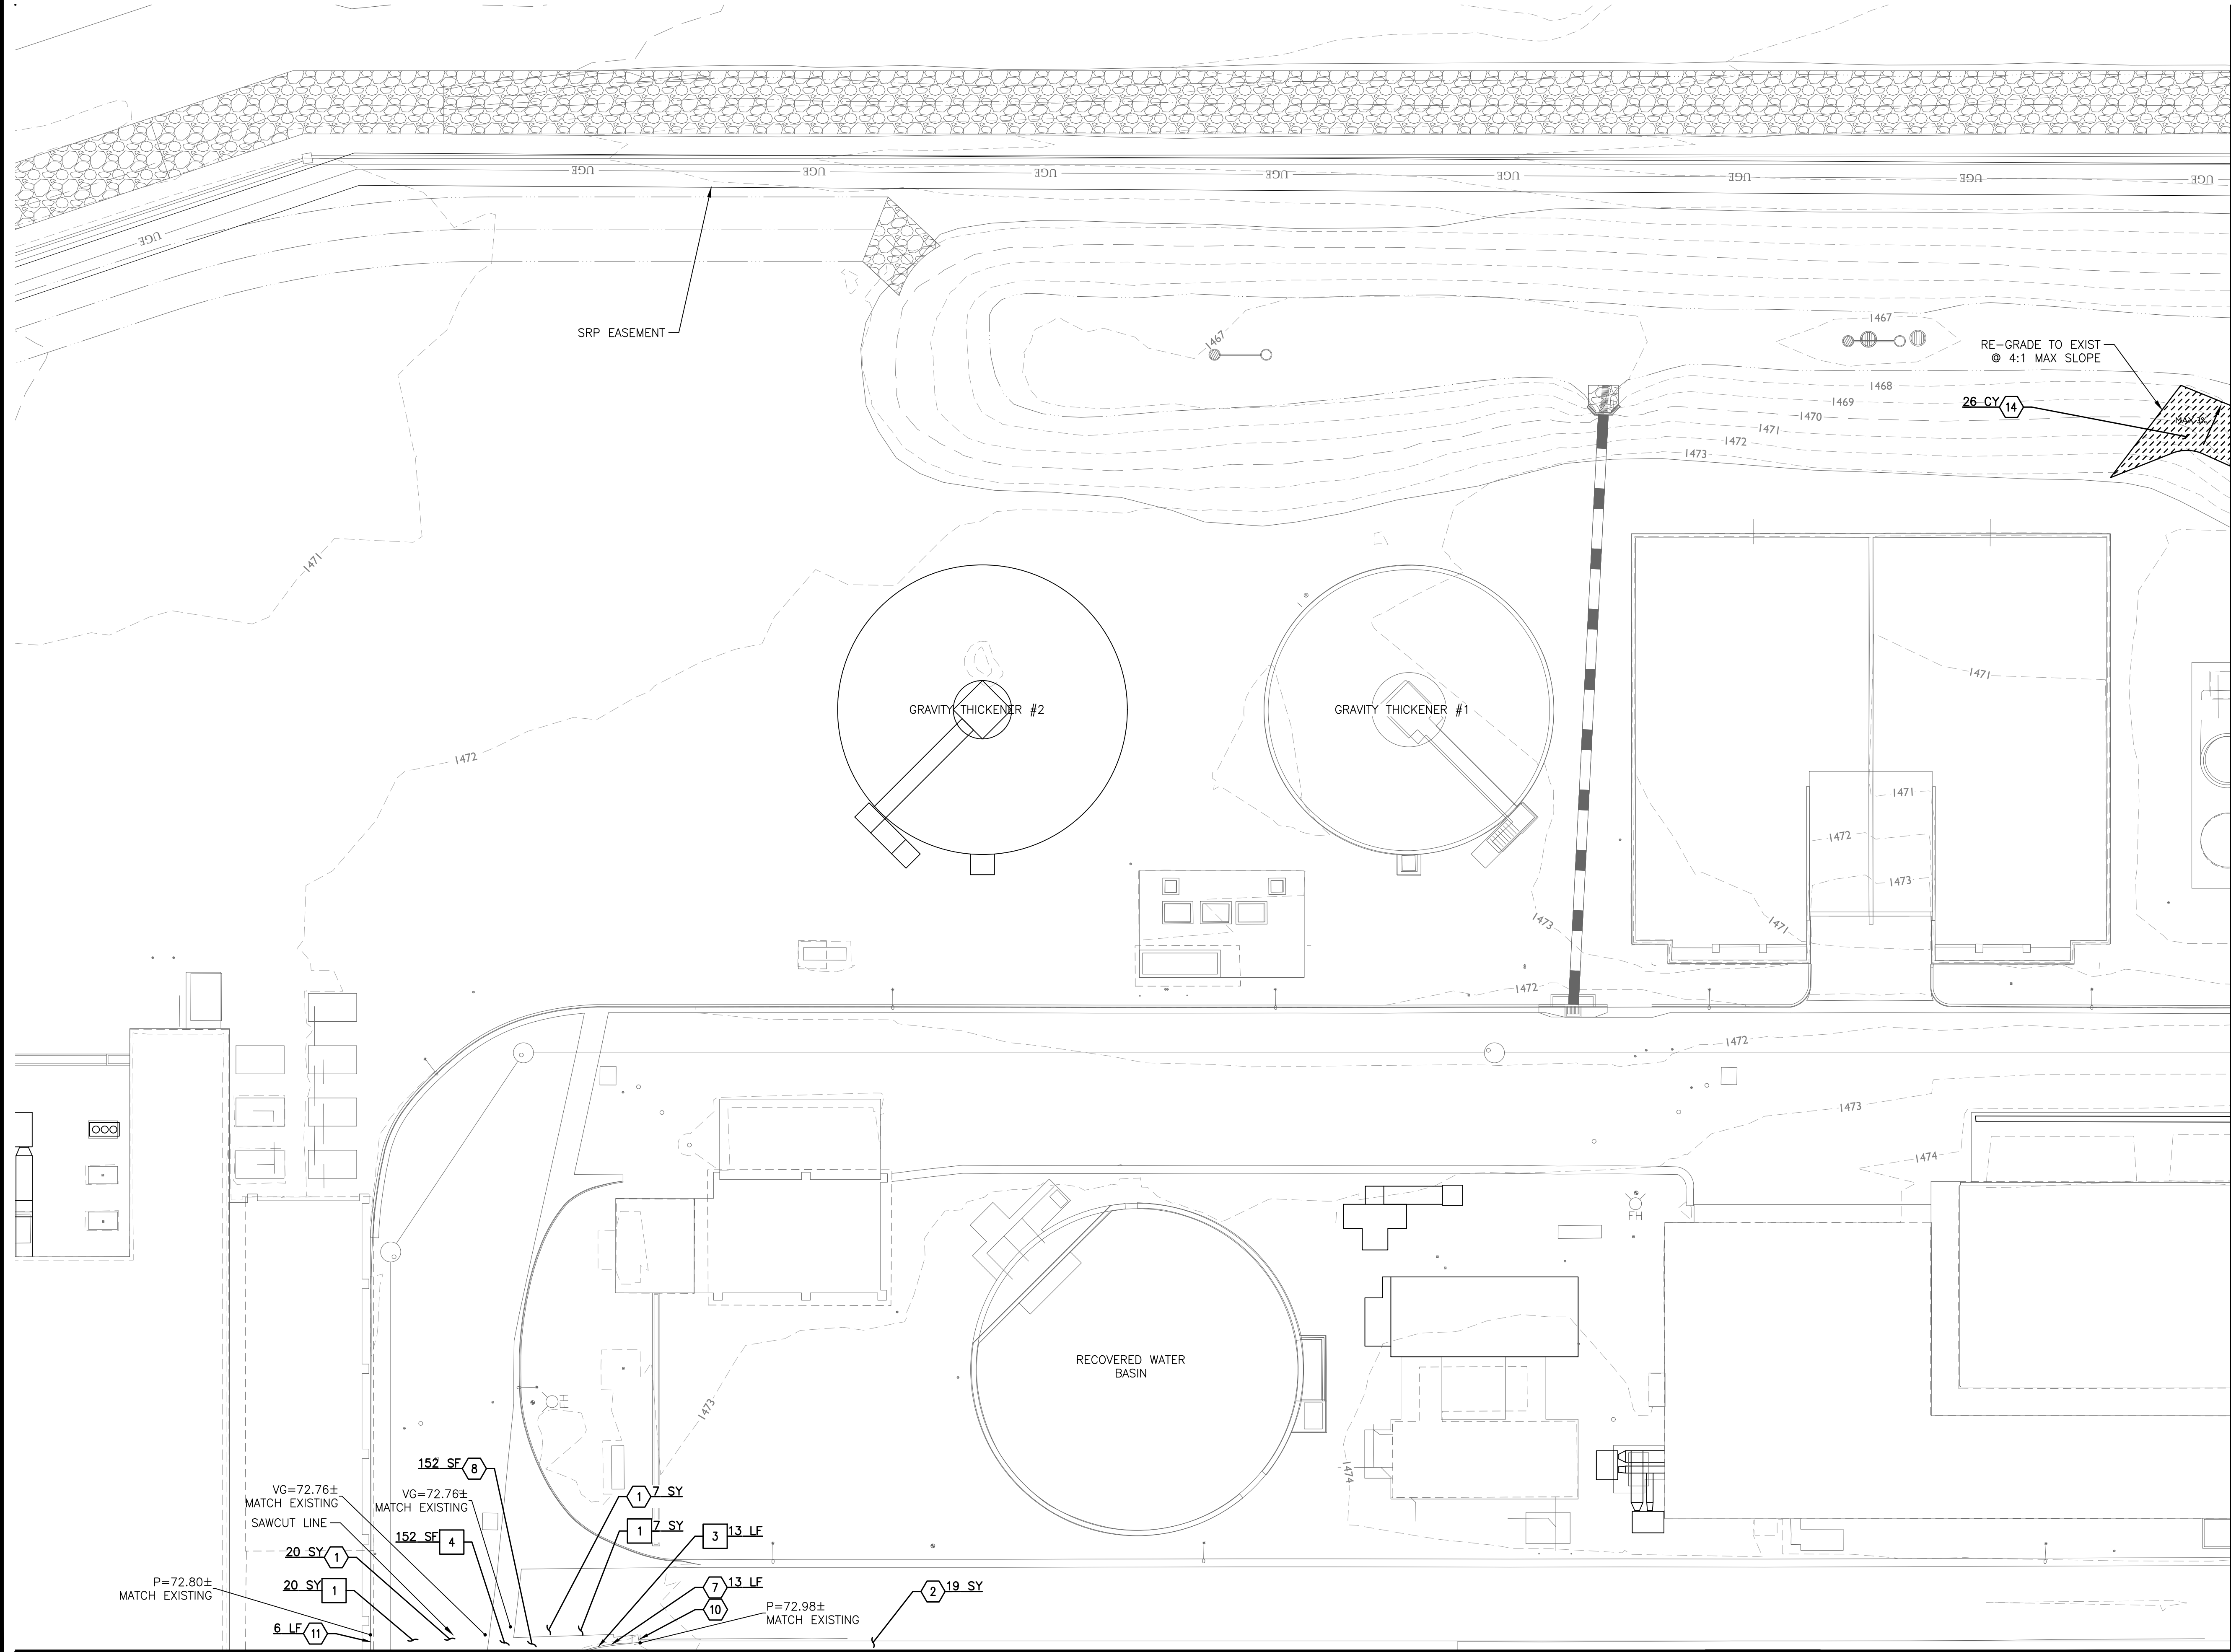

Match Sheet C-01-107

SCALE: 1" = 20' HORZ	 NORTH	BENCHMARK: BRASS TAG AT THE NW CORNER OF MERIDIAN & ELLIOT ROAD ELEVATION=1496.81 (C.O.M. DATUM)
 ROADWAY		
1 Prepare Subgrade & Install 3" AC Pavement over 6" ABC per Structural Section #1		27 SY
2 Prepare Subgrade & Install 6" PCCP Pavement over 4" ABC per Structural Section #2		19 SY
7 Roll Curb per MAG Detail 220-1, Type C		13 LF
8 Valley Gutter & Apron per MAG Detail 240		152 SF
10 Curb Termination per MAG Detail 222		1 EA
11 Thickened Edge per MAG Detail 201, Type A		6 LF
14 Earthwork for Retention Basins		26 CY
REMOVALS		
1 Sawcut & Remove Existing AC Pavement		27 SY
3 Sawcut & Remove Existing Concrete Curb		13 LF
4 Remove Existing Concrete (Sidewalk, Driveway, Apron)		152 SY

Match Sheet C-01-109

PAVEMENT LEGEND

	3" AC ON 6" ABC
	6" PCCP ON 4" ABC



60% Preliminary Not For Construction Or Recording	CITY OF MESA ENGINEERING DEPARTMENT	
	SIGNAL BUTTE WATER TREATMENT PLANT	
	CIVIL GRADING & PAVING PLAN - AREA G6	DRAWING C-01-106
	SHEET 9 OF 26	CATALOG NUMBER:
DRAWN BY: RW ENGINEER: BJH APPROVED BY: BJH		
ACTIVITY: PROJ. NO.: CP0372		

Match Sheet C-01-106

SCALE: 1" = 20' HORZ





NORTH

BENCHMARK:
BRASS TAG AT THE NW CORNER OF
MERIDIAN & ELLIOT ROAD
ELEVATION=1496.81 (C.O.M. DATUM)

ROADWAY	
1 Prepare Subgrade & Install 3" AC Pavement over 6" ABC per Structural Section #1	398 SY
2 Prepare Subgrade & Install 6" PCCP Pavement over 4" ABC per Structural Section #2	318 SY
7 Roll Curb per MAG Detail 220-1, Type C	161 LF
8 Valley Gutter & Apron per MAG Detail 240	258 SF
11 Thickened Edge per MAG Detail 201, Type A	85 LF
REMOVALS	
1 Sawcut & Remove Existing AC Pavement	398 SY
3 Sawcut & Remove Existing Concrete Curb	161 LF
4 Remove Existing Concrete (Sidewalk, Driveway, Apron)	258 SY
8 Remove Existing Concrete (Sidewalk, Driveway, Apron)	60 SY

Match Sheet
#####

PAVEMENT LEGEND

	3" AC ON 6" ABC
	6" PCCP ON 4" ABC



EPS
GROUP

1130 N Alma School Road
Suite 120
Mesa, AZ 85201
T:480.503.2250 | F:480.503.2258
www.epsgroupinc.com


Call at least two full working days
before you begin excavation



ARIZONA 811

Dial 8-1-1 or 1-800-STAKE-IT (785-5348)
in Maricopa County: (602)683-1100


60% Preliminary Not For Construction Or Recording	CITY OF MESA ENGINEERING DEPARTMENT	
	SIGNAL BUTTE WATER TREATMENT PLANT	
	CIVIL GRADING & PAVING PLAN - AREA G7	DRAWING C-01-107
	SHEET 10 of 26	CATALOG NUMBER:
DRAWN BY: RW ENGINEER: BJH APPROVED BY: BJH		
ACTIVITY: PROJ. NO.: CP0372		

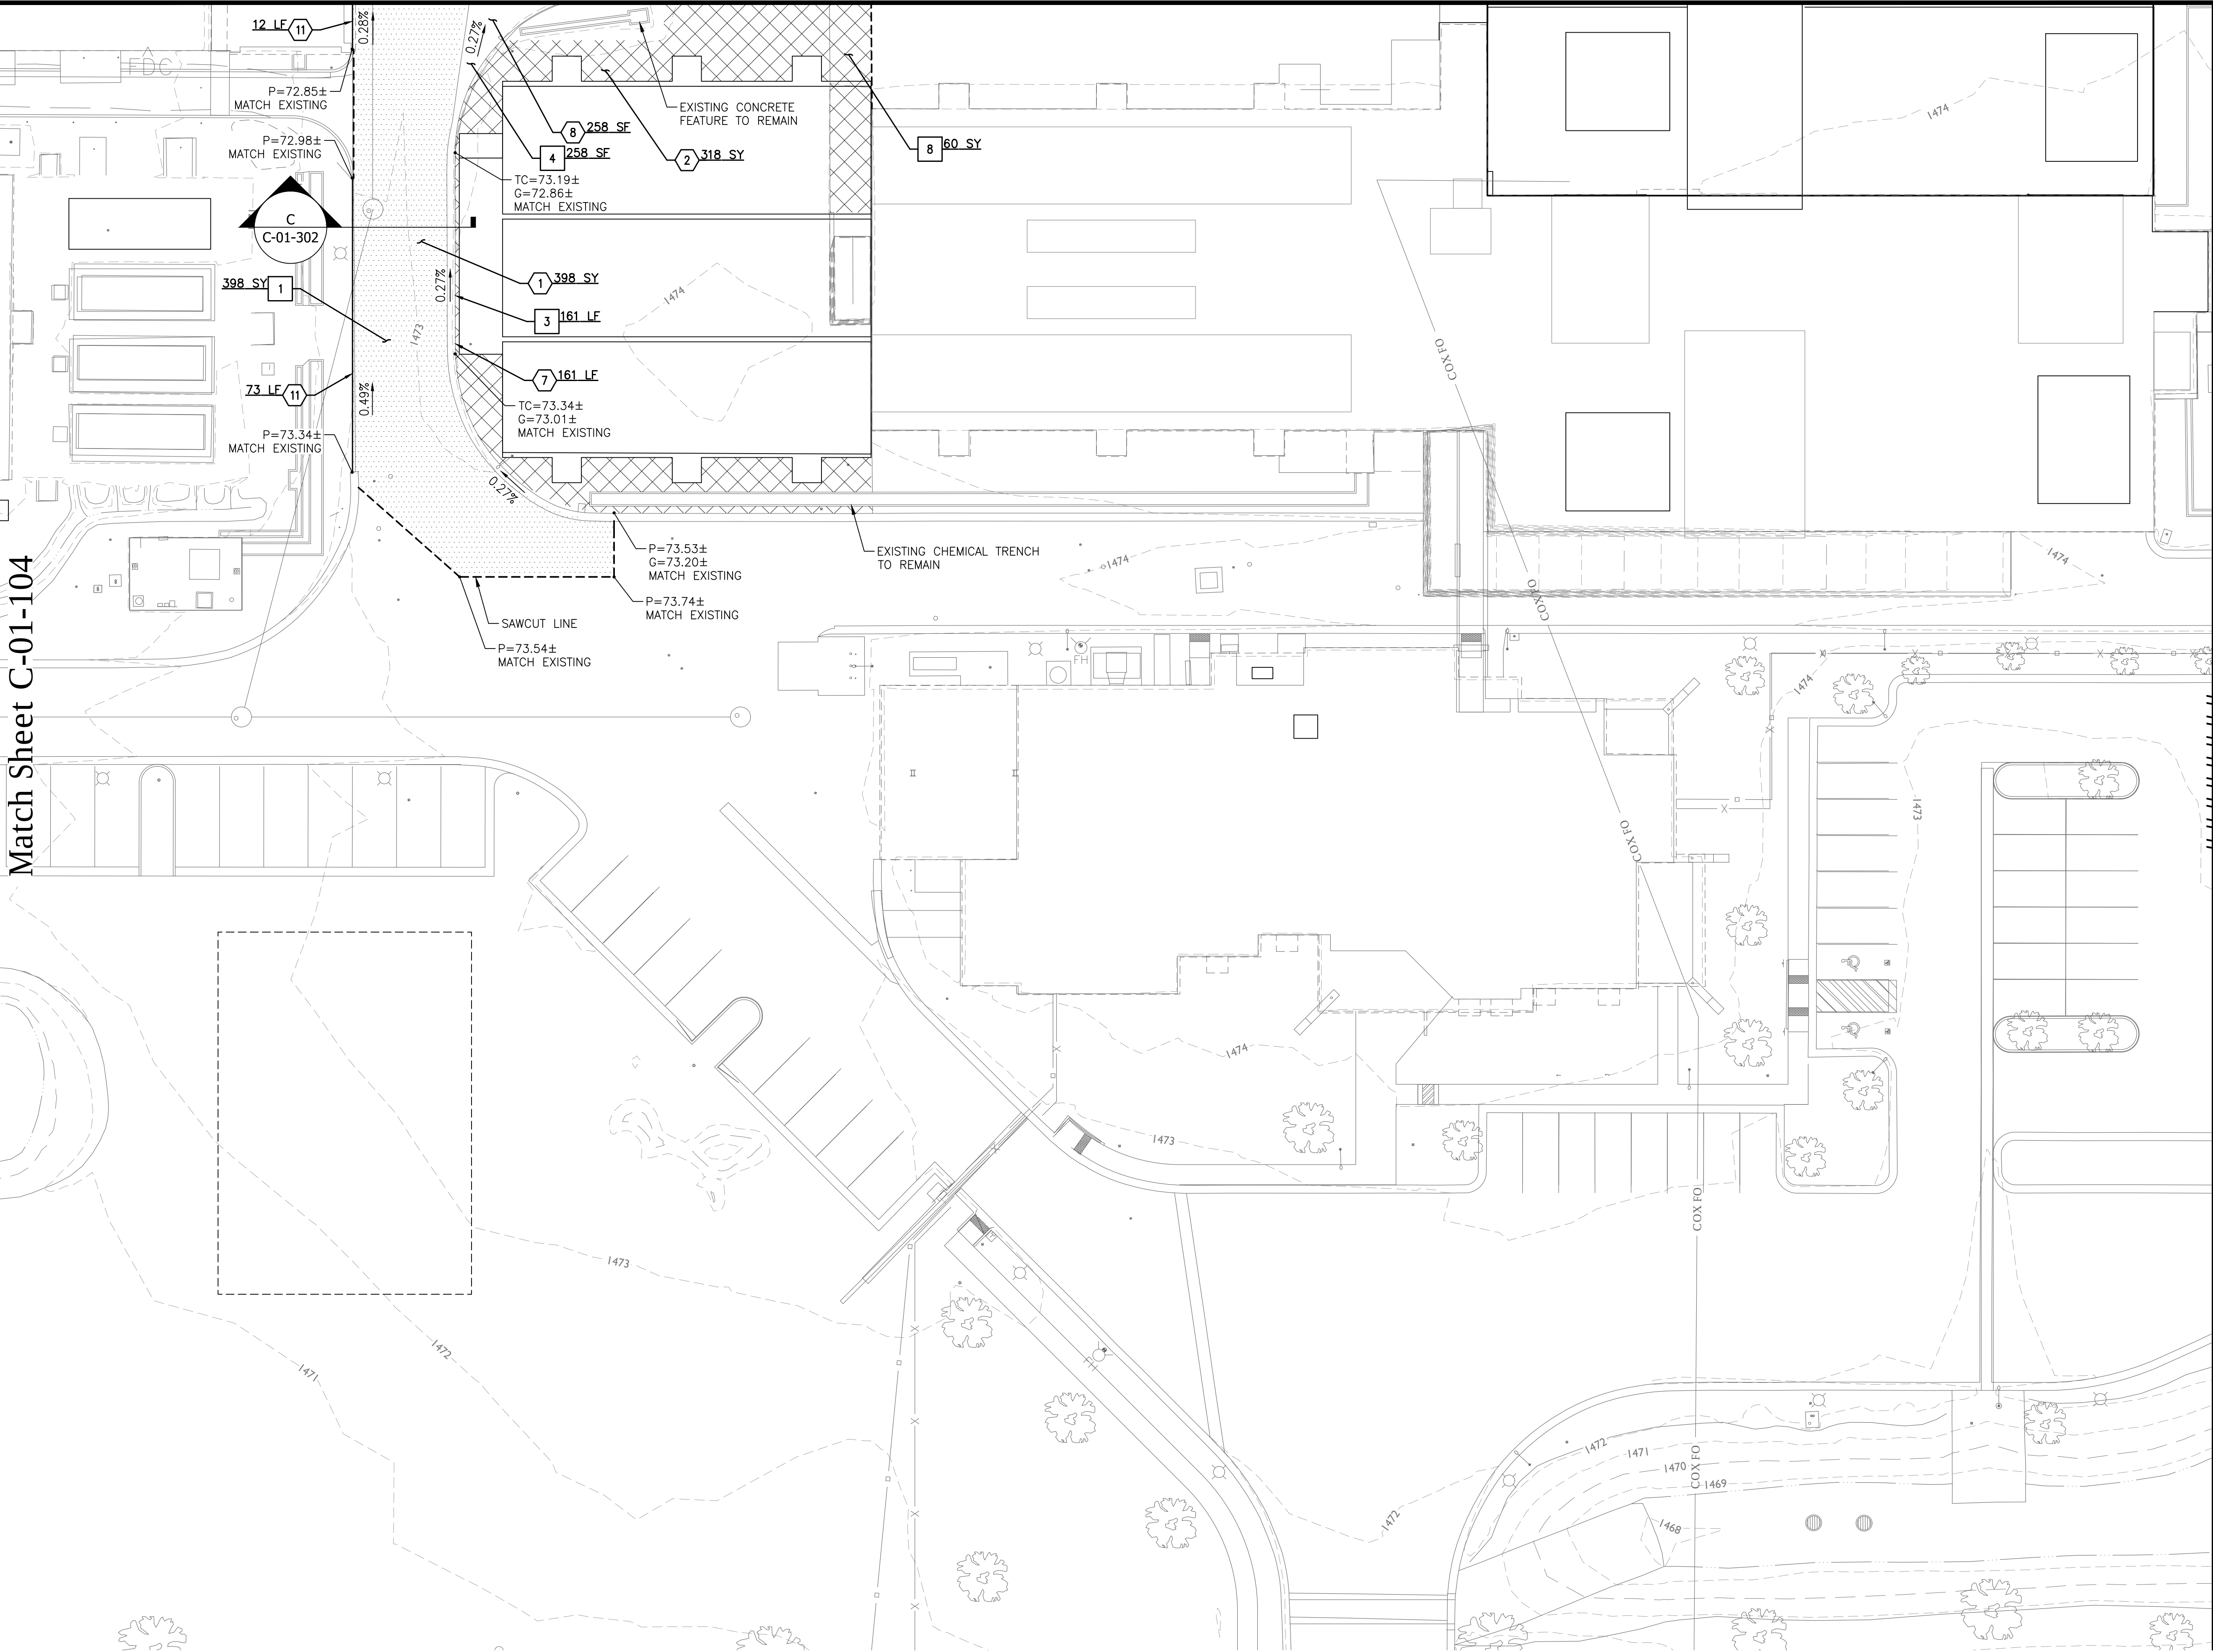

Match Sheet C-01-104

S:\PROJECTS\2020\20-1290\CIVIL\CAD\DWG\C-01-109.DWG
DATE SAVED: 8/12/22

Match Sheet C-01-106

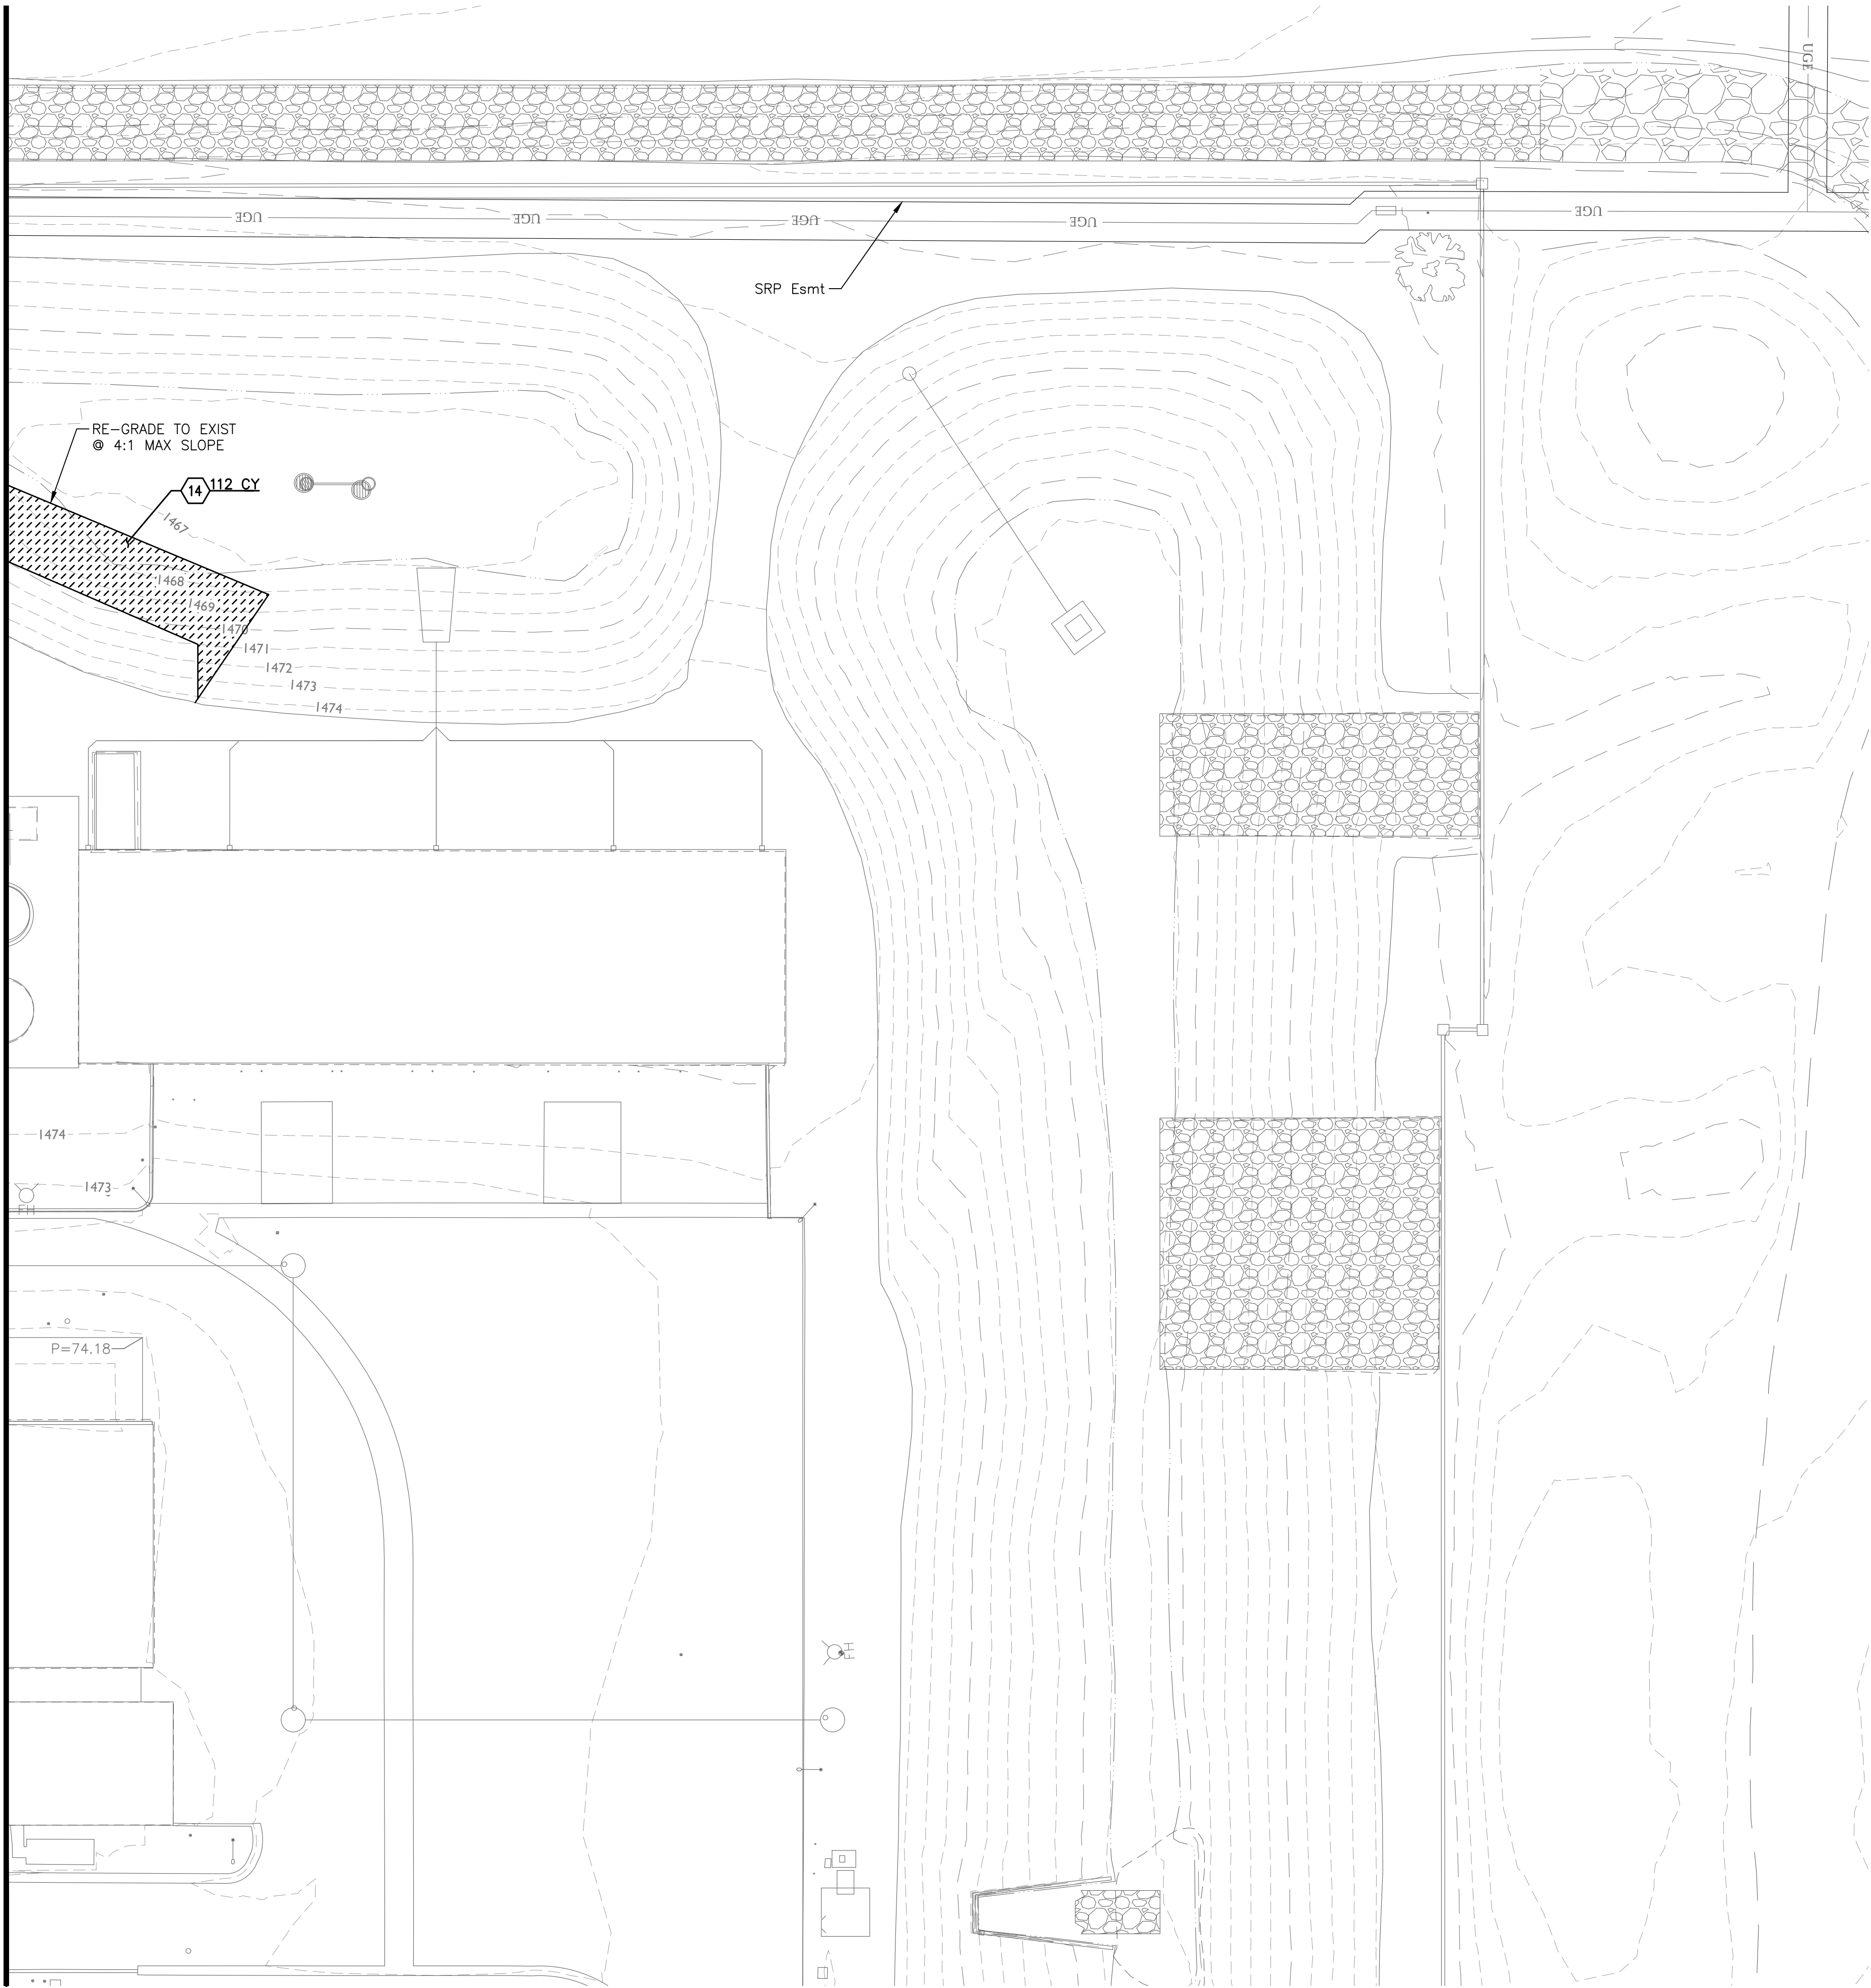

SCALE: 1" = 20' HORZ




BENCHMARK:
BRASS TAG AT THE NW CORNER OF
MERIDIAN & ELLIOT ROAD
ELEVATION=1496.81 (C.O.M. DATUM)

ROADWAY

14 Earthwork for Retention Basins

112 CY

PAVEMENT LEGEND



3" AC ON 6" ABC

6" PCCP ON 4" ABC



1130 N Alma School Road
Suite 120
Mesa, AZ 85201
T:480.503.2250 | F:480.503.2258
www.epsgroupinc.com

60%
Preliminary
Not For
Construction
Or
Recording

DRAWN BY: RW
ENGINEER: BJH
APPROVED BY: BJH

ACTIVITY:
PROJ. NO.: CP0372

CITY OF MESA
ENGINEERING DEPARTMENT

SIGNAL BUTTE
WATER TREATMENT PLANT

CIVIL
GRADING & PAVING
PLAN - AREA G9


DRAWING

C-01-109

SHEET
11 of 26



CATALOG NUMBER:

Match Sheet C-01-109

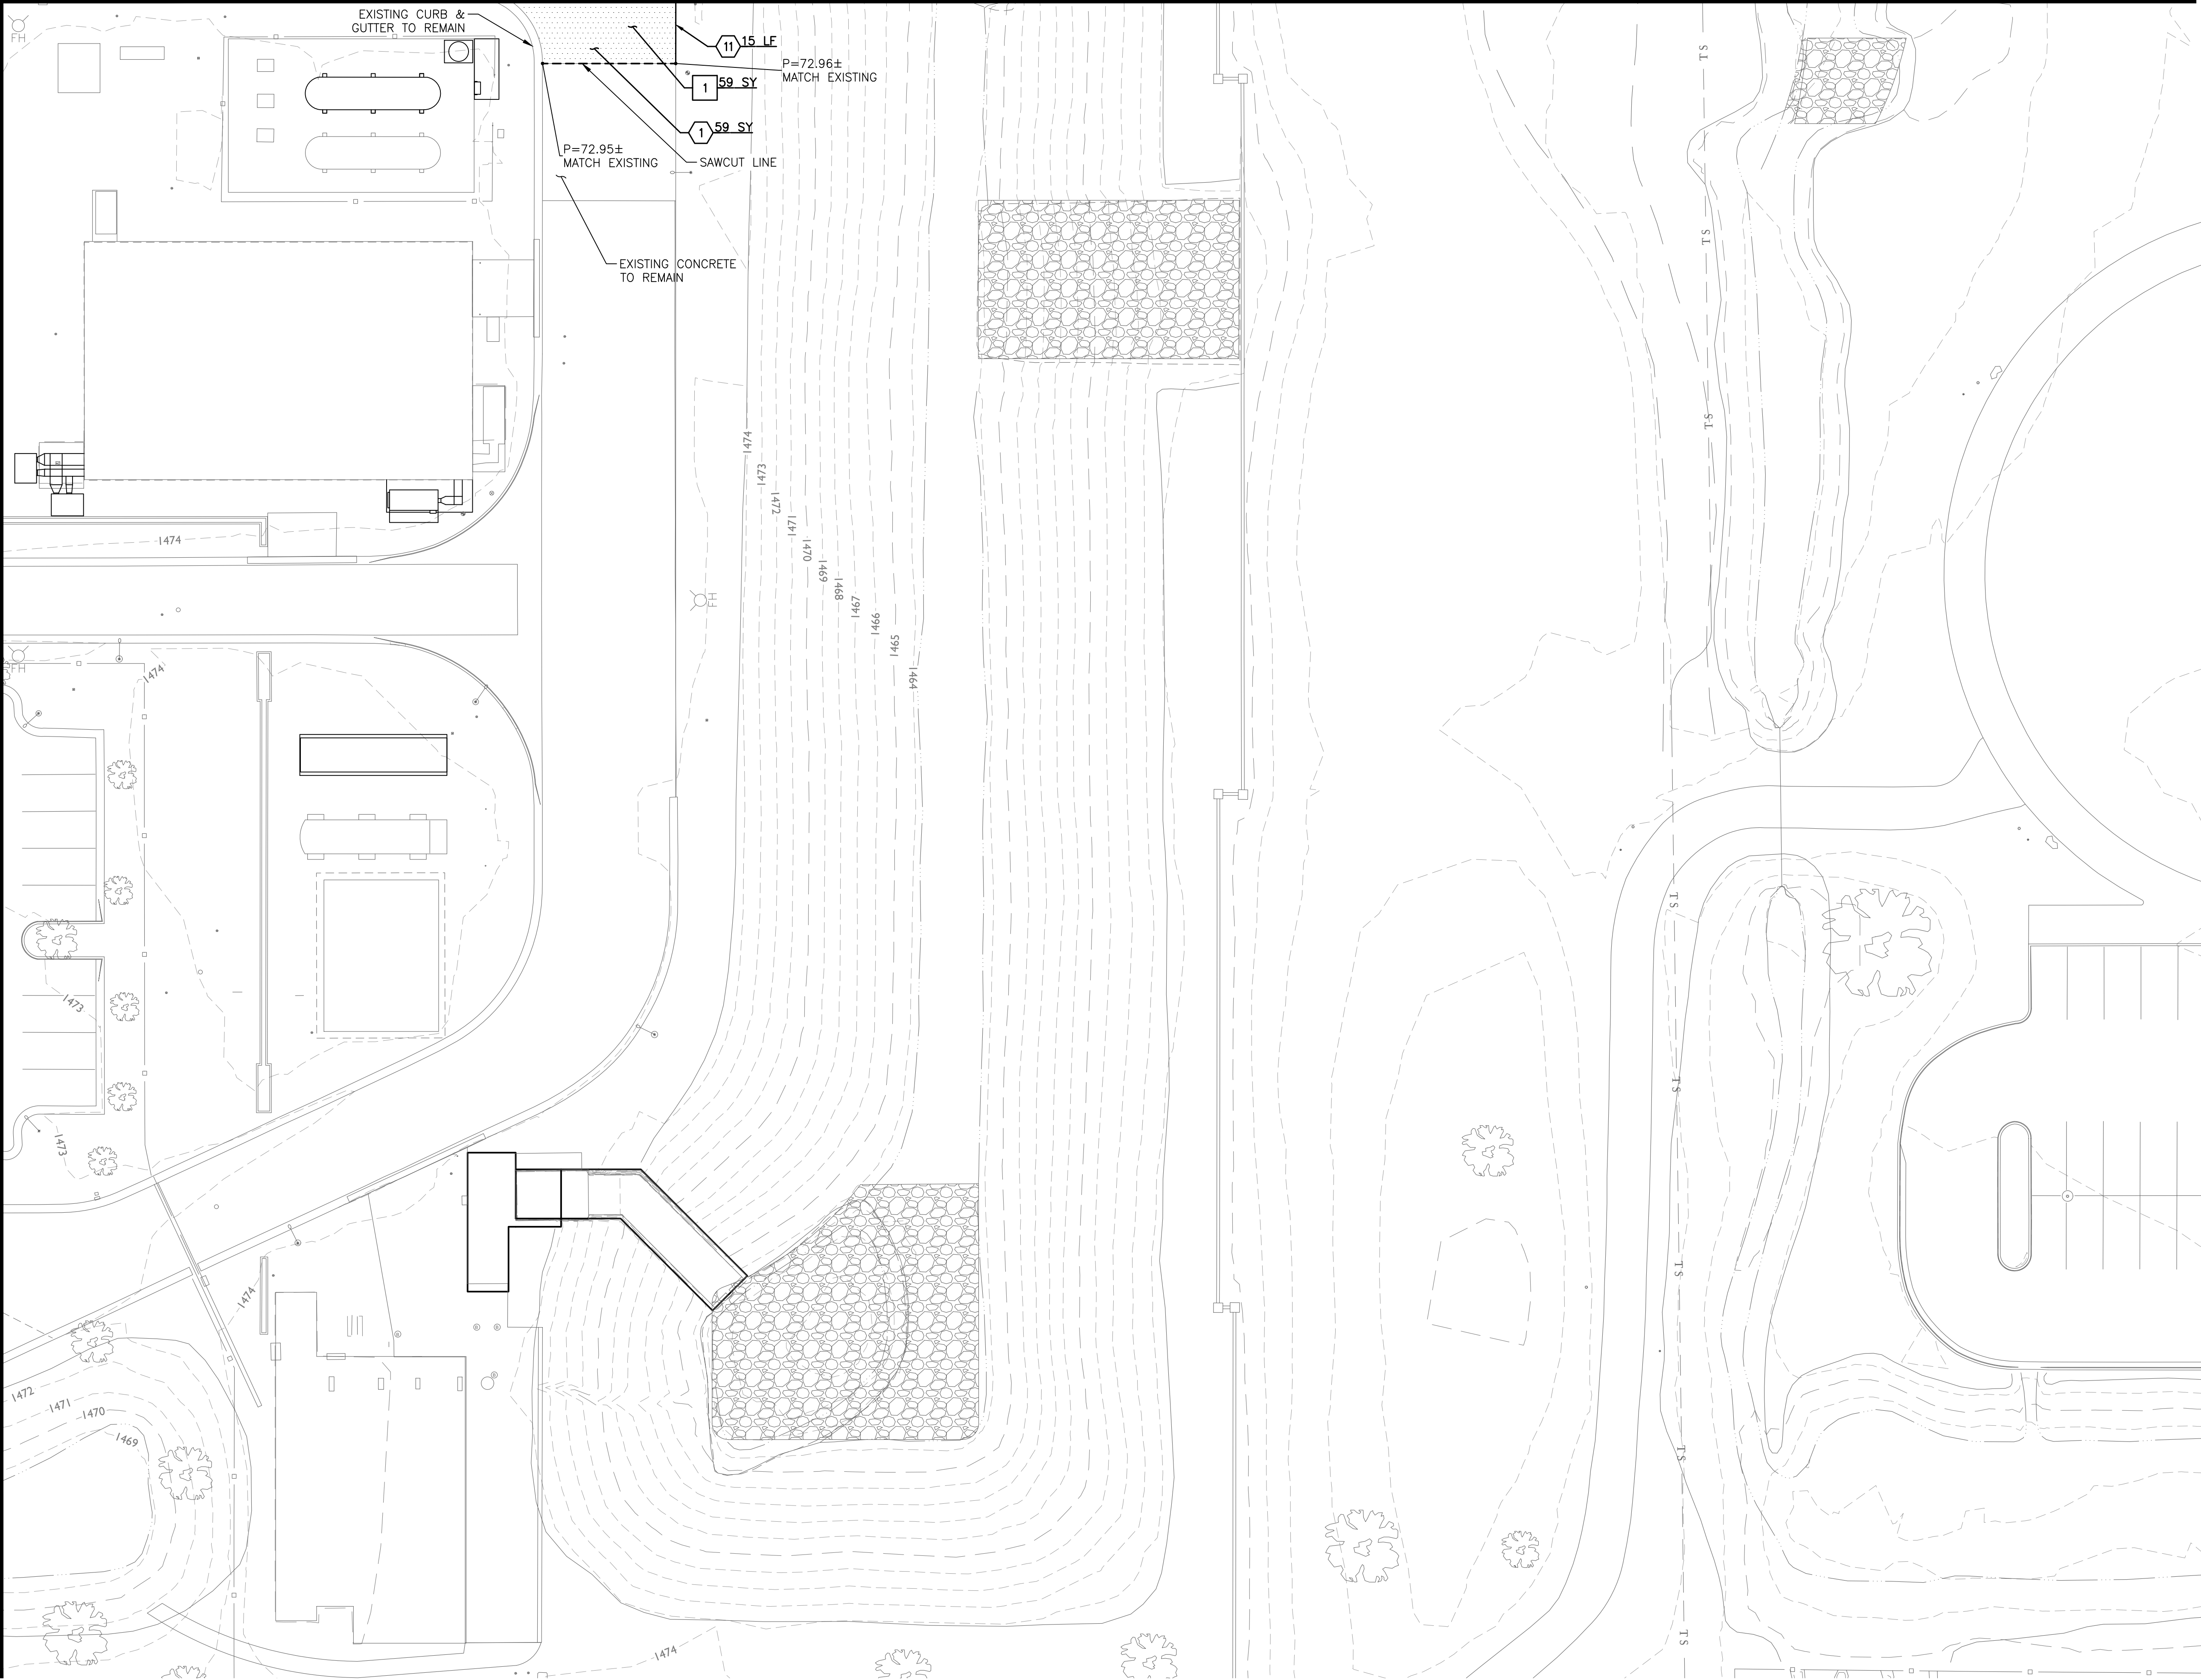

SCALE: 1" = 20' HORZ		 NORTH	BENCHMARK: BRASS TAG AT THE NW CORNER OF MERIDIAN & ELLIOT ROAD ELEVATION=1496.81 (C.O.M. DATUM)
ROADWAY			
1	Prepare Subgrade & Install 3" AC Pavement over 6" ABC per Structural Section #1		59 SY
11	Thickened Edge per MAG Detail 201, Type A		15 LF
REMOVALS			
1	Sawcut & Remove Existing AC Pavement		59 SY

PAVEMENT LEGEND

	3" AC ON 6" ABC
	6" PCCP ON 4" ABC

PLANNING & ZONING REVIEW



1130 N Alma School Road
Suite 120
Mesa, AZ 85201
T:480.503.2250 | F:480.503.2258
www.epsgroupinc.com



Preliminary Not For Construction Or Recording	CITY OF MESA ENGINEERING DEPARTMENT		
	SIGNAL BUTTE WATER TREATMENT PLANT		
	CIVIL GRADING & PAVING PLAN - AREA G10	DRAWING C-01-110	
	ACTIVITY: PROJ. NO.: CP0372	SHEET 12 of 28	CATALOG NUMBER:

Match Sheet C-01-107

SCALE: 1" = 20' HORZ




NORTH

BENCHMARK:
BRASS TAG AT THE NW CORNER OF
MERIDIAN & ELLIOT ROAD
ELEVATION=1496.81 (C.O.M. DATUM)

	STORM DRAIN	
	24" RGRCP or HDPE Storm Drain Pipe	345 LF
	Storm Drain Manhole per MAG Details 520 & 522	2 EA

Match Sheet C-01-104

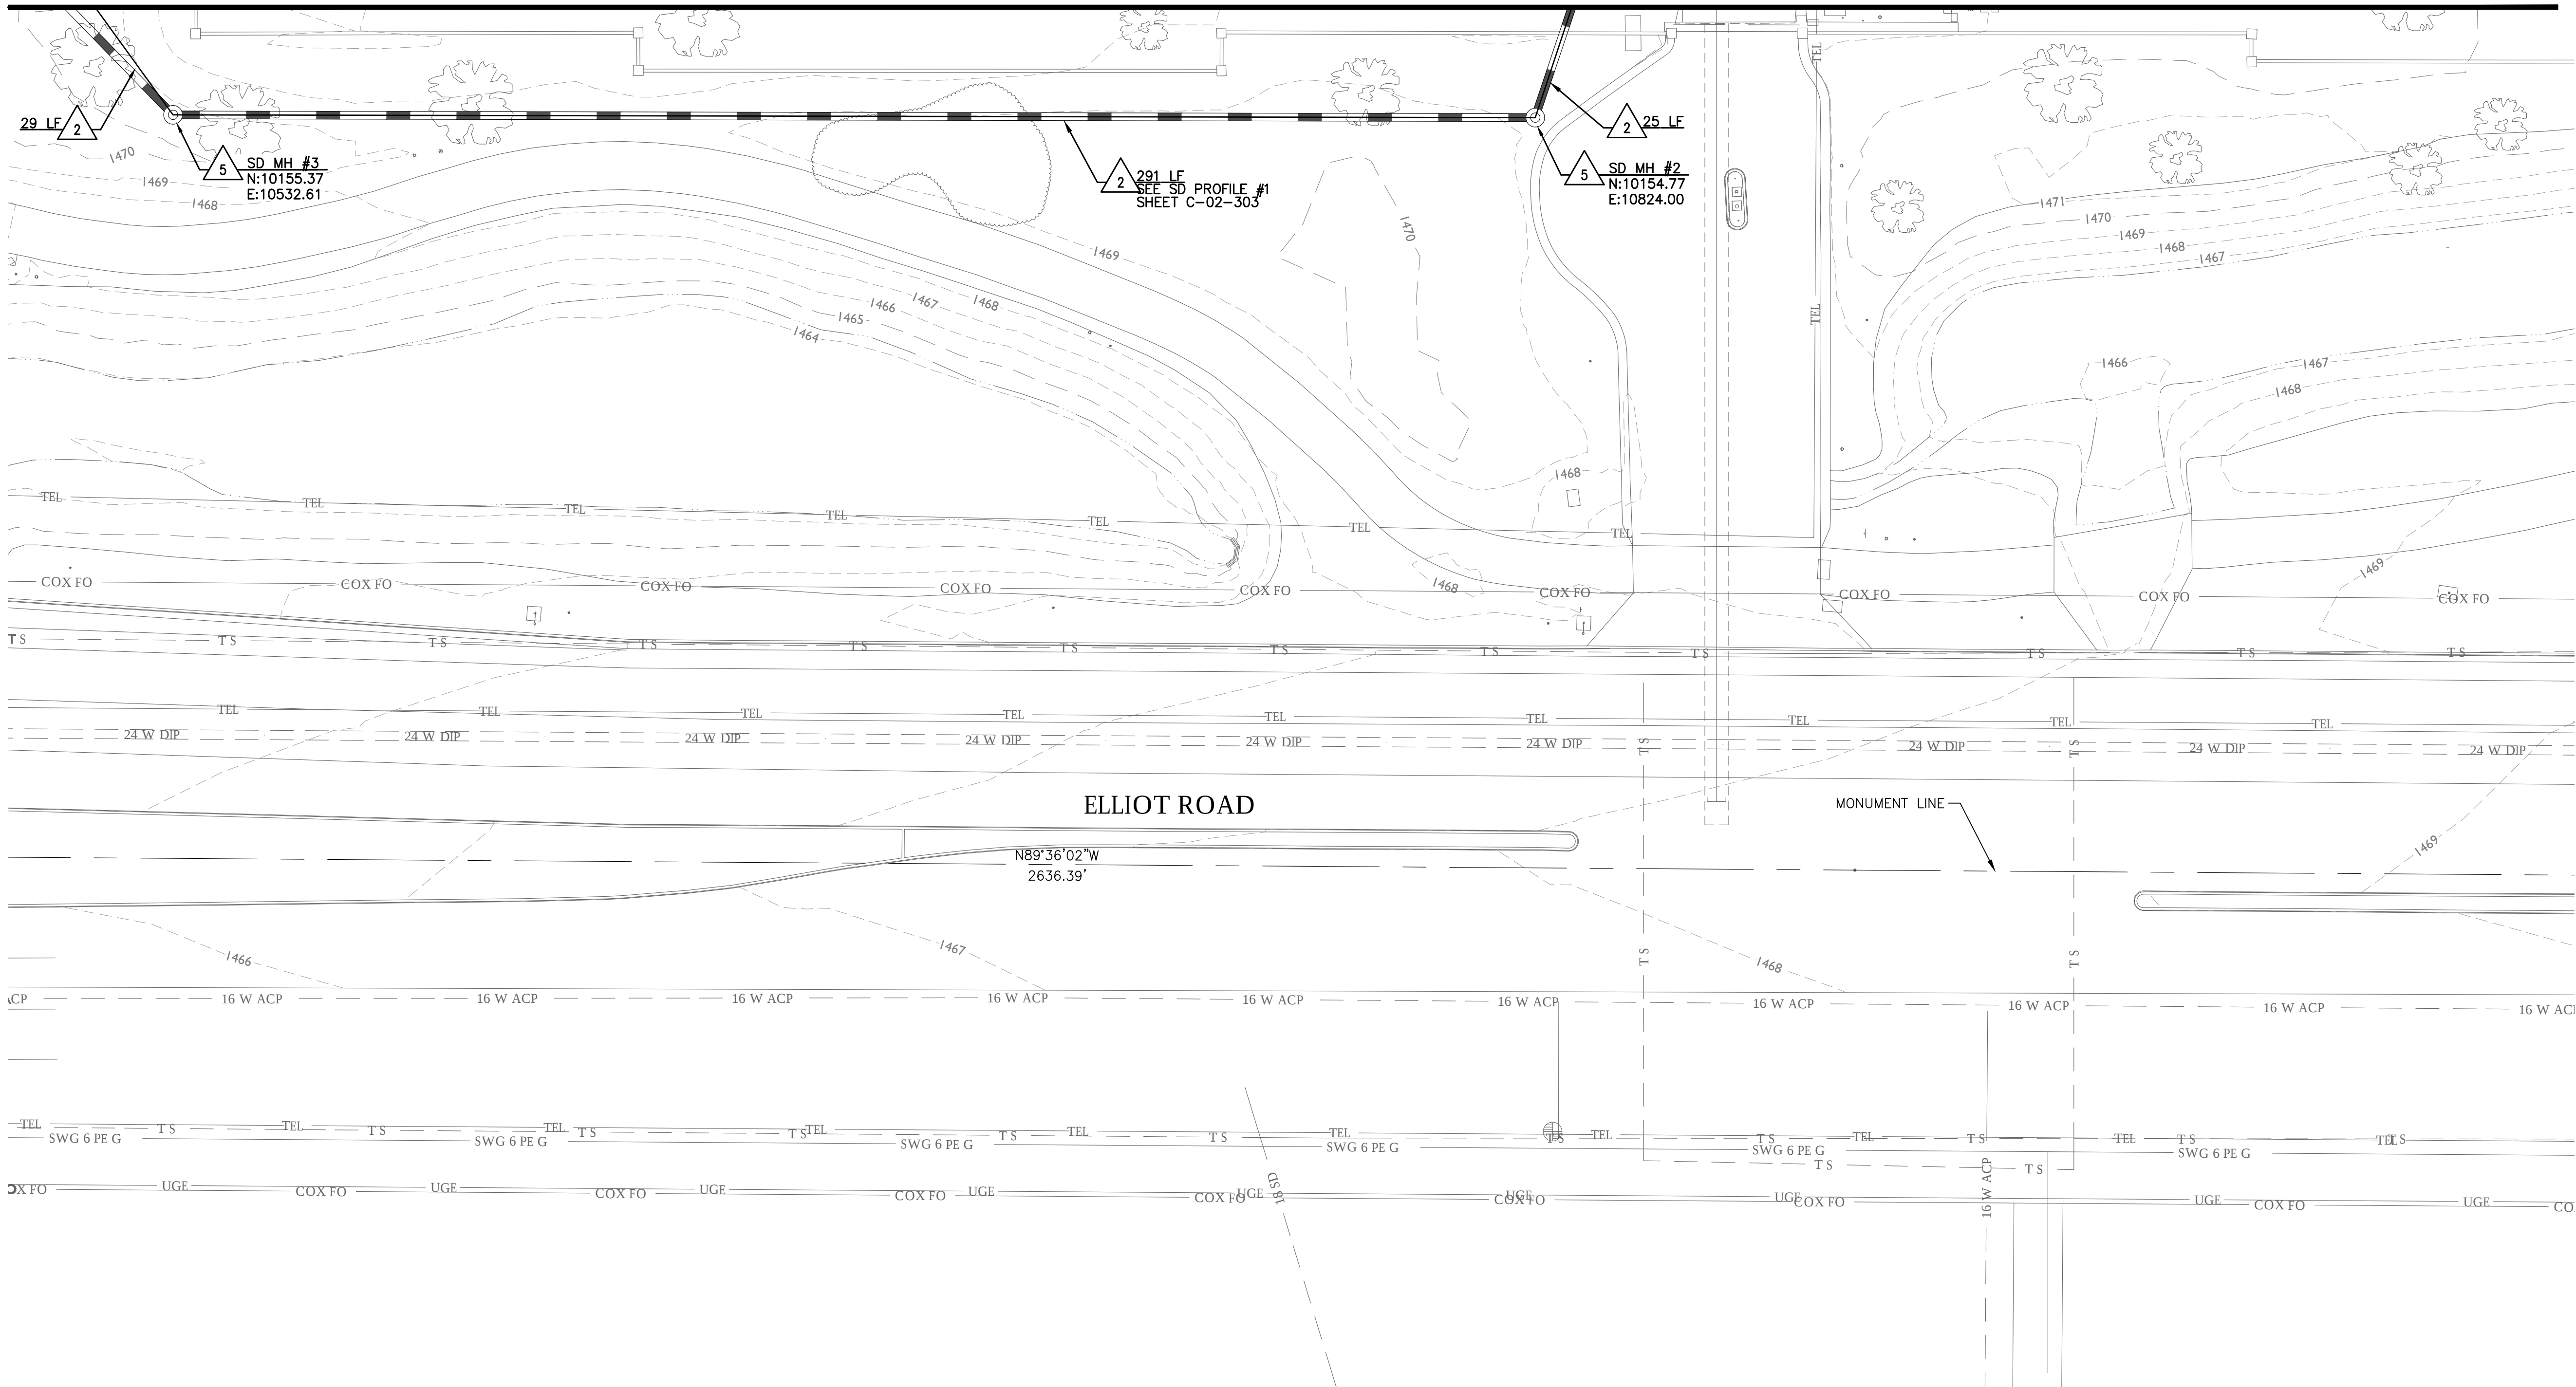



1130 N Alma School Road
Suite 120
Mesa, AZ 85201
T:480.503.2250 | F:480.503.2258
www.epsgroupinc.com

Call at least two full working days
before you begin excavation




ARIZONA 811
Arizona One Call, Inc.


Dial 8-1-1 or 1-800-STAKE-IT (782-5348)
in Maricopa County: (602)283-1100

60% Preliminary Not For Construction Or Recording	CITY OF MESA ENGINEERING DEPARTMENT	
	SIGNAL BUTTE WATER TREATMENT PLANT	
	CIVIL GRADING & PAVING PLAN - AREA G5	DRAWING C-01-105
DRAWN BY: RW ENGINEER: BJH APPROVED BY: BJH	SHEET 8 OF 26	CATALOG NUMBER:
ACTIVITY: PROJ. NO.: CP0372		


RESERVOIR STAIR ENCLOSURE
FIGURE 7

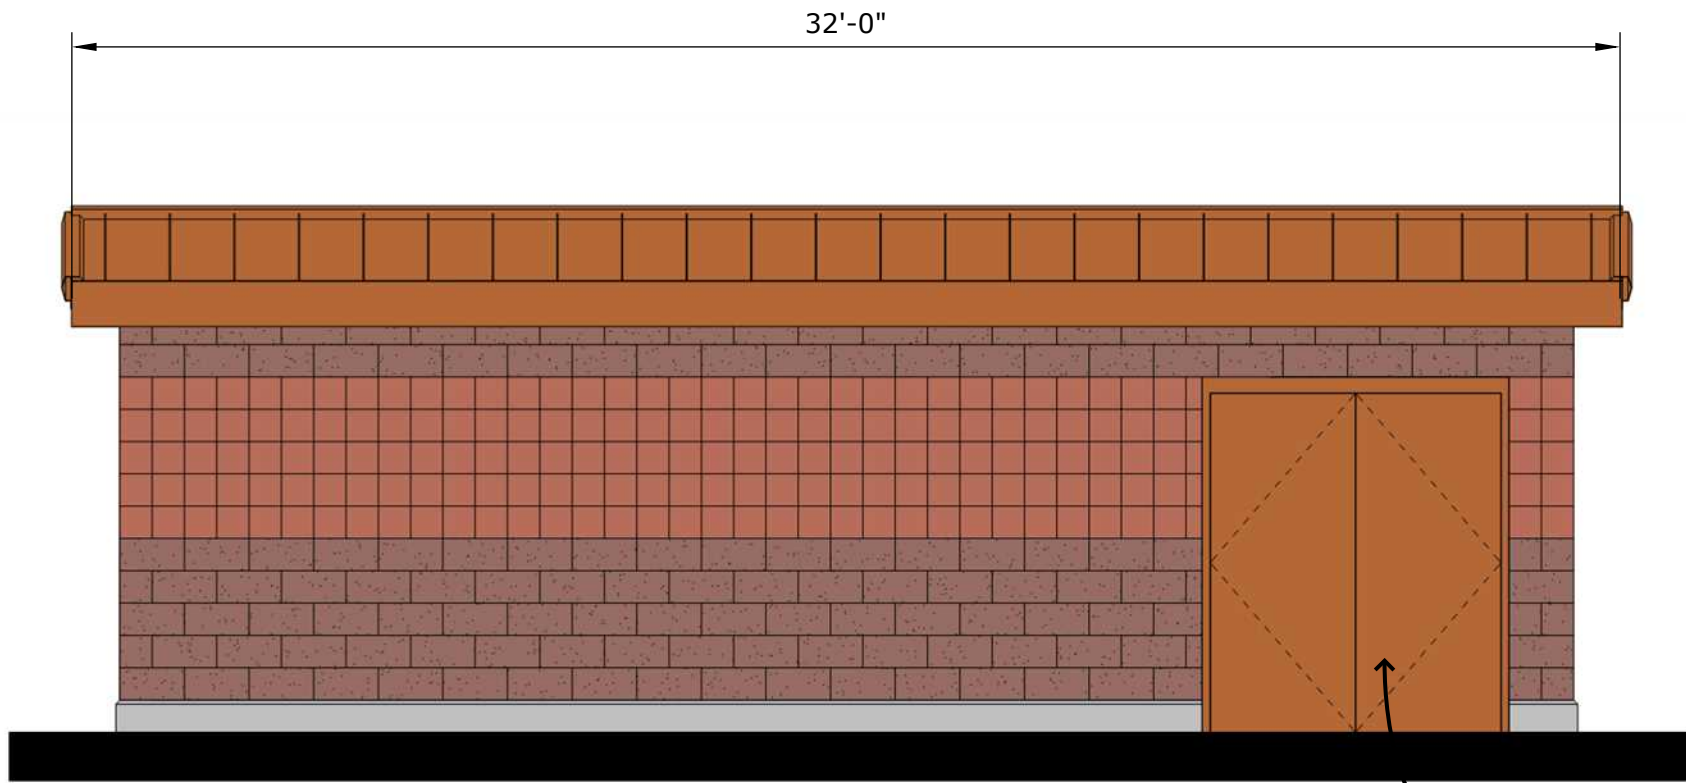


NORTH ELEVATION
Scale: 1/4" = 1'-0"

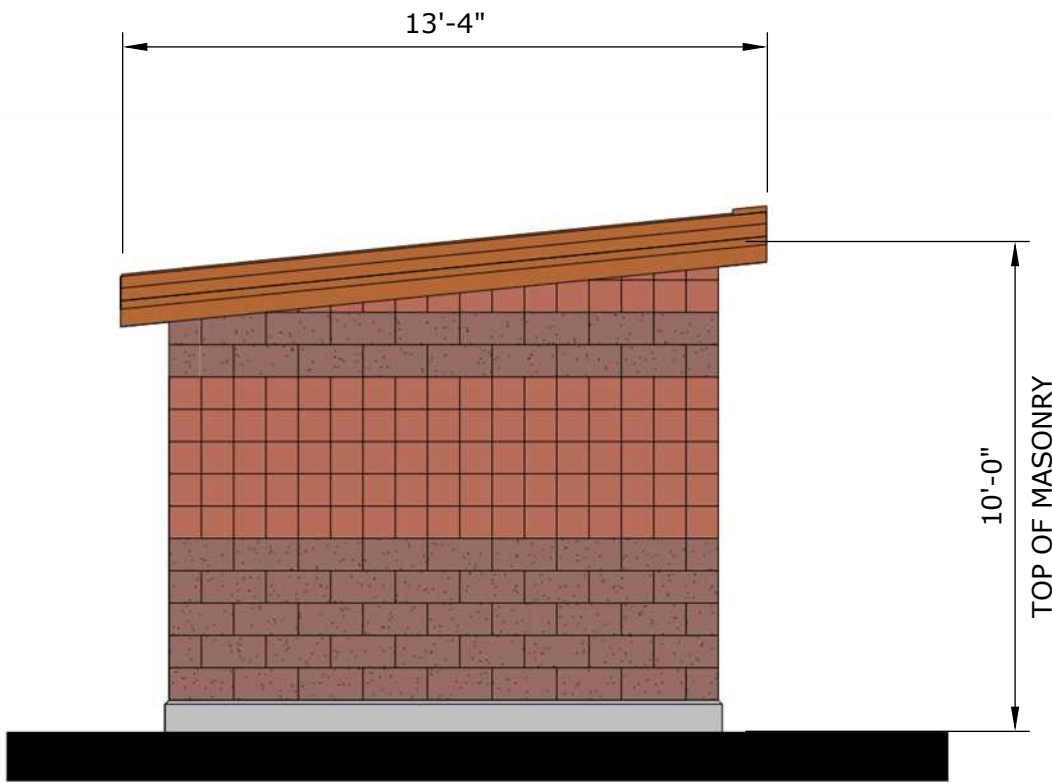

WEST ELEVATION
Scale: 1/4" = 1'-0"

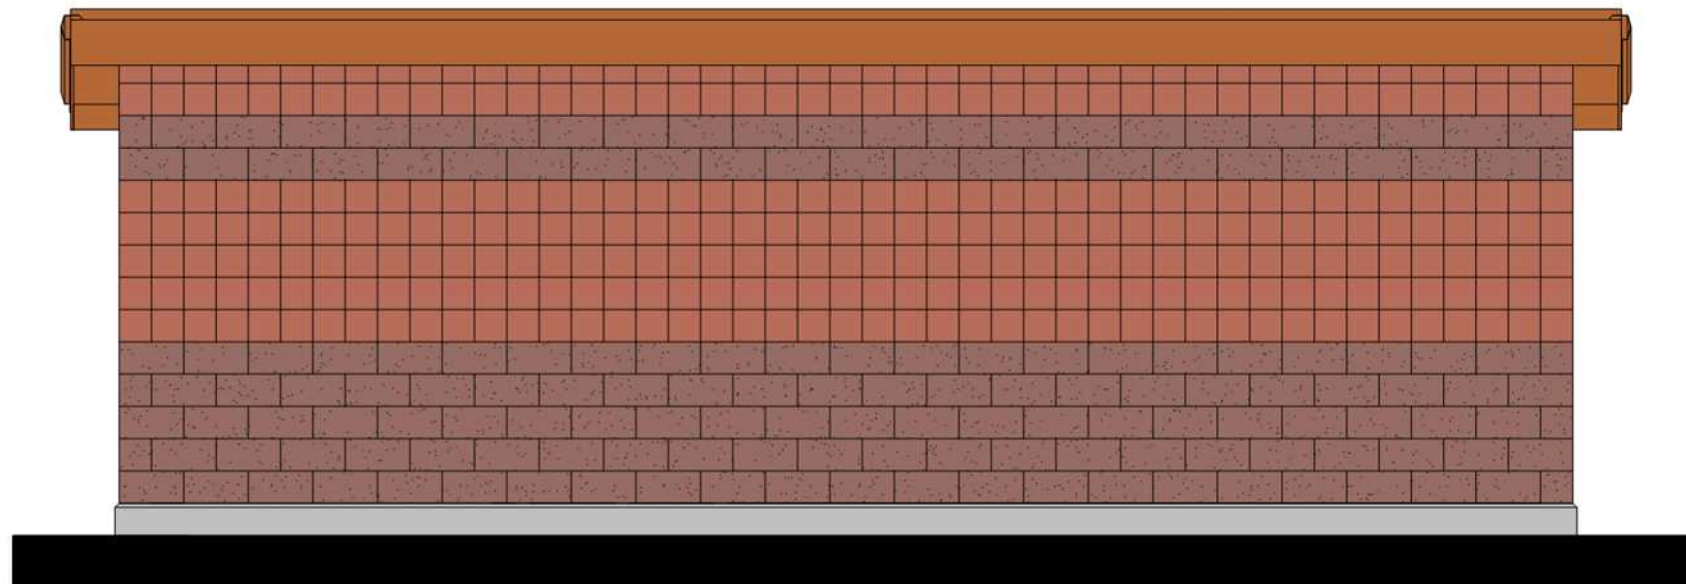

SOUTH ELEVATION
Scale: 1/4" = 1'-0"





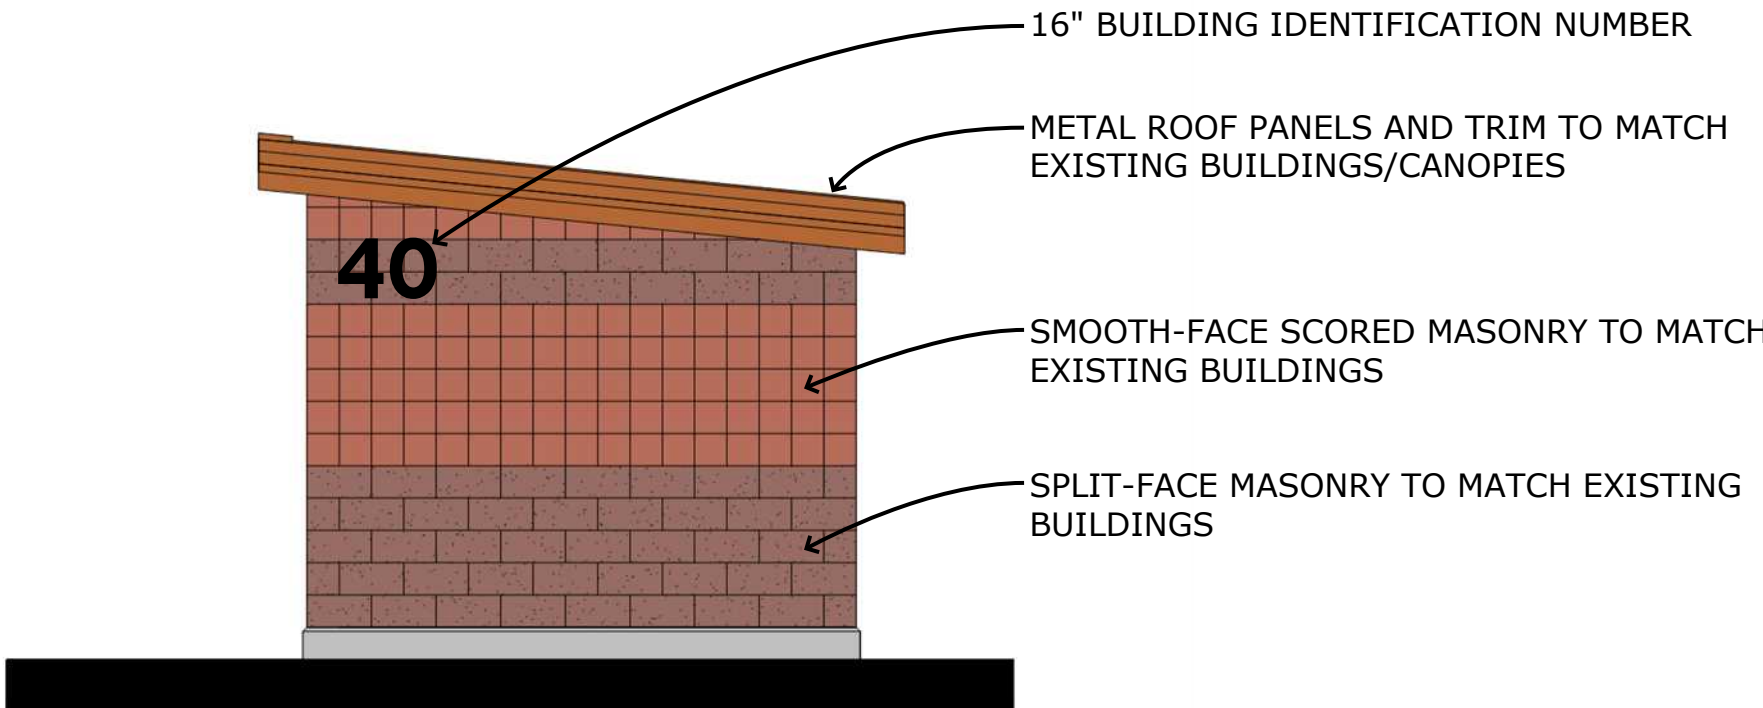



EAST ELEVATION
Scale: 1/4" = 1'-0"



PROPOSED STORAGE BUILDING
FIGURE 9

WALL MATERIAL QUANTITIES:	
29%	- ARCHITECTURAL METAL WALL PANELS (1,581 SF)
45%	- PRECAST WALL PANELS (2,493 SF)
03%	- CAST STONE ACCENT (158 SF)
23%	- KALWALL TRANSLUCENT WALL PANELS (1,265 SF)

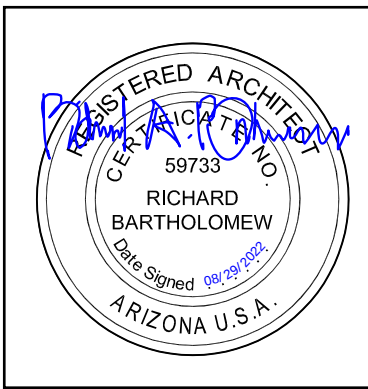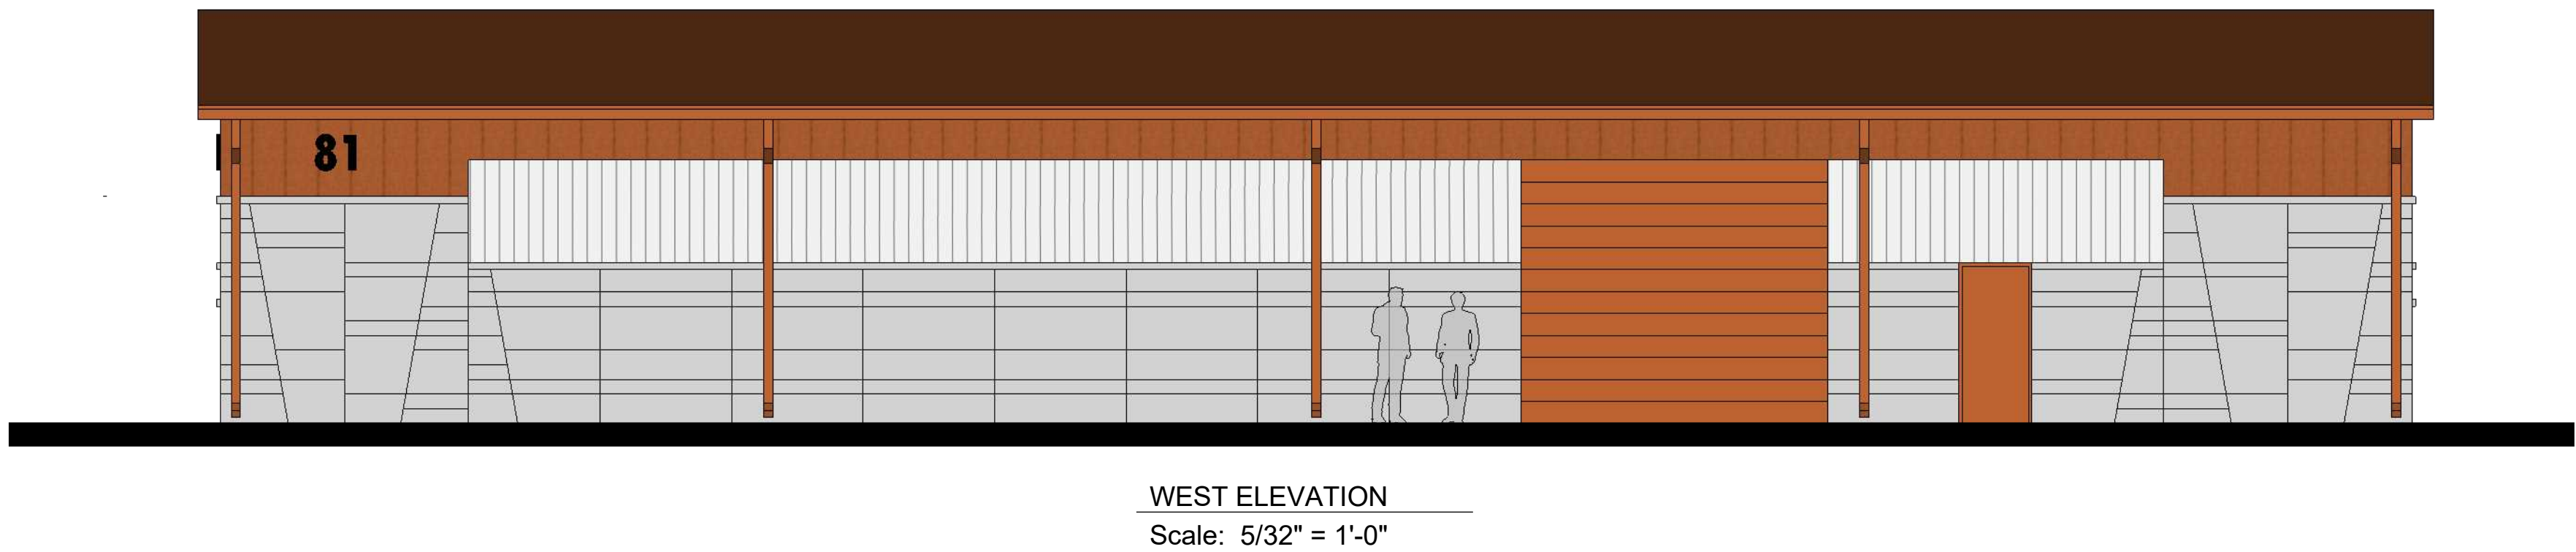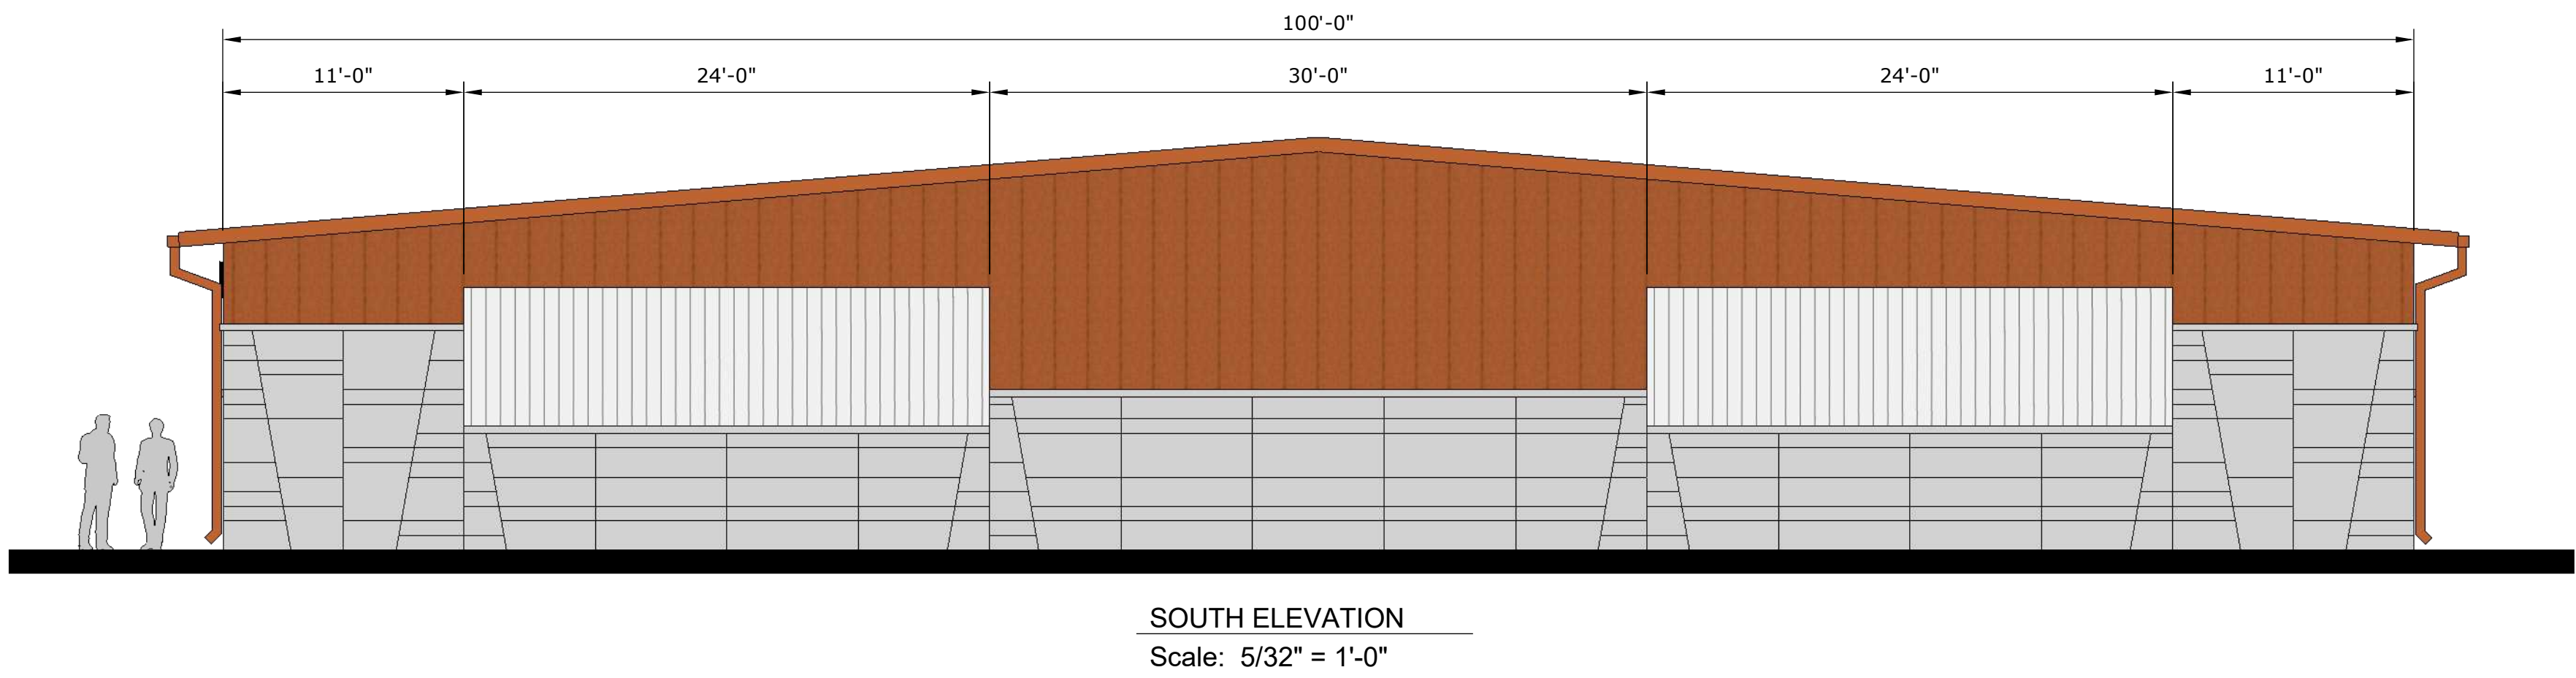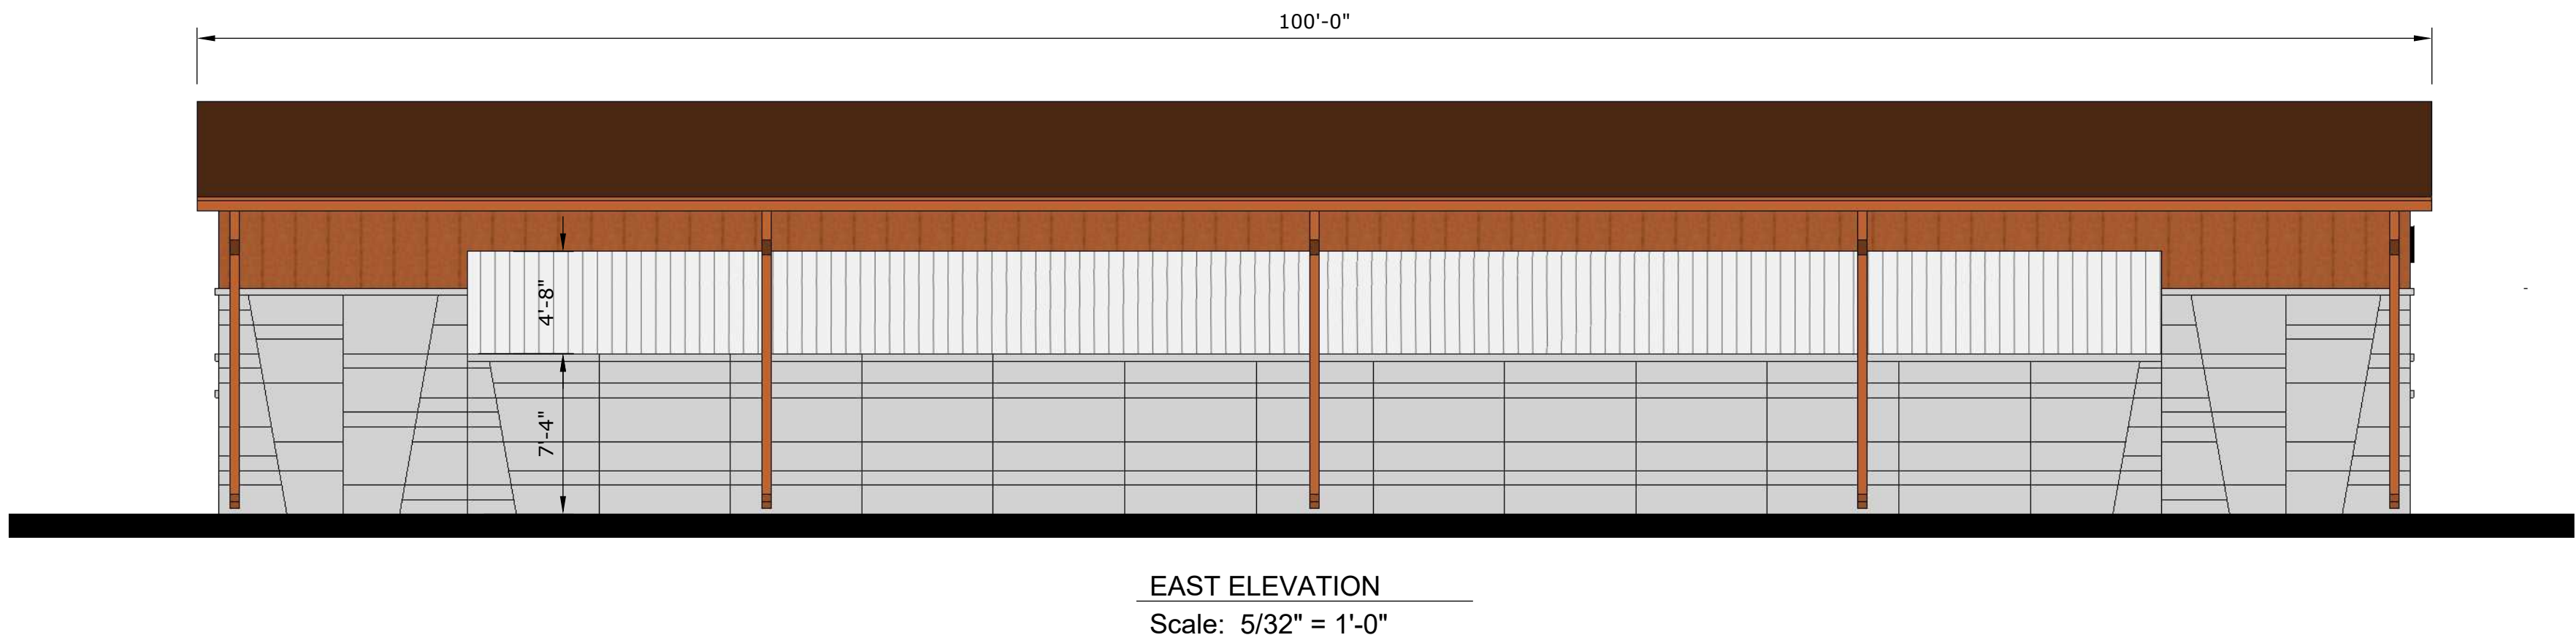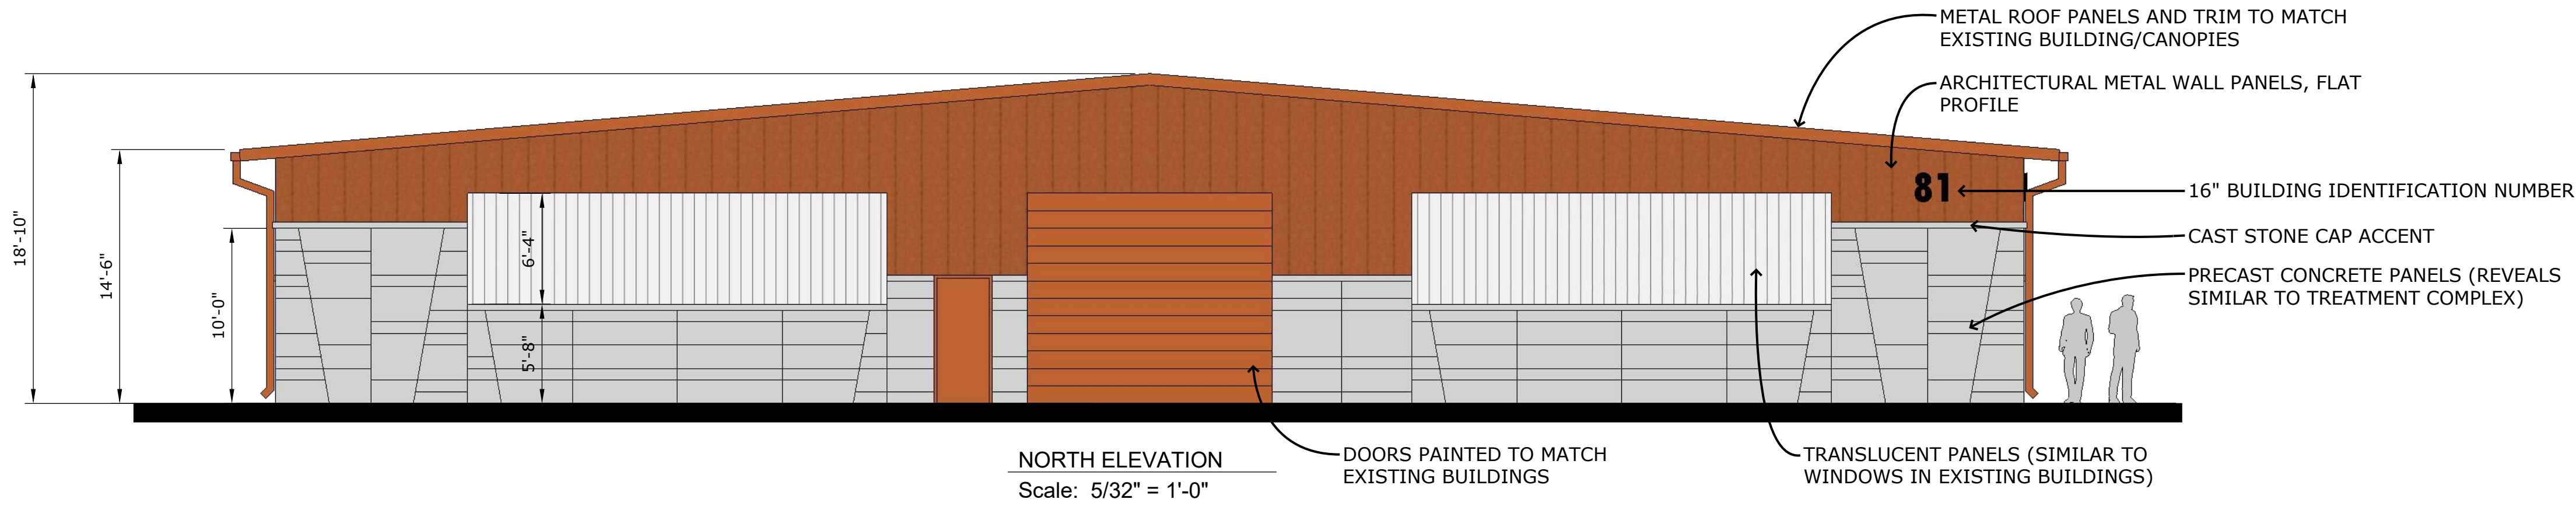

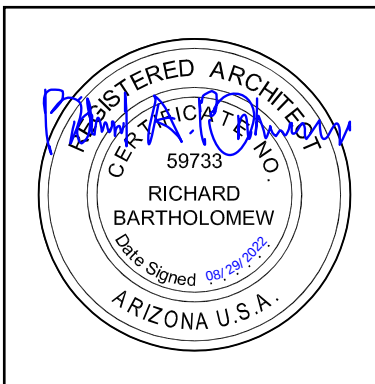

EXISTING BUILDING PHOTOS
FIGURE 11



Existing Filter Complex



Existing Operations Building





Existing Dewatering Building (typical façade treatment for all process buildings)



South Aerial View

TREATMENT COMPLEX EXPANSION
FIGURE 12

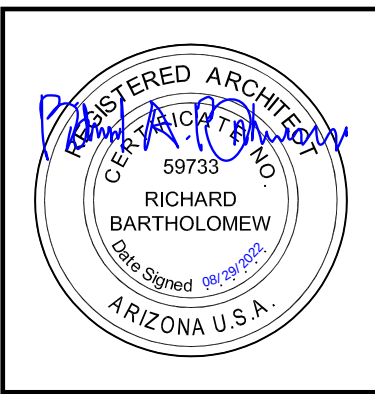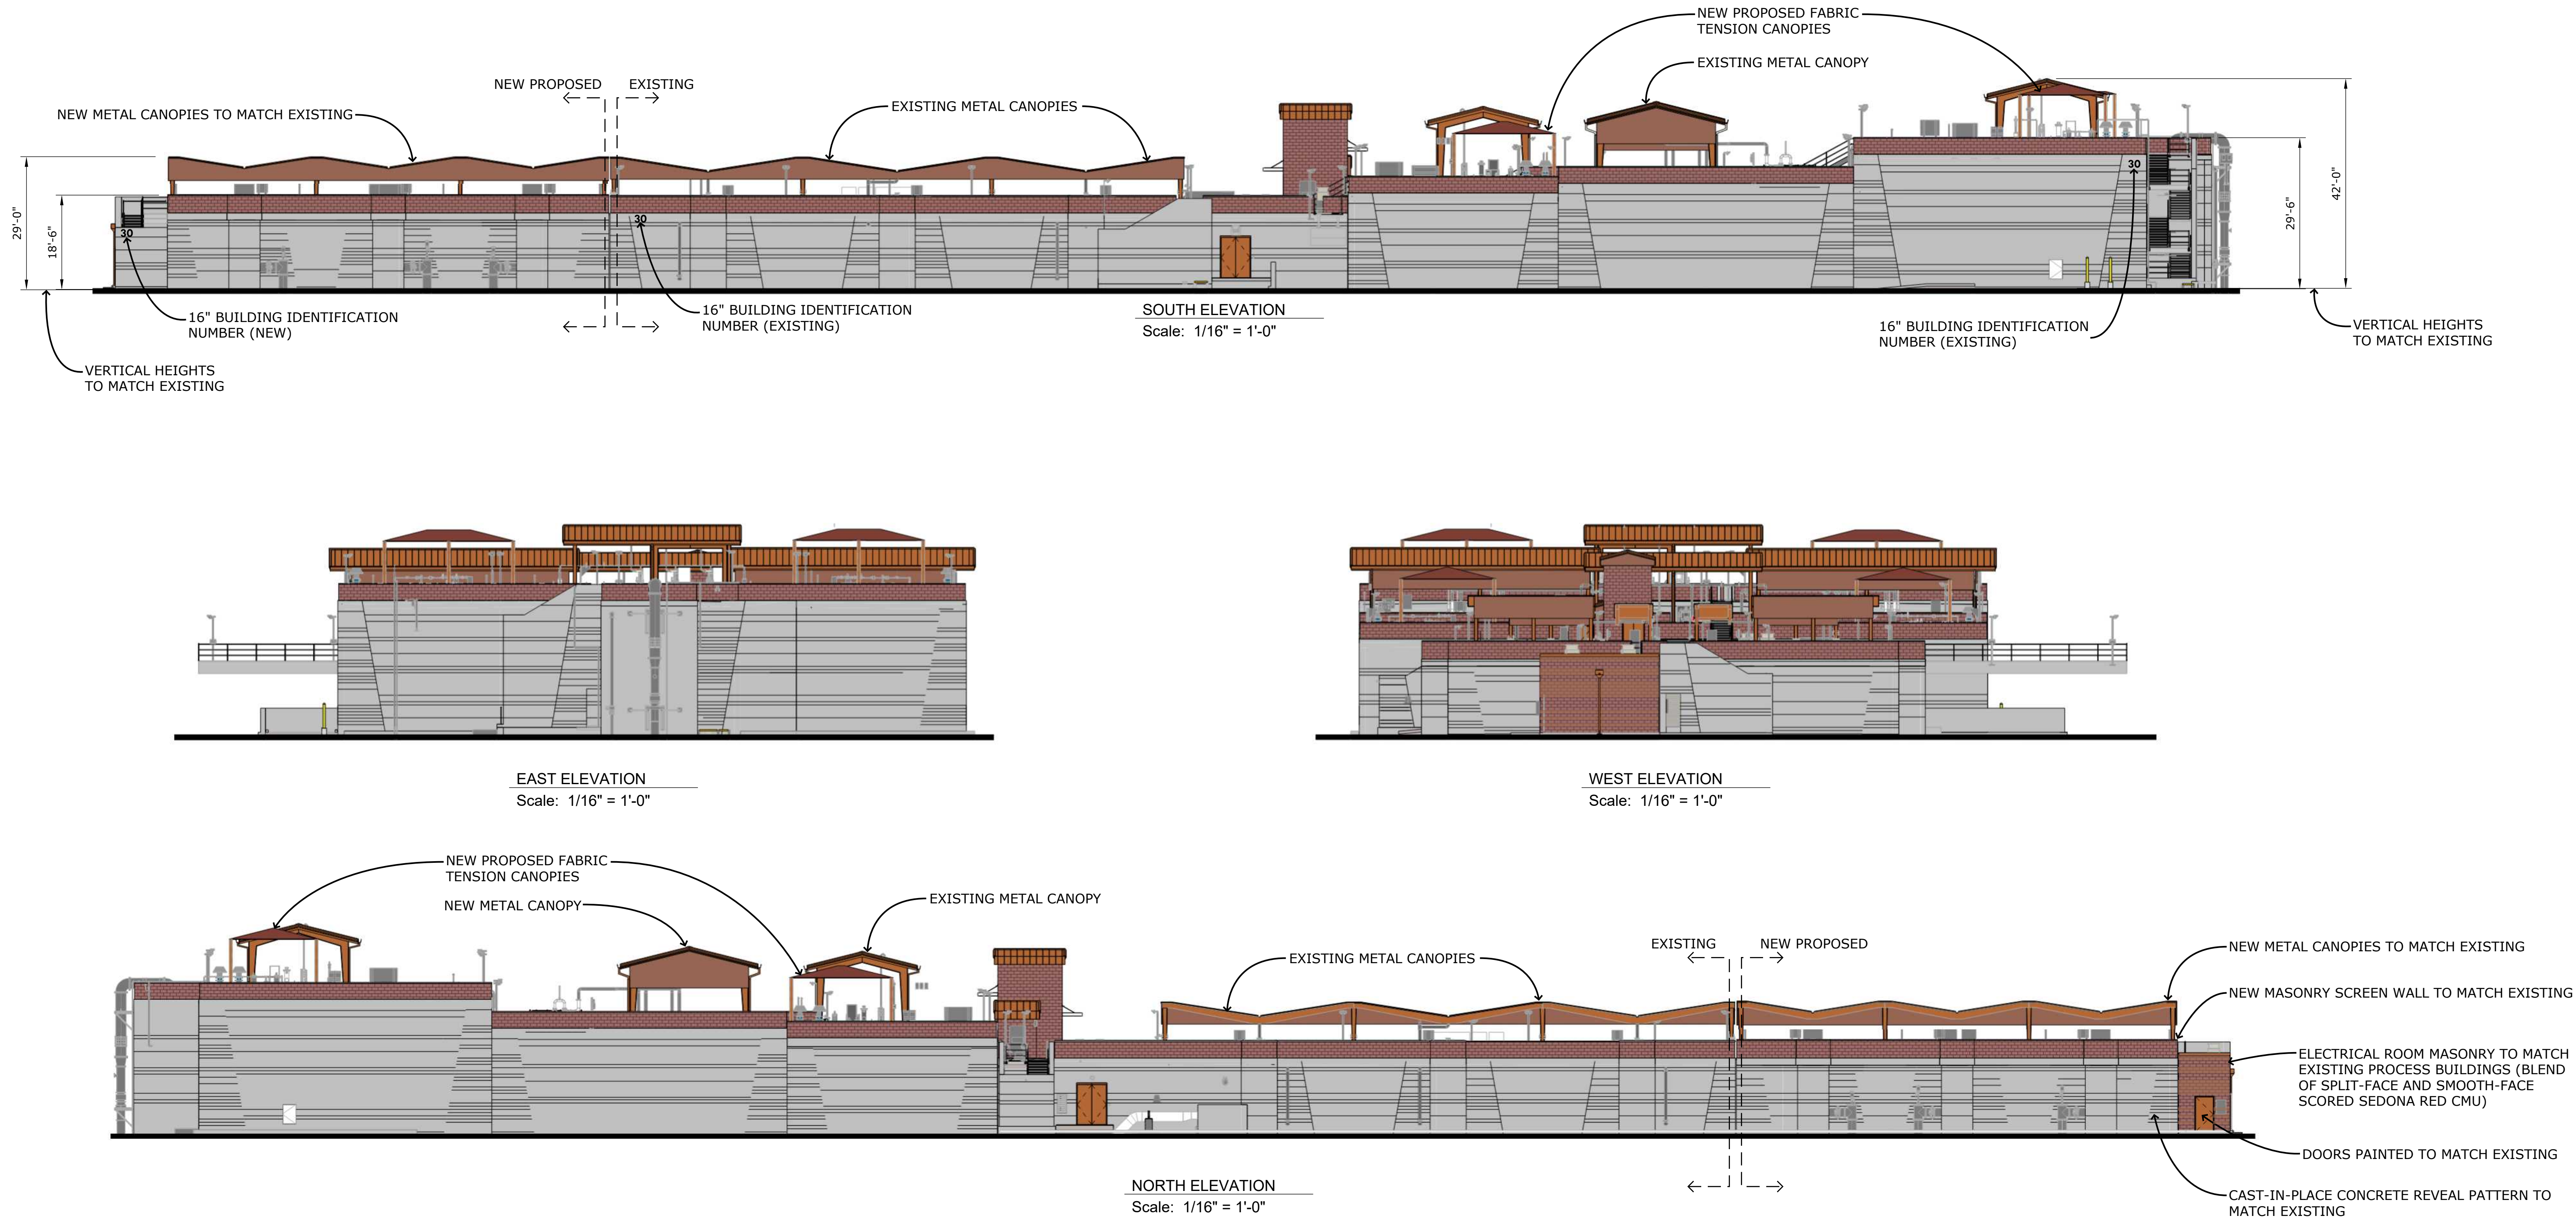

DRB SUBMITTAL

Citizen Participation Plan for Signal Butte Water Treatment Plant

Date: July 15, 2022

Purpose: The purpose of this Citizen Participation Plan is to inform citizens, property owners, neighborhood associations, agencies, and businesses in the vicinity of the site of an application for the City of Mesa Signal Butte Water Treatment Plant. The site is located at 10950 East Elliot Road near the northeast intersection of Elliot Road and Signal Butte Road. The water treatment plant is located within a 23.5 acre area and the Expansion project will expand the facilities within the masonry block site walls. This project includes the installation of non-occupiable structures, a buried finished water reservoir, and storage building. The site plan for this phase is required to be reviewed and approved by the Planning and Zoning Board, and Design Review Board. The Citizen Participation plan will ensure that those affected by this application will have an adequate opportunity to learn about and comment on the planned project.

Contact:

Reid Guzy & Michael Caruso

2231 East Camelback Road, Suite 250

Phoenix, AZ 85016

(602) 381-4441 & (602) 381-4407

Email: GuzyRB@bv.com & CarusoME@bv.com

Pre-Application Meeting:

The pre-application meeting with the City of Mesa Planning was held on 11/16/21. After continued project development, Staff reviewed the application on 7/11/22 and the city planning reviewer recommended a planning and submittal be created and all property owners, neighborhoods and business be contacted within 1,000 ft.

Action Plan:

In order to provide effective citizen participation in conjunction with the application, the following actions will be taken to provide opportunities to learn about and comment on the planned project. The Citizen Participation Plan includes:

1. A contact list will be developed for citizens, property owners, neighborhood associations, agencies, and businesses in this area including:
 - a. All applicable parties within a 1000 feet vicinity of the exterior boundary of the Signal Butte Water Treatment Plant property.

2. All identified residences and business listed on the contact list will receive a letter describing the project, project schedule, and site plan that is planned to be early the week of July 25, 2022. The attachment will provide the names and contact numbers for the City's Engineering Public Relations professionals.
3. The mailing list and map noting the location of the notified property owners, registered neighborhood associations, and businesses contacted will be provided to the Planning staff for inclusion in the case file.
4. The City's Engineering Public Relations professionals will keep a log of any comments received from citizens calling the Public Relations number provided in the attachment and how they were addressed. They will also provide copies of comment letters, petitions and other pertinent information if received from residents and other interested parties.
5. Other Citizen Participation opportunities will depend on the comments and interest received.

Schedule:

Pre-Application meeting – 11/16/2021

Follow-up Application meeting – 7/11/22

P&Z Application Submittal – 7/15/22

Notification mailers sent – 7/25/22

Submittal of Citizen Participation Report and Notification materials – 9/28/2022

Planning and Zoning Board Hearing – 10/12/2022



**Citizen Participation Plan Report
For the
City of Mesa Signal Butte Water Treatment Plant Expansion Ph II**

Date
10/18/2022

Purpose

We are pleased to report on the implementation of this Citizen Participation Plan is to inform citizens, property owners, neighborhood associations, agencies, and businesses in the vicinity of the site of an application for the City of Mesa Signal Butte Water Treatment Plant. The site is located at 10950 East Elliot Road near the northeast intersection of Elliot Road and Signal Butte Road. The water treatment plant is located within a 23.5-acre area and the Expansion project will expand the facilities within the masonry block site walls. This project includes the installation of non-occupiable structures, a buried finished water reservoir, and storage building. The site plan for this phase is required to be reviewed and approved by the Planning and Zoning Board. This report demonstrates how residents, property and business owners in this area had an adequate opportunity to learn about and comment on the proposed facility.

Contact

Jennifer Donahue, Supervising Engineer
City of Mesa, Engineering Department 20
E Main St, 5th Floor
Mesa, Arizona 85211
(480) 644-5670 | jennifer.donahue@mesaaz.gov

Pre-Submittal Meeting

The pre-submittal meeting with City of Mesa planning staff for ZON22-00773 The pre-application meeting with the City of Mesa Planning was held on 11/16/21. After continued project development, Staff reviewed the application on 7/11/22 and the city planning reviewer recommended a planning and submittal

Action Plan

In order to provide effective citizen participation in conjunction with the application, the following actions will be taken to provide opportunities to learn about and comment on the planned project.

1. A contact list will be developed for citizens, property owners, neighborhood associations, agencies, and businesses in this area including:
 - a. All applicable parties within a 1,200 feet vicinity of the exterior boundary of the Signal Butte Water Treatment Plant property.
2. All identified residences and business listed on the contact list will receive a letter describing the project, project schedule, and site plan on October 11, 2022. The attachment will provide the names and contact numbers for the City's Engineering Public Relations professionals.
3. The mailing list and map noting the location of the notified property owners, registered neighborhood associations, and businesses contacted will be provided to the Planning staff for inclusion in the case file.
4. The City's Engineering Public Relations professionals will keep a log of any comments received from citizens calling the Public Relations number provided in the attachment and how they were addressed. They will also provide copies of comment letters, petitions and other pertinent information if received from residents and other interested parties.
5. Other Citizen Participation opportunities will depend on the comments and interest received.

10/06/2022

Dear Neighbor,

We have applied for a **Planning and Zoning Board Hearing** for the property located at **10950 Rd. Mesa, AZ 85201**. This request is for a site plan review of the **City of Mesa Signal Butte Water Treatment Plant Expansion Ph II**. The case number assigned to this project is **ZON22-00773**.

This letter is being sent to all property owners within 1,000 feet of the property at the request of the City of Mesa Planning Division. Enclosed for your review is a copy of the site plan and elevations of the proposed development. This project is increase water production within the existing water treatment facility. If you have any questions regarding this proposal, please call me at **(480)-644-3800** or e-mail me at Engineering.Info@MesaAZ.gov.

This application will be scheduled for consideration by the Mesa Planning and Zoning Board at their meeting held on **Wednesday, October 26, 2022** in the City Council Chambers located at 57 East First Street. The meeting will begin at 4:00 p.m. You are invited to attend this meeting and provide any input you may have regarding this proposal.


The public can attend the meeting either in-person or electronically and telephonically. The live meeting may be watched on local cable Mesa channel 11, online at Mesa11.com/live or www.youtube.com/user/cityofmesa11/live, or listened to by calling **888-788-0099** or **877-853-5247 (toll free)** using meeting ID **530 123 2921** and following the prompts. If you want to provide a written comment or speak telephonically at the meeting, please submit an **online comment card** by scanning the QR code below or by visiting <https://www.mesaaz.gov/government/advisory-boards-committees/planning-zoning-board/online-meeting-comment-card> at least **1 hour prior to the start of the meeting**. If you want to speak at the meeting, you will need to indicate on the comment card that you would like to speak during the meeting, and you will need to call **888-788-0099** or **877-853-5247 (toll free)** using meeting ID **530 123 2921** and following the prompts, prior to the start of the meeting. You will be able to listen to the meeting; and when the item you have indicated that you want to speak on is before the Board, your line will be taken off mute and you will be given an opportunity to speak.


For help with the online comment card, or for any other technical difficulties, please call 480-644-2099.

The City of Mesa has assigned this case to **Josh Grandlienard** of their Planning Division staff. He can be reached at **480-644-4691** or joshua.grandlienard@mesaaz.gov should you have any questions regarding the public hearing process. If you have sold this property in the interim, please forward this correspondence to the new owner.

Sincerely,

Curt Albright, Public Relations Supervisor
City of Mesa - Engineering Department



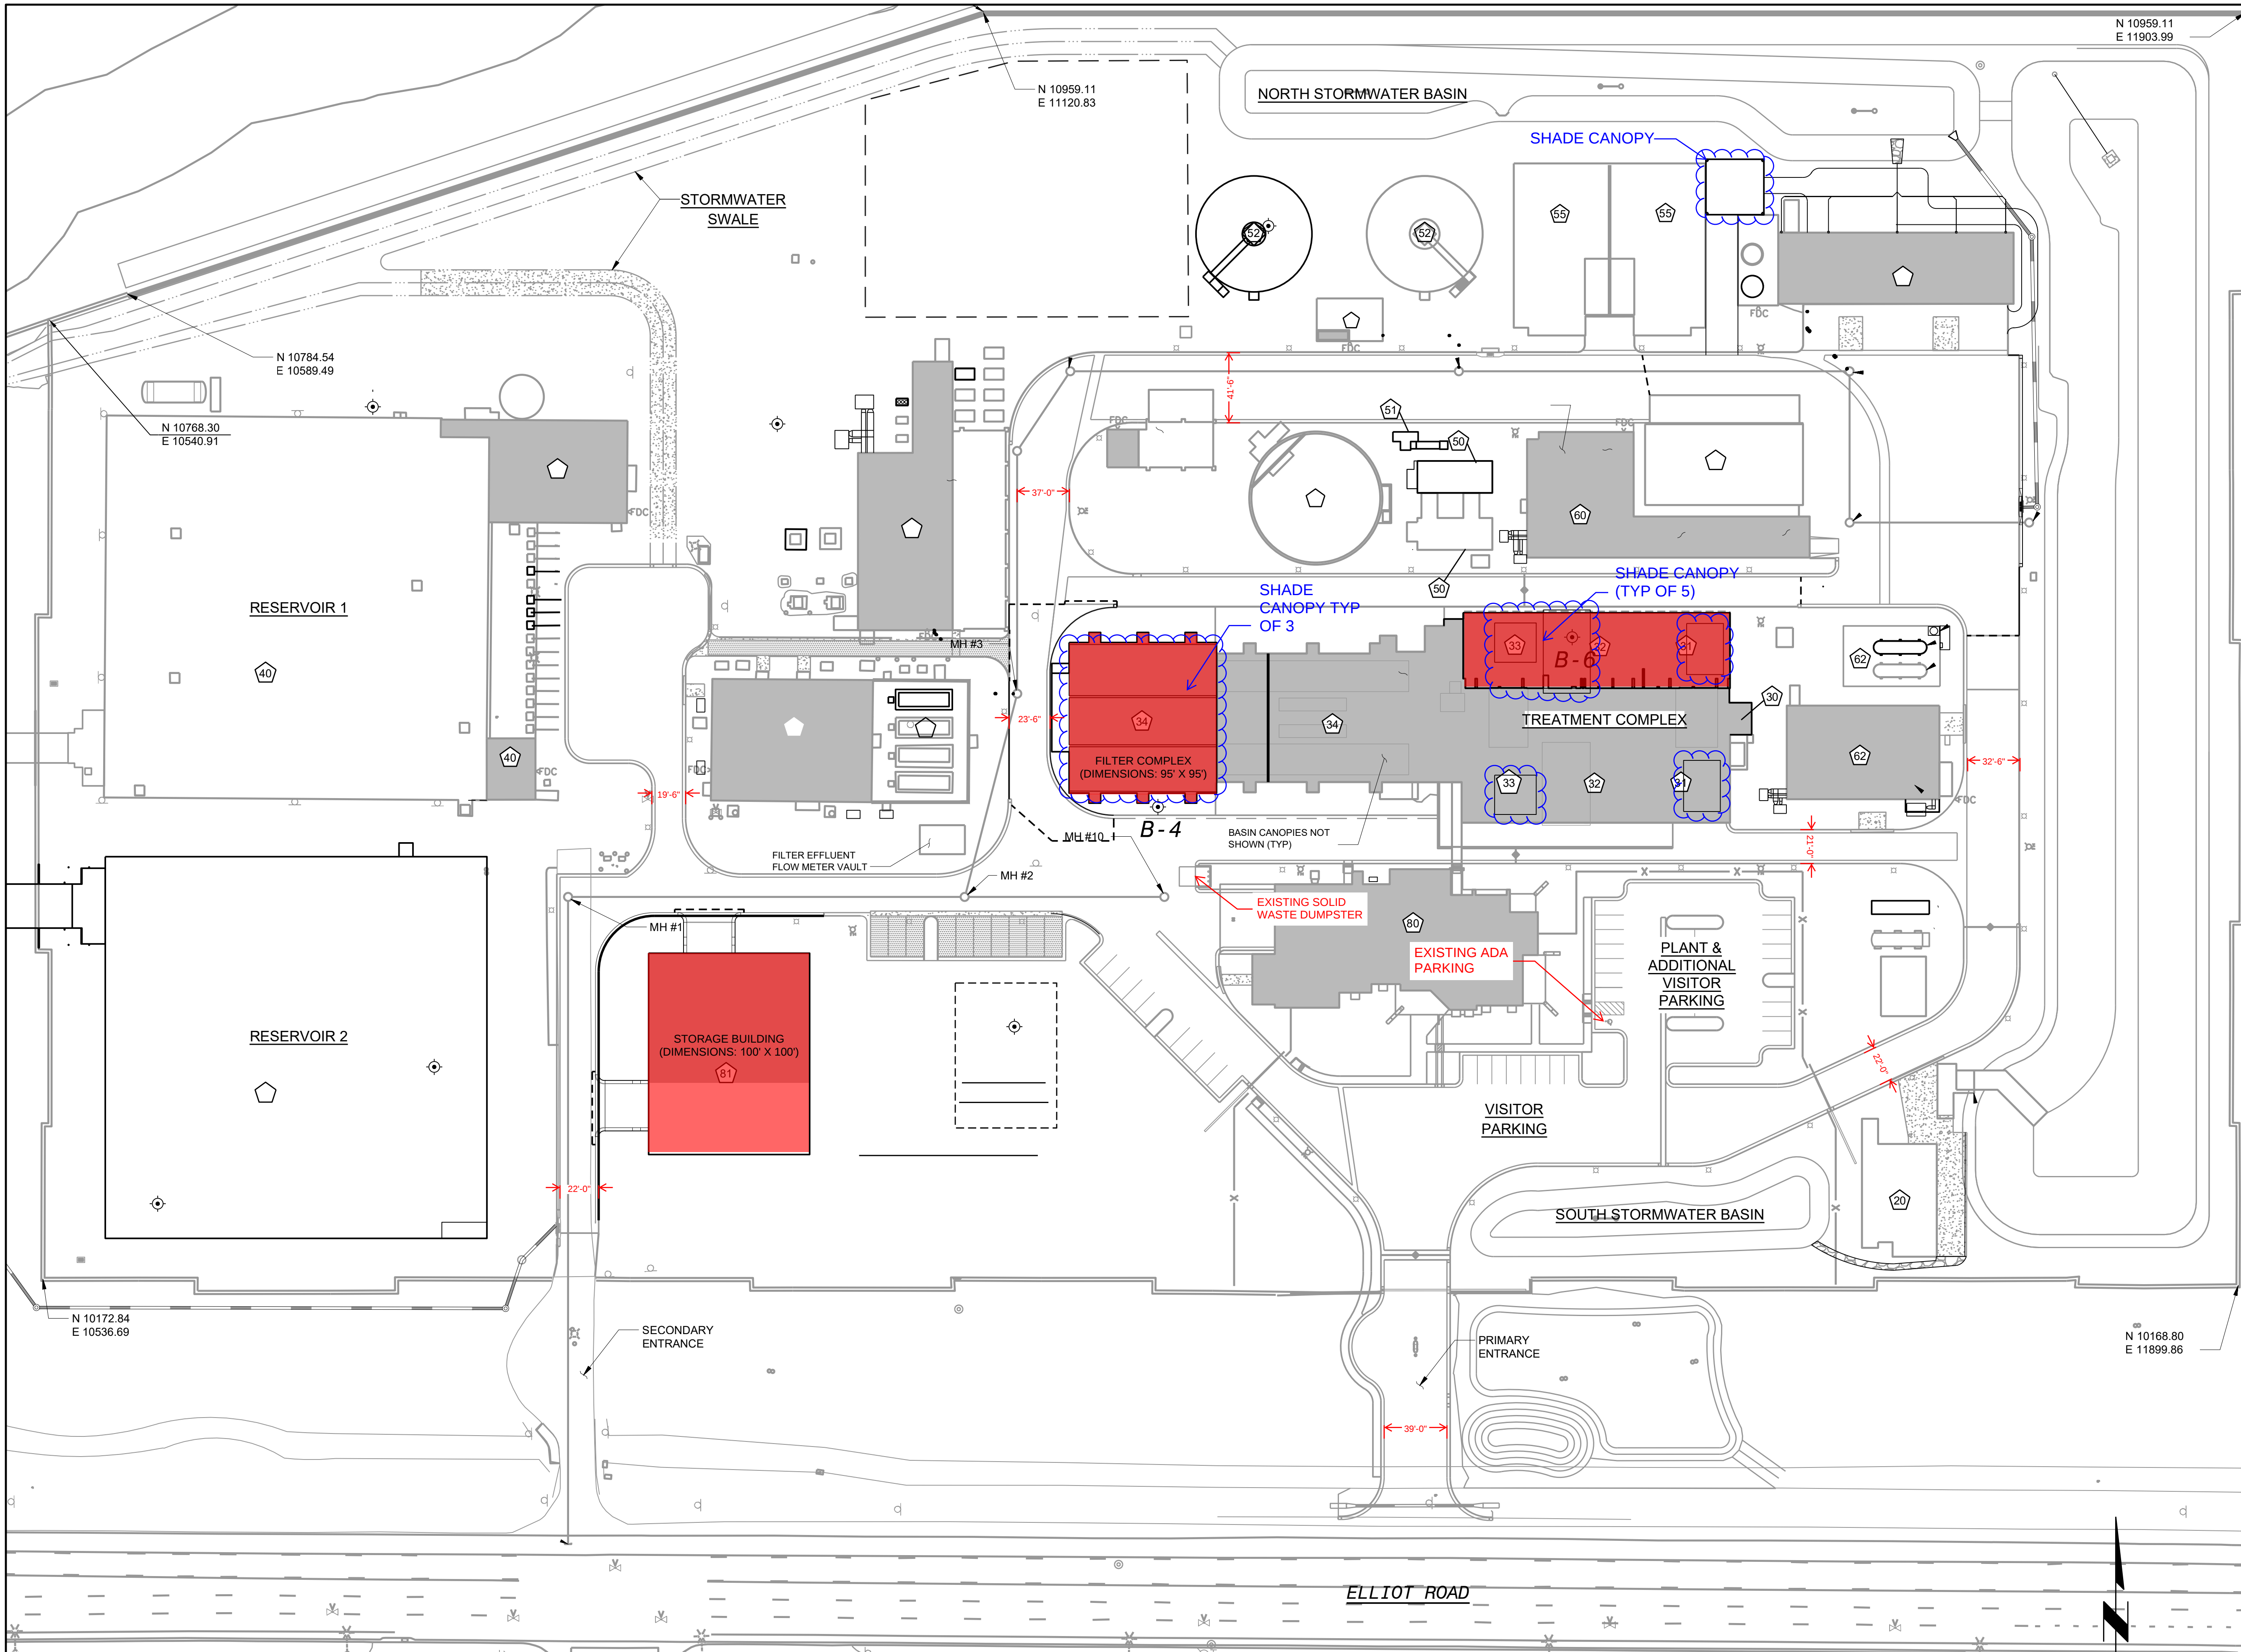

DATE	REVISIONS AND RECORD OF ISSUE	NO.	BY	CK	APP


ZONE HEARING

	CITY OF MESA ENGINEERING DEPARTMENT
	SIGNAL BUTTE WATER TREATMENT PLANT EXPANSION
	GENERAL OVERALL SITE PLAN FIGURE 2
DATE: SEPTEMBER 2022 DRAWN BY: ENGINEER: APPROVED BY:	G-00-102
ACTIVITY: PROJ NO.: CP0372	

PROPOSED STORAGE BUILDING

FIGURE 8

WALL MATERIAL QUANTITIES:	
28%	- ARCHITECTURAL METAL WALL PANELS (2,232 SF)
19%	- SPLIT-FACE CMU (1,527 SF)
23%	- SMOOTH-FACE SCORED CMU (1,854 SF)
02%	- CAST STONE ACCENT (158 SF)
28%	- KALWALL TRANSLUCENT WALL PANELS (2,293 SF)

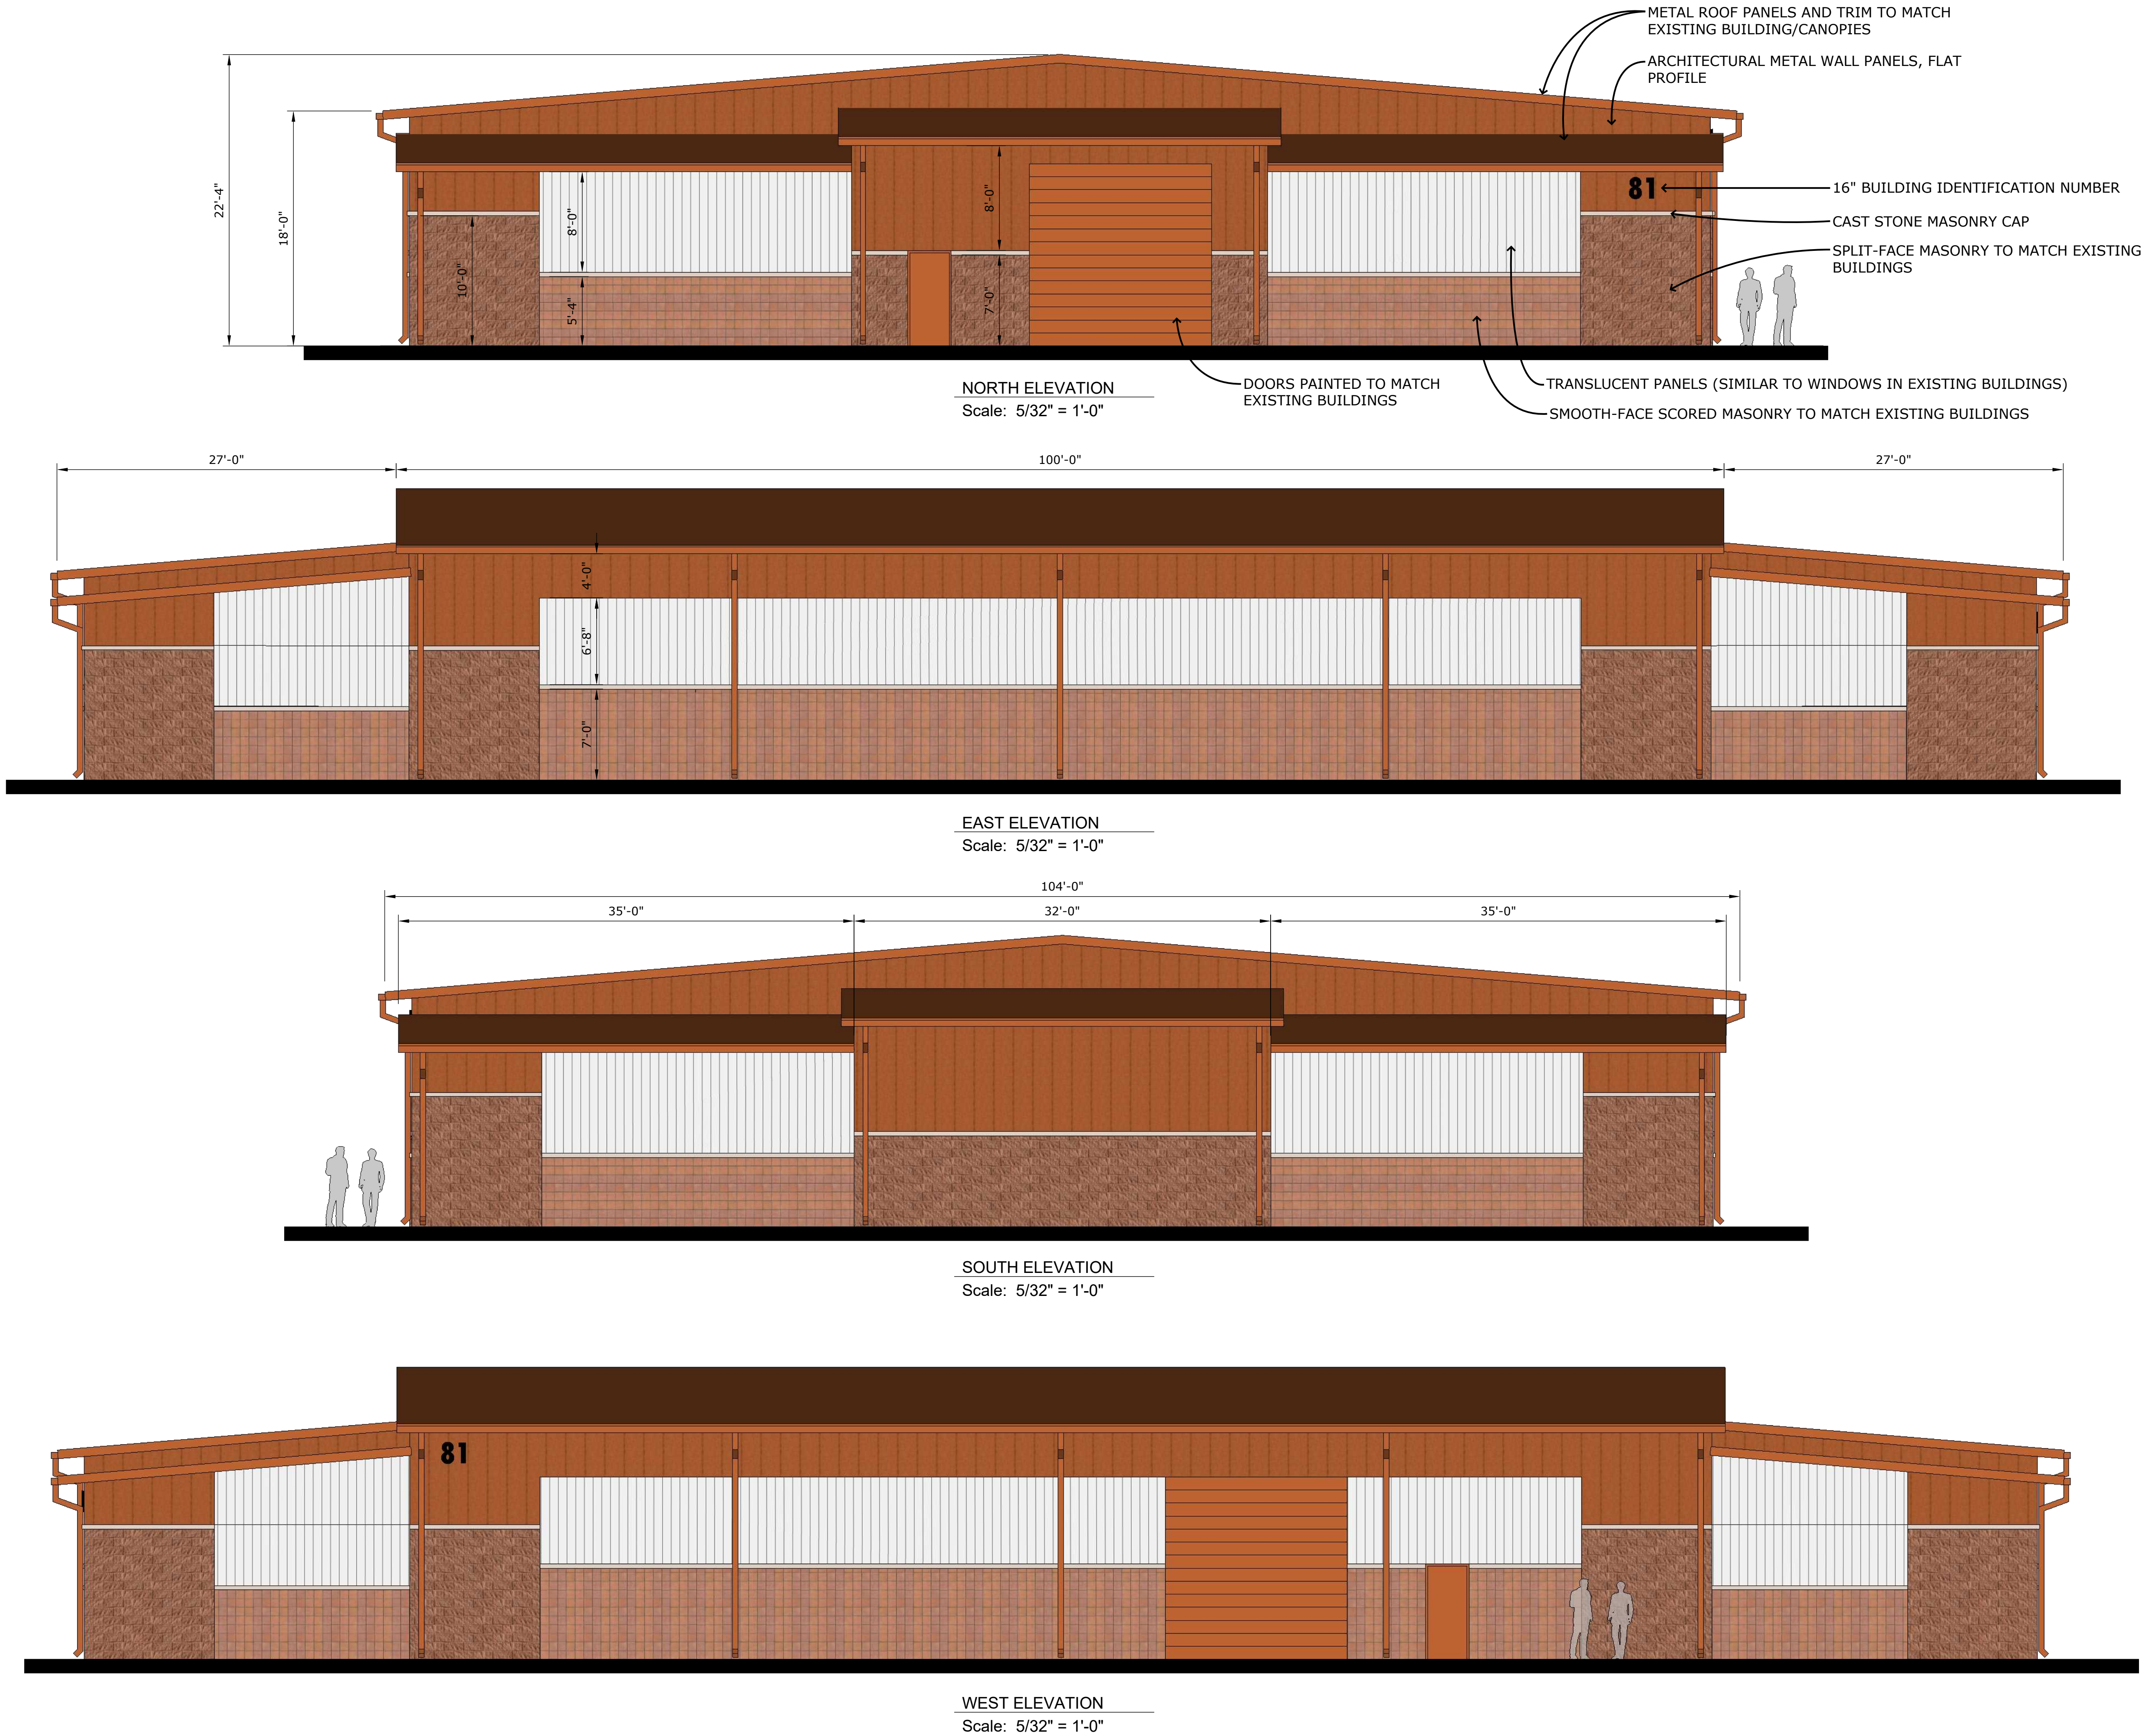

PROPOSED STORAGE BUILDING
FIGURE 9



Southwest view from East Elliot Road - Existing



Southwest view from East Elliot Road - After






Address List Generation Report

City of Mesa Engineering Department

Project Name: CP0372 SBWTP EXPANSION

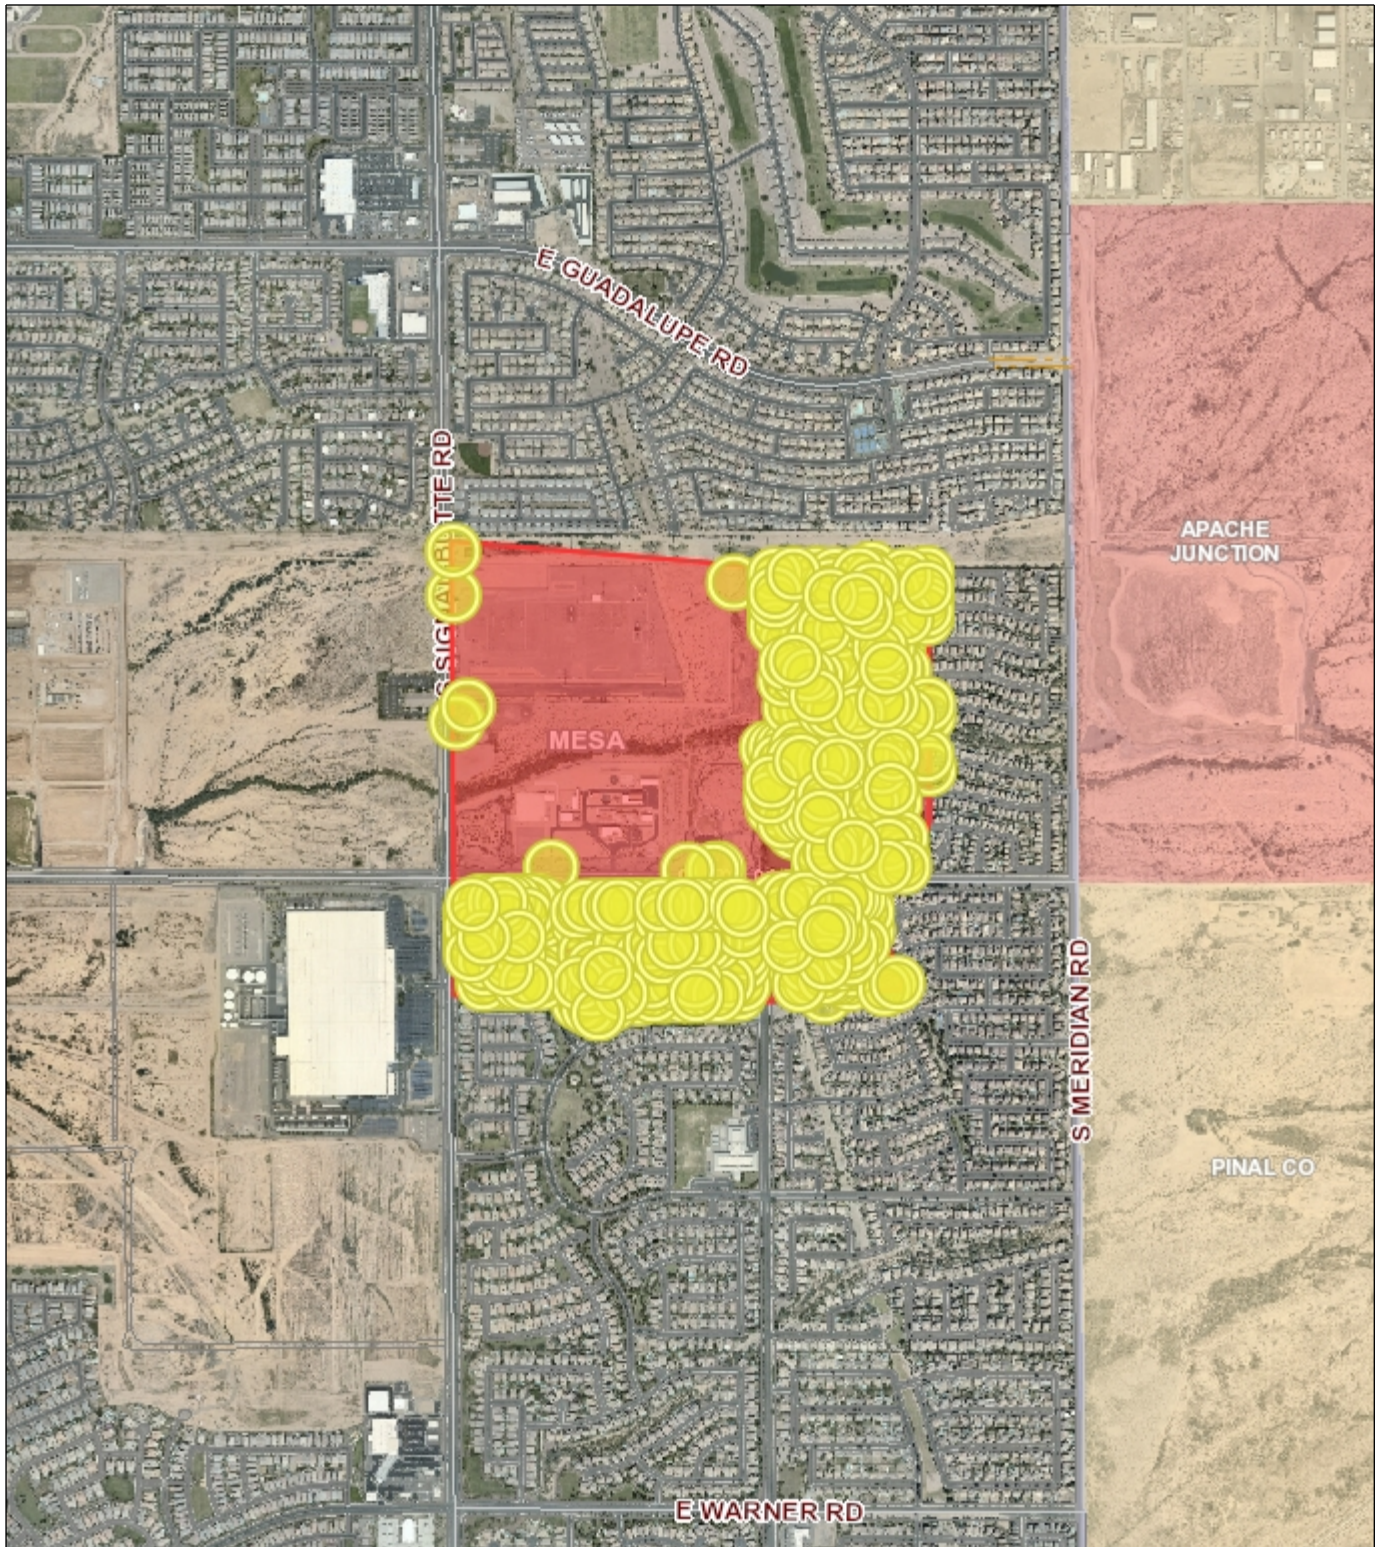

City of Mesa Enterprise GIS; CIS
519 addresses generated in this report

Completed By: DKalich
Date: 07/20/2022

NAME	Company	Address	City	ST	ZIP
CHRISTOPHER TOTH	OR CURRENT RESIDENT	PO BOX 50757	MESA	AZ	85208-0038
ROY AND JUDY GROSS FAMILY JOINT LIVING TRUST	OR CURRENT RESIDENT	PO BOX 51239	MESA	AZ	85208-0062
STACEY REED	OR CURRENT RESIDENT	8149 E OBISPO AVE	MESA	AZ	85212-1687
MELANIE WALTON	OR CURRENT RESIDENT	3540 S OPAL	MESA	AZ	85212-1900
LINDA ROLLINS	OR CURRENT RESIDENT	3546 S OPAL	MESA	AZ	85212-1900
ROBERT OLSON	OR CURRENT RESIDENT	3552 S OPAL	MESA	AZ	85212-1900
DONNA LANDUCCI-RUIZ	OR CURRENT RESIDENT	3558 S OPAL	MESA	AZ	85212-1900
LARRY M WALTON	OR CURRENT RESIDENT	3521 S OPAL	MESA	AZ	85212-1901
CHRISTY M FICK	OR CURRENT RESIDENT	3527 S OPAL	MESA	AZ	85212-1901
ERIN KLEM	OR CURRENT RESIDENT	3533 S OPAL	MESA	AZ	85212-1901
MANUEL B ALVAREZ	OR CURRENT RESIDENT	3539 S OPAL	MESA	AZ	85212-1901
TIMOTHY BUBENHEIM	OR CURRENT RESIDENT	3545 S OPAL	MESA	AZ	85212-1901
CHARLES WEEKS	OR CURRENT RESIDENT	3551 S OPAL	MESA	AZ	85212-1901
MELISSA GONZALEZ	OR CURRENT RESIDENT	11212 E PORTAL AVE	MESA	AZ	85212-1902
ANNABELL GRIFFIN	OR CURRENT RESIDENT	11220 E PORTAL AVE	MESA	AZ	85212-1902
MCCALL COOMBS	OR CURRENT RESIDENT	11228 E PORTAL AVE	MESA	AZ	85212-1902
PATRICK CLUFF	OR CURRENT RESIDENT	11234 E PORTAL AVE	MESA	AZ	85212-1902
RACHEL G SINGER	OR CURRENT RESIDENT	11242 E PORTAL AVE	MESA	AZ	85212-1902
VICTORINA HERNANDEZ AYALA	OR CURRENT RESIDENT	11248 E PORTAL AVE	MESA	AZ	85212-1902
BRETT WALTON	OR CURRENT RESIDENT	11254 E PORTAL AVE	MESA	AZ	85212-1902
CHRIS ASBILL	OR CURRENT RESIDENT	11219 E PORTAL AVE	MESA	AZ	85212-1903
KELLY JONES	OR CURRENT RESIDENT	11231 E PORTAL AVE	MESA	AZ	85212-1903
JOELLA BROWN	OR CURRENT RESIDENT	11243 E PORTAL AVE	MESA	AZ	85212-1903
MICHELLE PASCHKE	OR CURRENT RESIDENT	11249 E PORTAL AVE	MESA	AZ	85212-1903
BRANDON RUSSO	OR CURRENT RESIDENT	11202 E PERSIMMON AVE	MESA	AZ	85212-1904
ELIZABETH MANN	OR CURRENT RESIDENT	11208 E PERSIMMON AVE	MESA	AZ	85212-1904
JOHN FOREMAN	OR CURRENT RESIDENT	11214 E PERSIMMON AVE	MESA	AZ	85212-1904
JUSTIN B MAC DONALD	OR CURRENT RESIDENT	11220 E PERSIMMON AVE	MESA	AZ	85212-1904
ROBERT CURNOW	OR CURRENT RESIDENT	11226 E PERSIMMON AVE	MESA	AZ	85212-1904
PRESTON GROSS	OR CURRENT RESIDENT	11232 E PERSIMMON AVE	MESA	AZ	85212-1904
MARY JANE REBER	OR CURRENT RESIDENT	11238 E PERSIMMON AVE	MESA	AZ	85212-1904
JOSEPH HEIZMAN	OR CURRENT RESIDENT	11242 E PERSIMMON AVE	MESA	AZ	85212-1904
CARLTON J COX	OR CURRENT RESIDENT	11248 E PERSIMMON AVE	MESA	AZ	85212-1904
KRISTA R KUBAL	OR CURRENT RESIDENT	11254 E PERSIMMON AVE	MESA	AZ	85212-1904
ELENA MUHAMEDOV	OR CURRENT RESIDENT	11260 E PERSIMMON AVE	MESA	AZ	85212-1904
KRISTEN WEAVER	OR CURRENT RESIDENT	11266 E PERSIMMON AVE	MESA	AZ	85212-1904
2018-3 IH BORROWER LP	OR CURRENT RESIDENT	11205 E PERSIMMON AVE	MESA	AZ	85212-1905
MARC CONRAD	OR CURRENT RESIDENT	11211 E PERSIMMON AVE	MESA	AZ	85212-1905
DAN KOCH	OR CURRENT RESIDENT	11217 E PERSIMMON AVE	MESA	AZ	85212-1905
SADEQUR RAHMAN	OR CURRENT RESIDENT	11223 E PERSIMMON AVE	MESA	AZ	85212-1905
TINA BECK	OR CURRENT RESIDENT	11229 E PERSIMMON AVE	MESA	AZ	85212-1905
MARK HOWARD	OR CURRENT RESIDENT	11235 E PERSIMMON AVE	MESA	AZ	85212-1905
MELISSA MOY	OR CURRENT RESIDENT	11241 E PERSIMMON AVE	MESA	AZ	85212-1905
RUSSELL PETRINI	OR CURRENT RESIDENT	11247 E PERSIMMON AVE	MESA	AZ	85212-1905
KAREN DINGMAN	OR CURRENT RESIDENT	11253 E PERSIMMON AVE	MESA	AZ	85212-1905
TRACI SANCHEZ	OR CURRENT RESIDENT	11259 E PERSIMMON AVE	MESA	AZ	85212-1905
RAFAEL FRIAS	OR CURRENT RESIDENT	11265 E PERSIMMON AVE	MESA	AZ	85212-1905
TERESA C RUTHERFORD	OR CURRENT RESIDENT	11204 E PRONGHORN AVE	MESA	AZ	85212-1906
NICOLE TOUMA	OR CURRENT RESIDENT	11210 E PRONGHORN AVE	MESA	AZ	85212-1906
KENDRA FRASER	OR CURRENT RESIDENT	11216 E PRONGHORN AVE	MESA	AZ	85212-1906
CAROL CROWE	OR CURRENT RESIDENT	11222 E PRONGHORN AVE	MESA	AZ	85212-1906
MICHELLE FOSTER	OR CURRENT RESIDENT	11228 E PRONGHORN AVE	MESA	AZ	85212-1906
MATTHEW CASWELL	OR CURRENT RESIDENT	11234 E PRONGHORN AVE	MESA	AZ	85212-1906
DAWN BRABEAU	OR CURRENT RESIDENT	11240 E PRONGHORN AVE	MESA	AZ	85212-1906
ARACELI OCHOA	OR CURRENT RESIDENT	11246 E PRONGHORN AVE	MESA	AZ	85212-1906
MARIE MARIN	OR CURRENT RESIDENT	11252 E PRONGHORN AVE	MESA	AZ	85212-1906
MICHAEL HANSON	OR CURRENT RESIDENT	11258 E PRONGHORN AVE	MESA	AZ	85212-1906
CHRISTINA ORTIZ	OR CURRENT RESIDENT	11264 E PRONGHORN AVE	MESA	AZ	85212-1906
DEBBEE R REED	OR CURRENT RESIDENT	11217 E PRONGHORN AVE	MESA	AZ	85212-1907
JOSHUA M NEAL	OR CURRENT RESIDENT	11223 E PRONGHORN AVE	MESA	AZ	85212-1907
MARY KIMMICK	OR CURRENT RESIDENT	11229 E PRONGHORN AVE	MESA	AZ	85212-1907
KELLEE A GARCIA	OR CURRENT RESIDENT	11235 E PRONGHORN AVE	MESA	AZ	85212-1907
CHARLES L BYERLEY	OR CURRENT RESIDENT	11241 E PRONGHORN AVE	MESA	AZ	85212-1907
TORI L KACE	OR CURRENT RESIDENT	11247 E PRONGHORN AVE	MESA	AZ	85212-1907
JENNIFER NEWCOMER	OR CURRENT RESIDENT	11253 E PRONGHORN AVE	MESA	AZ	85212-1907
GRISelda FARIAS	OR CURRENT RESIDENT	11259 E PRONGHORN AVE	MESA	AZ	85212-1907
ANGELO PAFFUMI	OR CURRENT RESIDENT	11265 E PRONGHORN AVE	MESA	AZ	85212-1907

NAME	Company	Address	City	ST	ZIP
REYNALDO GUZMAN	OR CURRENT RESIDENT	3503 S EMERY	MESA	AZ	85212-1908
HEATHER JACOBSON	OR CURRENT RESIDENT	3509 S EMERY	MESA	AZ	85212-1908
KAREN STEINORTH	OR CURRENT RESIDENT	11310 E PERSIMMON AVE	MESA	AZ	85212-1909
NICOLE TAYLOR	OR CURRENT RESIDENT	11316 E PERSIMMON AVE	MESA	AZ	85212-1909
JENNIFER HOLLAND	OR CURRENT RESIDENT	11322 E PERSIMMON AVE	MESA	AZ	85212-1909
EVE CHAVEZ	OR CURRENT RESIDENT	11328 E PERSIMMON AVE	MESA	AZ	85212-1909
CHRISTOPHER DUNN	OR CURRENT RESIDENT	11334 E PERSIMMON AVE	MESA	AZ	85212-1909
SANDRA P STOCKTON	OR CURRENT RESIDENT	11340 E PERSIMMON AVE	MESA	AZ	85212-1909
CRAIG R DELMAN	OR CURRENT RESIDENT	11307 E PERSIMMON AVE	MESA	AZ	85212-1910
AIMEE MOEI	OR CURRENT RESIDENT	11313 E PERSIMMON AVE	MESA	AZ	85212-1910
ANTHONY S CANALE	OR CURRENT RESIDENT	11319 E PERSIMMON AVE	MESA	AZ	85212-1910
MATTHEW JORDAN	OR CURRENT RESIDENT	11325 E PERSIMMON AVE	MESA	AZ	85212-1910
RONALD D WINDSOR	OR CURRENT RESIDENT	11331 E PERSIMMON AVE	MESA	AZ	85212-1910
ERNEST HATHAWAY	OR CURRENT RESIDENT	11337 E PERSIMMON AVE	MESA	AZ	85212-1910
LIESE R SNYDER	OR CURRENT RESIDENT	11306 E PRONGHORN AVE	MESA	AZ	85212-1911
JENNA LEIGH TRETHEWAY	OR CURRENT RESIDENT	11312 E PRONGHORN AVE	MESA	AZ	85212-1911
KATHLEEN HANSON	OR CURRENT RESIDENT	11318 E PRONGHORN AVE	MESA	AZ	85212-1911
ALVARADO JESSICA	OR CURRENT RESIDENT	11324 E PRONGHORN AVE	MESA	AZ	85212-1911
MATT DIRKS	OR CURRENT RESIDENT	11330 E PRONGHORN AVE	MESA	AZ	85212-1911
SCOTT P ENYART SR	OR CURRENT RESIDENT	11336 E PRONGHORN AVE	MESA	AZ	85212-1911
PAUL JANSON	OR CURRENT RESIDENT	11323 E PRONGHORN AVE	MESA	AZ	85212-1912
DAVID CHASE	OR CURRENT RESIDENT	11329 E PRONGHORN AVE	MESA	AZ	85212-1912
LOURDES TORRES	OR CURRENT RESIDENT	11335 E PRONGHORN AVE	MESA	AZ	85212-1912
MATTHEW F PULVE	OR CURRENT RESIDENT	11341 E PRONGHORN AVE	MESA	AZ	85212-1912
CERBERUS SFR HOLDINGS LP	OR CURRENT RESIDENT	3502 S TAMBOR	MESA	AZ	85212-1913
ALEX VANDENBERG	OR CURRENT RESIDENT	3508 S TAMBOR	MESA	AZ	85212-1913
DAVID E GRAHAM	OR CURRENT RESIDENT	3514 S TAMBOR	MESA	AZ	85212-1913
BRENDA VERMILYEA	OR CURRENT RESIDENT	3520 S TAMBOR	MESA	AZ	85212-1913
BRANDI F JURICA	OR CURRENT RESIDENT	3526 S TAMBOR	MESA	AZ	85212-1913
MALINDA WILSON	OR CURRENT RESIDENT	3532 S TAMBOR	MESA	AZ	85212-1913
ZACHARY CLENBENIN	OR CURRENT RESIDENT	3538 S TAMBOR	MESA	AZ	85212-1913
JUAN NAVARRO	OR CURRENT RESIDENT	3544 S TAMBOR	MESA	AZ	85212-1913
CARIE M SHINN	OR CURRENT RESIDENT	3550 S TAMBOR	MESA	AZ	85212-1913
ELNA CAIN	OR CURRENT RESIDENT	3529 S TAMBOR	MESA	AZ	85212-1914
CHRISTINA M STENBERG	OR CURRENT RESIDENT	3535 S TAMBOR	MESA	AZ	85212-1914
LILA Y FREISINGER	OR CURRENT RESIDENT	3541 S TAMBOR	MESA	AZ	85212-1914
KIERSTEN SMITH	OR CURRENT RESIDENT	3547 S TAMBOR	MESA	AZ	85212-1914
CHRISTOPHER LAKSO	OR CURRENT RESIDENT	3555 S TAMBOR	MESA	AZ	85212-1914
GINA ROBERTA SIMPSON	OR CURRENT RESIDENT	11322 E PORTAL AVE	MESA	AZ	85212-1915
AMBER DEWITT	OR CURRENT RESIDENT	11328 E PORTAL AVE	MESA	AZ	85212-1915
A ANNE EILAND	OR CURRENT RESIDENT	11334 E PORTAL AVE	MESA	AZ	85212-1916
JENNIFER E MORRISON	OR CURRENT RESIDENT	11340 E PORTAL AVE	MESA	AZ	85212-1916
ANJANETTE SANCHEZ	OR CURRENT RESIDENT	3530 S OXLEY CIR	MESA	AZ	85212-1917
SAMUEL BOWMAN	OR CURRENT RESIDENT	3536 S OXLEY CIR	MESA	AZ	85212-1917
LA SHAWN JENKINS	OR CURRENT RESIDENT	3542 S OXLEY CIR	MESA	AZ	85212-1917
JOHN R FRISK	OR CURRENT RESIDENT	3548 S OXLEY CIR	MESA	AZ	85212-1917
TOM CARDWELL	OR CURRENT RESIDENT	3556 S OXLEY CIR	MESA	AZ	85212-1917
ROBERT L DEREMER	OR CURRENT RESIDENT	3531 S OXLEY CIR	MESA	AZ	85212-1918
JAMES O MAZINGO	OR CURRENT RESIDENT	3537 S OXLEY CIR	MESA	AZ	85212-1918
MADELEINE DALEY	OR CURRENT RESIDENT	3543 S OXLEY CIR	MESA	AZ	85212-1918
NORA TOUMA	OR CURRENT RESIDENT	3549 S OXLEY CIR	MESA	AZ	85212-1918
SHERYLE SMITH	OR CURRENT RESIDENT	3557 S OXLEY CIR	MESA	AZ	85212-1918
EFRAIN C URIAS	OR CURRENT RESIDENT	11402 E PERSIMMON AVE	MESA	AZ	85212-1932
LAMBERT STEPHEN M	OR CURRENT RESIDENT	11408 E PERSIMMON AVE	MESA	AZ	85212-1932
ARP 2014-1 BORROWER LP	OR CURRENT RESIDENT	11405 E PERSIMMON AVE	MESA	AZ	85212-1934
BOOGAARD KEVIN	OR CURRENT RESIDENT	11406 E PRONGHORN AVE	MESA	AZ	85212-1937
MASTEN KELLY JO/WILLIAM	OR CURRENT RESIDENT	11407 E PRONGHORN AVE	MESA	AZ	85212-1938
ALYSSA ANA BECK-WHITE	OR CURRENT RESIDENT	11403 E PETERSON AVE	MESA	AZ	85212-1943
LISA SEGER	OR CURRENT RESIDENT	3216 S CALDERON	MESA	AZ	85212-1973
HELEN ROSENWADE	OR CURRENT RESIDENT	3224 S CALDERON	MESA	AZ	85212-1973
ROSEN LAUREN	OR CURRENT RESIDENT	3224 S CALDERON # 118	MESA	AZ	85212-1973
STETSON TENNEY	OR CURRENT RESIDENT	3232 S CALDERON	MESA	AZ	85212-1973
MATHEW BAKER	OR CURRENT RESIDENT	3240 S CALDERON	MESA	AZ	85212-1973
MELINDA TUCKER	OR CURRENT RESIDENT	3246 S CALDERON	MESA	AZ	85212-1973
PAM MANS	OR CURRENT RESIDENT	3252 S CALDERON	MESA	AZ	85212-1973
KEVIN H NAUMAN	OR CURRENT RESIDENT	3258 S CALDERON	MESA	AZ	85212-1973
GREGORY SEASE	OR CURRENT RESIDENT	11306 E PRAIRIE AVE	MESA	AZ	85212-1974

NAME	Company	Address	City	ST	ZIP
DEBORAH BENTIVEGNO	OR CURRENT RESIDENT	11312 E PRAIRIE AVE	MESA	AZ	85212-1974
DAVID ISABELLA	OR CURRENT RESIDENT	11318 E PRAIRIE AVE	MESA	AZ	85212-1974
DANIEL SETH GUSTAFSON	OR CURRENT RESIDENT	11324 E PRAIRIE AVE	MESA	AZ	85212-1974
DEBRA MCCOY	OR CURRENT RESIDENT	11330 E PRAIRIE AVE	MESA	AZ	85212-1974
JENNIFER A FERRIN	OR CURRENT RESIDENT	11305 E PRAIRIE AVE	MESA	AZ	85212-1975
JENNIFER LEMLEY	OR CURRENT RESIDENT	11311 E PRAIRIE AVE	MESA	AZ	85212-1975
LAMAR L NEWMAYER	OR CURRENT RESIDENT	11317 E PRAIRIE AVE	MESA	AZ	85212-1975
STEPHEN KEMPTON	OR CURRENT RESIDENT	11323 E PRAIRIE AVE	MESA	AZ	85212-1975
PEG DAVIS-HOHMANN	OR CURRENT RESIDENT	11329 E PRAIRIE AVE	MESA	AZ	85212-1975
AMY L POTTER	OR CURRENT RESIDENT	11335 E PRAIRIE AVE	MESA	AZ	85212-1975
ANNA PADILLA	OR CURRENT RESIDENT	3224 S OXLEY	MESA	AZ	85212-1976
RICHARD CASILLAS	OR CURRENT RESIDENT	3232 S OXLEY	MESA	AZ	85212-1976
JAMES SALISBURY	OR CURRENT RESIDENT	3240 S OXLEY	MESA	AZ	85212-1976
BRIAN RICE	OR CURRENT RESIDENT	3248 S OXLEY	MESA	AZ	85212-1976
JACKIE HESKETH	OR CURRENT RESIDENT	3256 S OXLEY	MESA	AZ	85212-1976
RODOLFO PEREIDA	OR CURRENT RESIDENT	3217 S OXLEY	MESA	AZ	85212-1977
EMILY GALSIM	OR CURRENT RESIDENT	3225 S OXLEY	MESA	AZ	85212-1977
CURTIS W PARKER	OR CURRENT RESIDENT	3233 S OXLEY	MESA	AZ	85212-1977
BARBARA MAZUR	OR CURRENT RESIDENT	3241 S OXLEY	MESA	AZ	85212-1977
MICHAEL D JENSEN	OR CURRENT RESIDENT	3249 S OXLEY	MESA	AZ	85212-1977
ROBERT DILBECK	OR CURRENT RESIDENT	3257 S OXLEY	MESA	AZ	85212-1977
THOMAS BUDO	OR CURRENT RESIDENT	3220 S TAMBOR	MESA	AZ	85212-1978
JOSHUA GLOVER	OR CURRENT RESIDENT	3228 S TAMBOR	MESA	AZ	85212-1978
RONALD BARKER	OR CURRENT RESIDENT	3223 S TAMBOR	MESA	AZ	85212-1979
THOMAS R MCINTYRE	OR CURRENT RESIDENT	3231 S TAMBOR	MESA	AZ	85212-1979
REBECCA MCCLELLAN	OR CURRENT RESIDENT	3239 S TAMBOR	MESA	AZ	85212-1979
JOSEPH M ROCHA	OR CURRENT RESIDENT	3247 S TAMBOR	MESA	AZ	85212-1979
AMANDA BEAUDOIN	OR CURRENT RESIDENT	11302 E PETRA AVE	MESA	AZ	85212-1980
WLIALDO OCHOA	OR CURRENT RESIDENT	11308 E PETRA AVE	MESA	AZ	85212-1980
JOSEPH WAGONER	OR CURRENT RESIDENT	11303 E PETRA AVE	MESA	AZ	85212-1981
RYAN FLAKE	OR CURRENT RESIDENT	11309 E PETRA AVE	MESA	AZ	85212-1981
WESLEY CLUBB	OR CURRENT RESIDENT	11315 E PETRA AVE	MESA	AZ	85212-1981
MALYNDA GAMBOA	OR CURRENT RESIDENT	11227 E PETRA AVE	MESA	AZ	85212-1982
DOMINIC A GAMBOA	OR CURRENT RESIDENT	11233 E PETRA AVE	MESA	AZ	85212-1982
ABEL MARTINEZ	OR CURRENT RESIDENT	11239 E PETRA AVE	MESA	AZ	85212-1983
LINDA M DODSON	OR CURRENT RESIDENT	11245 E PETRA AVE	MESA	AZ	85212-1983
LAWRENCE MARCHIONY	OR CURRENT RESIDENT	11251 E PETRA AVE	MESA	AZ	85212-1983
DARLA SHIPLEY	OR CURRENT RESIDENT	11257 E PETRA AVE	MESA	AZ	85212-1983
DEBORA JAMISON	OR CURRENT RESIDENT	11263 E PETRA AVE	MESA	AZ	85212-1983
MARY C SIMMONS	OR CURRENT RESIDENT	11304 E PETERSON AVE	MESA	AZ	85212-1984
EVA VERDONI	OR CURRENT RESIDENT	11312 E PETERSON AVE	MESA	AZ	85212-1984
DANETTE ALLEY	OR CURRENT RESIDENT	11320 E PETERSON AVE	MESA	AZ	85212-1984
ASIA EL GANT	OR CURRENT RESIDENT	11328 E PETERSON AVE	MESA	AZ	85212-1984
WALT MONTAGUE	OR CURRENT RESIDENT	11336 E PETERSON AVE	MESA	AZ	85212-1984
NATHAN SMITH	OR CURRENT RESIDENT	11344 E PETERSON AVE	MESA	AZ	85212-1984
JESSICA LEE MARAIS	OR CURRENT RESIDENT	11305 E PETERSON AVE	MESA	AZ	85212-1985
STEPHEN GOOD	OR CURRENT RESIDENT	11313 E PETERSON AVE	MESA	AZ	85212-1985
JEANNE Y MCFARLAND	OR CURRENT RESIDENT	11321 E PETERSON AVE	MESA	AZ	85212-1985
DEBRA BAKER	OR CURRENT RESIDENT	11329 E PETERSON AVE	MESA	AZ	85212-1985
MATTHEW HAZELWOOD	OR CURRENT RESIDENT	11337 E PETERSON AVE	MESA	AZ	85212-1985
MARK TORGERSON	OR CURRENT RESIDENT	11345 E PETERSON AVE	MESA	AZ	85212-1985
LARRY M BARNEY	OR CURRENT RESIDENT	11353 E PETERSON AVE	MESA	AZ	85212-1985
MICHAEL J WALDEN	OR CURRENT RESIDENT	11361 E PETERSON AVE	MESA	AZ	85212-1985
DEANNE REESER	OR CURRENT RESIDENT	11234 E PETERSON AVE	MESA	AZ	85212-1986
JENNIFER HAINES	OR CURRENT RESIDENT	11240 E PETERSON AVE	MESA	AZ	85212-1986
VINCENT M ESQUER	OR CURRENT RESIDENT	11246 E PETERSON AVE	MESA	AZ	85212-1986
RANDY BONE	OR CURRENT RESIDENT	11252 E PETERSON AVE	MESA	AZ	85212-1987
BRADLEY FELICE	OR CURRENT RESIDENT	11258 E PETERSON AVE	MESA	AZ	85212-1987
DEREK KLANN	OR CURRENT RESIDENT	11264 E PETERSON AVE	MESA	AZ	85212-1987
LISA FARLINGER	OR CURRENT RESIDENT	11229 E PETERSON AVE	MESA	AZ	85212-1988
JOHN DOHERTY	OR CURRENT RESIDENT	11235 E PETERSON AVE	MESA	AZ	85212-1988
LINDA MOHR-STRECKER	OR CURRENT RESIDENT	11241 E PETERSON AVE	MESA	AZ	85212-1988
JENNIFER HALE	OR CURRENT RESIDENT	11247 E PETERSON AVE	MESA	AZ	85212-1988
SCOTT ADLER	OR CURRENT RESIDENT	11253 E PETERSON AVE	MESA	AZ	85212-1988
SCOTT WEARING	OR CURRENT RESIDENT	11259 E PETERSON AVE	MESA	AZ	85212-1988
JASON BEST	OR CURRENT RESIDENT	11265 E PETERSON AVE	MESA	AZ	85212-1988
JUDY S ALDRICH	OR CURRENT RESIDENT	11304 E PRATT AVE	MESA	AZ	85212-1989

NAME	Company	Address	City	ST	ZIP
KAREN KUHN	OR CURRENT RESIDENT	11310 E PRATT AVE	MESA	AZ	85212-1989
AMANDA CREASON	OR CURRENT RESIDENT	11316 E PRATT AVE	MESA	AZ	85212-1990
CHRISTOPHER TOTH	OR CURRENT RESIDENT	11322 E PRATT AVE	MESA	AZ	85212-1990
WILLIAM W WALTON	OR CURRENT RESIDENT	11328 E PRATT AVE	MESA	AZ	85212-1990
MARY CALDWELL	OR CURRENT RESIDENT	11334 E PRATT AVE	MESA	AZ	85212-1990
DAVID M HALL	OR CURRENT RESIDENT	11340 E PRATT AVE	MESA	AZ	85212-1990
GILBERT E HAMANN	OR CURRENT RESIDENT	11303 E PRATT AVE	MESA	AZ	85212-1991
KATHY DUNCAN	OR CURRENT RESIDENT	11309 E PRATT AVE	MESA	AZ	85212-1991
DAMOND DINH	OR CURRENT RESIDENT	11315 E PRATT AVE	MESA	AZ	85212-1991
NIKCOLE ESQUIVEL	OR CURRENT RESIDENT	11321 E PRATT AVE	MESA	AZ	85212-1991
LAUREN SARMIENTO	OR CURRENT RESIDENT	11327 E PRATT AVE	MESA	AZ	85212-1991
CONNIE STONEBRAKER	OR CURRENT RESIDENT	11333 E PRATT AVE	MESA	AZ	85212-1991
SUE JUNGCK	OR CURRENT RESIDENT	11224 E PRATT AVE	MESA	AZ	85212-1992
WAYNE R RAY	OR CURRENT RESIDENT	11230 E PRATT AVE	MESA	AZ	85212-1992
LEROY GREENSHIELDS	OR CURRENT RESIDENT	11236 E PRATT AVE	MESA	AZ	85212-1992
BRETT A TUCKER	OR CURRENT RESIDENT	11242 E PRATT AVE	MESA	AZ	85212-1992
DAYNA KALFUS	OR CURRENT RESIDENT	11248 E PRATT AVE	MESA	AZ	85212-1992
KELLY L KRAL	OR CURRENT RESIDENT	11254 E PRATT AVE	MESA	AZ	85212-1992
SHIRLEY LIDEN	OR CURRENT RESIDENT	11260 E PRATT AVE	MESA	AZ	85212-1992
STEVEN HALVORSEN	OR CURRENT RESIDENT	11233 E PRATT AVE	MESA	AZ	85212-1993
TIMOTHY A CULWELL	OR CURRENT RESIDENT	11239 E PRATT AVE	MESA	AZ	85212-1993
STEVE CORRELL	OR CURRENT RESIDENT	11245 E PRATT AVE	MESA	AZ	85212-1993
NICOLE ADAMS	OR CURRENT RESIDENT	11251 E PRATT AVE	MESA	AZ	85212-1993
MARK D GIPPLE	OR CURRENT RESIDENT	11257 E PRATT AVE	MESA	AZ	85212-1993
DARYL K BOWER	OR CURRENT RESIDENT	11263 E PRATT AVE	MESA	AZ	85212-1993
KIMBERLY NEAL	OR CURRENT RESIDENT	11226 E PRAIRIE AVE	MESA	AZ	85212-1994
DAVID LEE LORAN	OR CURRENT RESIDENT	11232 E PRAIRIE AVE	MESA	AZ	85212-1994
PHILIP J KERWIN JR	OR CURRENT RESIDENT	11238 E PRAIRIE AVE	MESA	AZ	85212-1994
LINDSAY MILLER	OR CURRENT RESIDENT	11244 E PRAIRIE AVE	MESA	AZ	85212-1994
TAMMY WASHBURN	OR CURRENT RESIDENT	11250 E PRAIRIE AVE	MESA	AZ	85212-1994
KRISTINA GISH	OR CURRENT RESIDENT	11256 E PRAIRIE AVE	MESA	AZ	85212-1994
SANDRA FIELDS	OR CURRENT RESIDENT	11262 E PRAIRIE AVE	MESA	AZ	85212-1994
RENE WOODLAND	OR CURRENT RESIDENT	11266 E PRAIRIE AVE	MESA	AZ	85212-1994
PAULA SLONE	OR CURRENT RESIDENT	11225 E PRAIRIE AVE	MESA	AZ	85212-1995
DAVID FAULK	OR CURRENT RESIDENT	11231 E PRAIRIE AVE	MESA	AZ	85212-1995
PATRICIA WEISS	OR CURRENT RESIDENT	11237 E PRAIRIE AVE	MESA	AZ	85212-1995
RUBEN S MOYA	OR CURRENT RESIDENT	11243 E PRAIRIE AVE	MESA	AZ	85212-1995
LOREN CHARLES JONES	OR CURRENT RESIDENT	11249 E PRAIRIE AVE	MESA	AZ	85212-1995
NANCY L DINSMORE	OR CURRENT RESIDENT	11255 E PRAIRIE AVE	MESA	AZ	85212-1995
KENNETH TURK	OR CURRENT RESIDENT	11261 E PRAIRIE AVE	MESA	AZ	85212-1995
TAMMI SWEENEY	OR CURRENT RESIDENT	3240 S EMERY	MESA	AZ	85212-1996
ERIK J LYNN	OR CURRENT RESIDENT	3248 S EMERY	MESA	AZ	85212-1996
CHRISTA NASSIVERA	OR CURRENT RESIDENT	3256 S EMERY	MESA	AZ	85212-1996
ROBERT A BREITLING	OR CURRENT RESIDENT	3264 S EMERY	MESA	AZ	85212-1996
RANA YOST	OR CURRENT RESIDENT	3216 S EMERY CIR	MESA	AZ	85212-1997
NANCY KUPFERSCHMIDT	OR CURRENT RESIDENT	3224 S EMERY CIR	MESA	AZ	85212-1997
TOM BRADBURY	OR CURRENT RESIDENT	3232 S EMERY CIR	MESA	AZ	85212-1997
TRACY HAYS	OR CURRENT RESIDENT	3217 S EMERY CIR	MESA	AZ	85212-1998
CAROL L. WAGGENER	OR CURRENT RESIDENT	3225 S EMERY CIR	MESA	AZ	85212-1998
IRMA ULLOA	OR CURRENT RESIDENT	3233 S EMERY CIR	MESA	AZ	85212-1998
DAVID KING	OR CURRENT RESIDENT	3218 S OPAL CIR	MESA	AZ	85212-1999
LAURA NOEL SOKOL	OR CURRENT RESIDENT	3219 S OPAL CIR	MESA	AZ	85212-1999
BRIAN SNYDER	OR CURRENT RESIDENT	3226 S OPAL CIR	MESA	AZ	85212-1999
MICHAEL ESPITIA	OR CURRENT RESIDENT	3227 S OPAL CIR	MESA	AZ	85212-1999
KENNETH L BLACKSON	OR CURRENT RESIDENT	3234 S OPAL CIR	MESA	AZ	85212-1999
WILLIAM KLEISER	OR CURRENT RESIDENT	3235 S OPAL CIR	MESA	AZ	85212-1999
DOWNS COURTNEY C/CAMERON J	OR CURRENT RESIDENT	2828 S ESMERALDA CIR	MESA	AZ	85212-2387
JENNIFER HORVATH	OR CURRENT RESIDENT	3616 S HASSETT	MESA	AZ	85212-2500
DAVID C COBB	OR CURRENT RESIDENT	3624 S HASSETT	MESA	AZ	85212-2500
RODRIGO VELA	OR CURRENT RESIDENT	3632 S HASSETT	MESA	AZ	85212-2500
ELIZABETH M MILLER	OR CURRENT RESIDENT	3640 S HASSETT	MESA	AZ	85212-2500
ANDREW SILVER	OR CURRENT RESIDENT	3648 S HASSETT	MESA	AZ	85212-2500
JOHN PONCE	OR CURRENT RESIDENT	3656 S HASSETT	MESA	AZ	85212-2500
VICTORIA APPEL	OR CURRENT RESIDENT	3664 S HASSETT	MESA	AZ	85212-2500
KELLY UEHLING	OR CURRENT RESIDENT	3703 S HASSETT	MESA	AZ	85212-2501
JOSEPH SOLARO	OR CURRENT RESIDENT	3711 S HASSETT	MESA	AZ	85212-2501
DEAN SCOTT	OR CURRENT RESIDENT	3623 S HASSETT	MESA	AZ	85212-2501

NAME	Company	Address	City	ST	ZIP
MICHAEL MORROW	OR CURRENT RESIDENT	3631 S HASSETT	MESA	AZ	85212-2501
MEGAN JACOBITZ	OR CURRENT RESIDENT	3639 S HASSETT	MESA	AZ	85212-2501
WENDY BAIER	OR CURRENT RESIDENT	3647 S HASSETT	MESA	AZ	85212-2501
BARBARA/ROGER BARRIENTOS	OR CURRENT RESIDENT	3655 S HASSETT	MESA	AZ	85212-2501
DAVID PUSCH	OR CURRENT RESIDENT	3663 S HASSETT	MESA	AZ	85212-2501
WENDY DAVIS	OR CURRENT RESIDENT	10806 E QUARRY AVE	MESA	AZ	85212-2504
JOHN DYE	OR CURRENT RESIDENT	10814 E QUARRY AVE	MESA	AZ	85212-2504
ERIN KRAUSE	OR CURRENT RESIDENT	10822 E QUARRY AVE	MESA	AZ	85212-2504
SEAN NEILSON	OR CURRENT RESIDENT	10830 E QUARRY AVE	MESA	AZ	85212-2504
SOUHEIL EL-AAWAR	OR CURRENT RESIDENT	10838 E QUARRY AVE	MESA	AZ	85212-2504
JARETH LOPEZ	OR CURRENT RESIDENT	10846 E QUARRY AVE	MESA	AZ	85212-2504
JANET TASSIE	OR CURRENT RESIDENT	10902 E QUARRY CIR	MESA	AZ	85212-2505
CASSIE M SECOR	OR CURRENT RESIDENT	10905 E QUARRY CIR	MESA	AZ	85212-2505
BARBARA PUSCH	OR CURRENT RESIDENT	10910 E QUARRY CIR	MESA	AZ	85212-2505
DAWN DIETZ	OR CURRENT RESIDENT	10913 E QUARRY CIR	MESA	AZ	85212-2505
JARED SMITH	OR CURRENT RESIDENT	10854 E QUARRY CIR	MESA	AZ	85212-2505
CARLOS A PERAZA	OR CURRENT RESIDENT	10855 E QUARRY CIR	MESA	AZ	85212-2505
BRITTANY ROE	OR CURRENT RESIDENT	10862 E QUARRY CIR	MESA	AZ	85212-2505
JAYSON JACKSON	OR CURRENT RESIDENT	10863 E QUARRY CIR	MESA	AZ	85212-2505
PATRICIA CLARK	OR CURRENT RESIDENT	3702 S GARRISON	MESA	AZ	85212-2506
STACEY REED	OR CURRENT RESIDENT	3710 S GARRISON	MESA	AZ	85212-2506
SKYLAR BENNETT	OR CURRENT RESIDENT	3622 S GARRISON	MESA	AZ	85212-2506
ELLEN JOHNSON	OR CURRENT RESIDENT	3630 S GARRISON	MESA	AZ	85212-2506
ANNA PADILLA	OR CURRENT RESIDENT	3638 S GARRISON	MESA	AZ	85212-2506
MICHELE JOHNSON	OR CURRENT RESIDENT	3646 S GARRISON	MESA	AZ	85212-2506
KATIE E COX	OR CURRENT RESIDENT	3654 S GARRISON	MESA	AZ	85212-2506
LOURDES TALLEDO TAJOLOSA	OR CURRENT RESIDENT	3662 S GARRISON	MESA	AZ	85212-2506
DEBBIE TODD	OR CURRENT RESIDENT	3701 S GARRISON	MESA	AZ	85212-2507
BERNICE ORTIZ	OR CURRENT RESIDENT	3709 S GARRISON	MESA	AZ	85212-2507
DAVID J SZYMULA	OR CURRENT RESIDENT	3637 S GARRISON	MESA	AZ	85212-2507
TANYA N ANDERSON	OR CURRENT RESIDENT	3645 S GARRISON	MESA	AZ	85212-2507
LAURIE L BALZARINI	OR CURRENT RESIDENT	3653 S GARRISON	MESA	AZ	85212-2507
RYAN BALZARINE	OR CURRENT RESIDENT	3661 S GARRISON	MESA	AZ	85212-2507
JOSEPH C VERT	OR CURRENT RESIDENT	10821 E QUADE AVE	MESA	AZ	85212-2510
ERIKA L LONGACRE	OR CURRENT RESIDENT	10829 E QUADE AVE	MESA	AZ	85212-2510
GORDON C BAIRD	OR CURRENT RESIDENT	10903 E QUADE AVE	MESA	AZ	85212-2511
KARLA HEALEY	OR CURRENT RESIDENT	10911 E QUADE AVE	MESA	AZ	85212-2511
DEBORAH KERNS	OR CURRENT RESIDENT	10837 E QUADE AVE	MESA	AZ	85212-2511
CHRIS REARDON	OR CURRENT RESIDENT	10845 E QUADE AVE	MESA	AZ	85212-2511
JUAN F LUQUENO	OR CURRENT RESIDENT	10853 E QUADE AVE	MESA	AZ	85212-2511
RYANN ANDERSON	OR CURRENT RESIDENT	10861 E QUADE AVE	MESA	AZ	85212-2511
BARBARA DELANEY	OR CURRENT RESIDENT	10904 E QUADE AVE	MESA	AZ	85212-2512
DAVID ISHIZAKI	OR CURRENT RESIDENT	10912 E QUADE AVE	MESA	AZ	85212-2512
WOODWARD CELINA/CHRISTOPHER	OR CURRENT RESIDENT	10816 E QUARTET AVE	MESA	AZ	85212-2513
TENORIO CURTIS/JAMI LYN PEREZ	OR CURRENT RESIDENT	10822 E QUARTET AVE	MESA	AZ	85212-2513
HUNT JOHN T/ANDREA	OR CURRENT RESIDENT	10828 E QUARTET AVE	MESA	AZ	85212-2513
YSLAS ANTHONY/ERIN	OR CURRENT RESIDENT	10840 E QUARTET AVE	MESA	AZ	85212-2514
COENEN KATHLYN	OR CURRENT RESIDENT	10846 E QUARTET AVE	MESA	AZ	85212-2514
EDWARDS KRISTINE	OR CURRENT RESIDENT	10852 E QUARTET AVE	MESA	AZ	85212-2514
KEVIN G CANTILE AND PATTI R CANTILE LIVING TRUST	OR CURRENT RESIDENT	10858 E QUARTET AVE	MESA	AZ	85212-2514
DONNEY LUKE	OR CURRENT RESIDENT	3741 S ST CLAIRE	MESA	AZ	85212-2520
RAYMOND HINOJOSA	OR CURRENT RESIDENT	11004 E QUARRY CIR	MESA	AZ	85212-2572
AMBER DEWITT	OR CURRENT RESIDENT	11005 E QUARRY CIR	MESA	AZ	85212-2572
ROBERT MCKAY	OR CURRENT RESIDENT	11012 E QUARRY CIR	MESA	AZ	85212-2572
KODY COOKE	OR CURRENT RESIDENT	11013 E QUARRY CIR	MESA	AZ	85212-2572
JOE SANCHEZ	OR CURRENT RESIDENT	10946 E QUARRY CIR	MESA	AZ	85212-2572
EMILY VARGA	OR CURRENT RESIDENT	10947 E QUARRY CIR	MESA	AZ	85212-2572
MARGO MELAINE SNOW	OR CURRENT RESIDENT	10954 E QUARRY CIR	MESA	AZ	85212-2572
ALAN WEIDNER	OR CURRENT RESIDENT	10955 E QUARRY CIR	MESA	AZ	85212-2572
BRENDA D GRIEGO	OR CURRENT RESIDENT	10962 E QUARRY CIR	MESA	AZ	85212-2572
JOE A PROFITA	OR CURRENT RESIDENT	10963 E QUARRY CIR	MESA	AZ	85212-2572
PATRICIA KAY YATES	OR CURRENT RESIDENT	11020 E QUARRY AVE	MESA	AZ	85212-2573
CORINNE MALDONADO	OR CURRENT RESIDENT	11028 E QUARRY AVE	MESA	AZ	85212-2573
DEREK TAYLOR	OR CURRENT RESIDENT	11036 E QUARRY AVE	MESA	AZ	85212-2573
SHUAI ZHAO	OR CURRENT RESIDENT	11044 E QUARRY AVE	MESA	AZ	85212-2573
JEFFREY EMMERSON	OR CURRENT RESIDENT	11052 E QUARRY AVE	MESA	AZ	85212-2573
SUSAN KUPCZYK	OR CURRENT RESIDENT	11060 E QUARRY AVE	MESA	AZ	85212-2573

NAME	Company	Address	City	ST	ZIP
MARTIN S BYRUM	OR CURRENT RESIDENT	11105 E QUARRY AVE	MESA	AZ	85212-2576
JANINE THEISS	OR CURRENT RESIDENT	11113 E QUARRY AVE	MESA	AZ	85212-2576
DAVID GILBERT	OR CURRENT RESIDENT	11121 E QUARRY AVE	MESA	AZ	85212-2576
KATIE ADAMS	OR CURRENT RESIDENT	11129 E QUARRY AVE	MESA	AZ	85212-2576
MARCUS SYNEGAL	OR CURRENT RESIDENT	11037 E QUARRY AVE	MESA	AZ	85212-2576
RUSSELL RANDALL ECKENBOY	OR CURRENT RESIDENT	11045 E QUARRY AVE	MESA	AZ	85212-2576
JOSE GARCIA	OR CURRENT RESIDENT	11053 E QUARRY AVE	MESA	AZ	85212-2576
JENNIFER KOBAYASHI	OR CURRENT RESIDENT	11061 E QUARRY AVE	MESA	AZ	85212-2576
STEVE ALBERT BISSETT	OR CURRENT RESIDENT	11104 E QUARRY AVE	MESA	AZ	85212-2577
ELEANOR HIRNEISEN	OR CURRENT RESIDENT	11112 E QUARRY AVE	MESA	AZ	85212-2577
SARA SNOW	OR CURRENT RESIDENT	11120 E QUARRY AVE	MESA	AZ	85212-2577
STEPHANIE FURLANETTO	OR CURRENT RESIDENT	11128 E QUARRY AVE	MESA	AZ	85212-2577
TERI A RAIDY	OR CURRENT RESIDENT	11136 E QUARRY AVE	MESA	AZ	85212-2577
MICHAEL BREU	OR CURRENT RESIDENT	10950 E QUADE AVE	MESA	AZ	85212-2578
AMY MARCINIAK	OR CURRENT RESIDENT	10958 E QUADE AVE	MESA	AZ	85212-2578
KENNETH KEATING	OR CURRENT RESIDENT	10966 E QUADE AVE	MESA	AZ	85212-2578
SCOTT PORTER	OR CURRENT RESIDENT	11007 E QUADE AVE	MESA	AZ	85212-2579
CLAUDE FLOURNOY	OR CURRENT RESIDENT	11015 E QUADE AVE	MESA	AZ	85212-2579
JARED KIESBY	OR CURRENT RESIDENT	11023 E QUADE AVE	MESA	AZ	85212-2579
PAULETT GREER	OR CURRENT RESIDENT	11031 E QUADE AVE	MESA	AZ	85212-2579
PAULINA FLORES	OR CURRENT RESIDENT	11039 E QUADE AVE	MESA	AZ	85212-2579
JOSHUA BERKLEY	OR CURRENT RESIDENT	10957 E QUADE AVE	MESA	AZ	85212-2579
JACOB M WOOD	OR CURRENT RESIDENT	10965 E QUADE AVE	MESA	AZ	85212-2579
DELANEY WOITH	OR CURRENT RESIDENT	11016 E QUADE AVE	MESA	AZ	85212-2580
NICHOLAS CORTINA	OR CURRENT RESIDENT	11024 E QUADE AVE	MESA	AZ	85212-2580
RYLAND BRIDGEWATER	OR CURRENT RESIDENT	11106 E QUADE AVE	MESA	AZ	85212-2581
RENAE CASTONGUAY	OR CURRENT RESIDENT	11114 E QUADE AVE	MESA	AZ	85212-2581
PETER DEMARTINI	OR CURRENT RESIDENT	11122 E QUADE AVE	MESA	AZ	85212-2581
ARTHUR KING	OR CURRENT RESIDENT	11130 E QUADE AVE	MESA	AZ	85212-2581
PHILLIP LAROCHE	OR CURRENT RESIDENT	11038 E QUADE AVE	MESA	AZ	85212-2581
JOANN HESS	OR CURRENT RESIDENT	11046 E QUADE AVE	MESA	AZ	85212-2581
SAMUEL G DAY	OR CURRENT RESIDENT	11054 E QUADE AVE	MESA	AZ	85212-2581
REGINA BUBAN	OR CURRENT RESIDENT	11062 E QUADE AVE	MESA	AZ	85212-2581
GREGORY HALL	OR CURRENT RESIDENT	11107 E QUADE AVE	MESA	AZ	85212-2582
JOHN LANEY	OR CURRENT RESIDENT	11115 E QUADE AVE	MESA	AZ	85212-2582
DAVID B BOGGS	OR CURRENT RESIDENT	11123 E QUADE AVE	MESA	AZ	85212-2582
DONALD R BOYER	OR CURRENT RESIDENT	11131 E QUADE AVE	MESA	AZ	85212-2582
RUTH LAWYER	OR CURRENT RESIDENT	11047 E QUADE AVE	MESA	AZ	85212-2582
JAMES I GLORIA	OR CURRENT RESIDENT	11055 E QUADE AVE	MESA	AZ	85212-2582
DALE CHRISTEL	OR CURRENT RESIDENT	11063 E QUADE AVE	MESA	AZ	85212-2582
KRIS PASSOW	OR CURRENT RESIDENT	3707 S HARLAN	MESA	AZ	85212-2583
ERIC EMLET	OR CURRENT RESIDENT	3715 S HARLAN	MESA	AZ	85212-2583
JORDAN SWEET	OR CURRENT RESIDENT	3723 S HARLAN	MESA	AZ	85212-2583
TERRI CASCIO	OR CURRENT RESIDENT	3633 S HARLAN	MESA	AZ	85212-2583
NICK BAZINET	OR CURRENT RESIDENT	3641 S HARLAN	MESA	AZ	85212-2583
RYAN WHITTINGTON	OR CURRENT RESIDENT	3649 S HARLAN	MESA	AZ	85212-2583
CHRISTIAN ADAMS	OR CURRENT RESIDENT	3657 S HARLAN	MESA	AZ	85212-2583
LOTTIE KIMBALL	OR CURRENT RESIDENT	3665 S HARLAN	MESA	AZ	85212-2583
BRYAN ROSS	OR CURRENT RESIDENT	11008 E QUARTET AVE	MESA	AZ	85212-2584
SARAH L WARNER	OR CURRENT RESIDENT	11016 E QUARTET AVE	MESA	AZ	85212-2584
KELLEEN BANNON	OR CURRENT RESIDENT	11024 E QUARTET AVE	MESA	AZ	85212-2584
JULIE ATHMANN	OR CURRENT RESIDENT	11032 E QUARTET AVE	MESA	AZ	85212-2584
MATTHEW PAINTER	OR CURRENT RESIDENT	11040 E QUARTET AVE	MESA	AZ	85212-2584
JAMES NEPHEW	OR CURRENT RESIDENT	11048 E QUARTET AVE	MESA	AZ	85212-2584
MARK JOLLEY	OR CURRENT RESIDENT	11056 E QUARTET AVE	MESA	AZ	85212-2584
DENTON DONLEY	OR CURRENT RESIDENT	11064 E QUARTET AVE	MESA	AZ	85212-2584
BRIAN BAKER	OR CURRENT RESIDENT	11029 E QUARTET AVE	MESA	AZ	85212-2585
MARJORIE M SAYCO	OR CURRENT RESIDENT	11041 E QUARTET AVE	MESA	AZ	85212-2585
ANNE HENDRICKSON	OR CURRENT RESIDENT	11049 E QUARTET AVE	MESA	AZ	85212-2585
SCOTT ISPAS	OR CURRENT RESIDENT	11109 E QUARTET AVE	MESA	AZ	85212-2586
OSCAR HERNADEZ	OR CURRENT RESIDENT	11117 E QUARTET AVE	MESA	AZ	85212-2586
PAUL M VALASCO	OR CURRENT RESIDENT	11125 E QUARTET AVE	MESA	AZ	85212-2586
ANGELA BRYAN	OR CURRENT RESIDENT	11133 E QUARTET AVE	MESA	AZ	85212-2586
DAWN VENTURA	OR CURRENT RESIDENT	11141 E QUARTET AVE	MESA	AZ	85212-2586
LORI NOTTINGHAM	OR CURRENT RESIDENT	11065 E QUARTET AVE	MESA	AZ	85212-2586
ROBERT D CLINE	OR CURRENT RESIDENT	11108 E QUARTET AVE	MESA	AZ	85212-2587
CURT M STANDLEY	OR CURRENT RESIDENT	11116 E QUARTET AVE	MESA	AZ	85212-2587

NAME	Company	Address	City	ST	ZIP
JAMES WAITE	OR CURRENT RESIDENT	11124 E QUARTET AVE	MESA	AZ	85212-2587
OUTHONE SOUVANNAVONG	OR CURRENT RESIDENT	11132 E QUARTET AVE	MESA	AZ	85212-2587
DEANNA SILVA	OR CURRENT RESIDENT	3738 S WHITMAN	MESA	AZ	85212-2588
GIBHRAMN SANCHEZ	OR CURRENT RESIDENT	3746 S WHITMAN	MESA	AZ	85212-2588
SCOTT McCRACKEN	OR CURRENT RESIDENT	3754 S WHITMAN	MESA	AZ	85212-2588
FINACE DENTON	OR CURRENT RESIDENT	11210 E QUARRY AVE	MESA	AZ	85212-4000
BRYAN BLAIR	OR CURRENT RESIDENT	11214 E QUARRY AVE	MESA	AZ	85212-4000
JAIME BURRIS	OR CURRENT RESIDENT	11224 E QUARRY AVE	MESA	AZ	85212-4000
COLLEEN URBAN	OR CURRENT RESIDENT	11230 E QUARRY AVE	MESA	AZ	85212-4000
RONALD PORTER	OR CURRENT RESIDENT	11236 E QUARRY AVE	MESA	AZ	85212-4000
KHALED HOLMAN	OR CURRENT RESIDENT	11242 E QUARRY AVE	MESA	AZ	85212-4000
ANTHONY GILLS	OR CURRENT RESIDENT	11246 E QUARRY AVE	MESA	AZ	85212-4000
CARMEN D'AIUTO	OR CURRENT RESIDENT	11250 E QUARRY AVE	MESA	AZ	85212-4000
'AIUTO CARMEN	'AIUTO CARMEN	11250 E QUARRY AVE	MESA	AZ	85212-4000
BRETT REINSCH	OR CURRENT RESIDENT	11254 E QUARRY AVE	MESA	AZ	85212-4000
APRIL SANCHEZ	OR CURRENT RESIDENT	11260 E QUARRY AVE	MESA	AZ	85212-4000
JOSE R HERNANDEZ	OR CURRENT RESIDENT	11266 E QUARRY AVE	MESA	AZ	85212-4000
RICK PERRY	OR CURRENT RESIDENT	11304 E QUARRY AVE	MESA	AZ	85212-4001
PATRICIA WENDEL	OR CURRENT RESIDENT	11310 E QUARRY AVE	MESA	AZ	85212-4001
MICHAEL LUCAS	OR CURRENT RESIDENT	11316 E QUARRY AVE	MESA	AZ	85212-4001
HUNTER HATTABAUGH	OR CURRENT RESIDENT	11322 E QUARRY AVE	MESA	AZ	85212-4001
GREGORY CORREA	OR CURRENT RESIDENT	11219 E QUARRY AVE	MESA	AZ	85212-4002
GLENICE L CRABTREE	OR CURRENT RESIDENT	11225 E QUARRY AVE	MESA	AZ	85212-4002
ANNETTE S ANDERSON	OR CURRENT RESIDENT	11231 E QUARRY AVE	MESA	AZ	85212-4002
MIRIAM Y MEDRANO	OR CURRENT RESIDENT	11237 E QUARRY AVE	MESA	AZ	85212-4002
MARIO A ARBALLO	OR CURRENT RESIDENT	11243 E QUARRY AVE	MESA	AZ	85212-4002
APRIL HARPER	OR CURRENT RESIDENT	11247 E QUARRY AVE	MESA	AZ	85212-4002
BENJAMIN SANTA ROSA	OR CURRENT RESIDENT	11251 E QUARRY AVE	MESA	AZ	85212-4002
STEPHANIE M LABADIE	OR CURRENT RESIDENT	11255 E QUARRY AVE	MESA	AZ	85212-4002
BRIEL USEVITCH	OR CURRENT RESIDENT	11261 E QUARRY AVE	MESA	AZ	85212-4002
ELAINE FULLER	OR CURRENT RESIDENT	11301 E QUARRY AVE	MESA	AZ	85212-4003
IH6 PROPERTY PHOENIX, LP	OR CURRENT RESIDENT	11305 E QUARRY AVE	MESA	AZ	85212-4003
BENJAMIN MOSLEY	OR CURRENT RESIDENT	11311 E QUARRY AVE	MESA	AZ	85212-4004
JEREMY A HOFFMANN	OR CURRENT RESIDENT	11317 E QUARRY AVE	MESA	AZ	85212-4004
MYND MANAGEMENT INC	OR CURRENT RESIDENT	11214 E QUICKSILVER AVE	MESA	AZ	85212-4005
MICHELLE A ONKELS	OR CURRENT RESIDENT	11220 E QUICKSILVER AVE	MESA	AZ	85212-4005
CAROLYN HILGENBERG	OR CURRENT RESIDENT	11226 E QUICKSILVER AVE	MESA	AZ	85212-4005
CURTIS MARINER	OR CURRENT RESIDENT	11232 E QUICKSILVER AVE	MESA	AZ	85212-4005
BRADY ANDREW DELOBEL	OR CURRENT RESIDENT	11238 E QUICKSILVER AVE	MESA	AZ	85212-4005
PAMELA T TAPAHA	OR CURRENT RESIDENT	11244 E QUICKSILVER AVE	MESA	AZ	85212-4005
VILLA ROMAIN	OR CURRENT RESIDENT	11250 E QUICKSILVER AVE	MESA	AZ	85212-4005
TIFFANY LAYNE	OR CURRENT RESIDENT	11256 E QUICKSILVER AVE	MESA	AZ	85212-4005
MICHAEL HAYES	OR CURRENT RESIDENT	11260 E QUICKSILVER AVE	MESA	AZ	85212-4005
SAGE LEWIS	OR CURRENT RESIDENT	11264 E QUICKSILVER AVE	MESA	AZ	85212-4005
ALEXANDRIA DELAFUENTE	OR CURRENT RESIDENT	11306 E QUICKSILVER AVE	MESA	AZ	85212-4006
MARCELA G GARCIA	OR CURRENT RESIDENT	11312 E QUICKSILVER AVE	MESA	AZ	85212-4006
FRANCESKA JOHNSTON	OR CURRENT RESIDENT	11318 E QUICKSILVER AVE	MESA	AZ	85212-4006
JEFFREY B DARNELL	OR CURRENT RESIDENT	11324 E QUICKSILVER AVE	MESA	AZ	85212-4006
THR PHOENIX LLC	OR CURRENT RESIDENT	11219 E QUICKSILVER AVE	MESA	AZ	85212-4007
DAVID HARDY	OR CURRENT RESIDENT	11225 E QUICKSILVER AVE	MESA	AZ	85212-4007
LEAH PILE	OR CURRENT RESIDENT	11231 E QUICKSILVER AVE	MESA	AZ	85212-4007
KAILA YEANAN	OR CURRENT RESIDENT	11239 E QUICKSILVER AVE	MESA	AZ	85212-4007
COURTNEY DOWNS	OR CURRENT RESIDENT	11245 E QUICKSILVER AVE	MESA	AZ	85212-4007
CRYSTAL GRAHAM	OR CURRENT RESIDENT	11251 E QUICKSILVER AVE	MESA	AZ	85212-4007
ERAN LESCHAUER	OR CURRENT RESIDENT	11257 E QUICKSILVER AVE	MESA	AZ	85212-4007
BENJAMIN MOSEY	OR CURRENT RESIDENT	11261 E QUICKSILVER AVE	MESA	AZ	85212-4007
FREY WILLIAM SCOTT/SHAYLEE JO	OR CURRENT RESIDENT	11246 E QUARTET AVE	MESA	AZ	85212-4008
ALEJANDRA RODRIGIEZ	OR CURRENT RESIDENT	11252 E QUARTET AVE	MESA	AZ	85212-4008
CORDOVA GARY S	OR CURRENT RESIDENT	11258 E QUARTET AVE	MESA	AZ	85212-4008
THORNTON SHERRI	OR CURRENT RESIDENT	11318 E QUARTET AVE	MESA	AZ	85212-4009
ROGERS BRADLEY TREJO/HEIDI RENEE	OR CURRENT RESIDENT	11326 E QUARTET AVE	MESA	AZ	85212-4009
TORRES ADRIAN JESSIE INCLAN/INCLAN LAURA LETICIA	OR CURRENT RESIDENT	11334 E QUARTET AVE	MESA	AZ	85212-4009
GEORGE SELF	OR CURRENT RESIDENT	11342 E QUARTET AVE	MESA	AZ	85212-4009
BRIANNA TRIKOFF	OR CURRENT RESIDENT	11348 E QUARTET AVE	MESA	AZ	85212-4009
MERIDITH WIGHTMAN	OR CURRENT RESIDENT	11354 E QUARTET AVE	MESA	AZ	85212-4009
ROBERT J GILBO	OR CURRENT RESIDENT	3653 S TAMBOR	MESA	AZ	85212-4013
ERNEST A MAGOFFIE	OR CURRENT RESIDENT	3659 S TAMBOR	MESA	AZ	85212-4013

NAME	Company	Address	City	ST	ZIP
ROBERT ASHBY	OR CURRENT RESIDENT	3665 S TAMBOR	MESA	AZ	85212-4013
CAROL S ROBERTSON	OR CURRENT RESIDENT	3705 S TAMBOR	MESA	AZ	85212-4014
EDDIE SCHANAMAN	OR CURRENT RESIDENT	3713 S TAMBOR	MESA	AZ	85212-4014
AMERICAN HOMES 4 RENT LLC	OR CURRENT RESIDENT	3721 S TAMBOR	MESA	AZ	85212-4014
AMERICAN HOMES 4 RENT LLC	OR CURRENT RESIDENT	3729 S TAMBOR	MESA	AZ	85212-4014
ALLEN ELL	OR CURRENT RESIDENT	11220 E QUADE CIR	MESA	AZ	85212-4015
COREY RANDALL BARCOMB	OR CURRENT RESIDENT	11226 E QUADE CIR	MESA	AZ	85212-4015
LINDA DESIDERIO	OR CURRENT RESIDENT	11232 E QUADE CIR	MESA	AZ	85212-4015
ANTHONY LOPEZ	OR CURRENT RESIDENT	11238 E QUADE CIR	MESA	AZ	85212-4015
KYLE B YAGER	OR CURRENT RESIDENT	11244 E QUADE CIR	MESA	AZ	85212-4015
TERRI PETERSON	OR CURRENT RESIDENT	11250 E QUADE CIR	MESA	AZ	85212-4015
IH6 PROPERTY PHOENIX, LP	OR CURRENT RESIDENT	11256 E QUADE CIR	MESA	AZ	85212-4015
MONICA WEIGLEY	OR CURRENT RESIDENT	11262 E QUADE CIR	MESA	AZ	85212-4015
ROBERT J RUSSELL	OR CURRENT RESIDENT	11221 E QUADE CIR	MESA	AZ	85212-4016
AMERICAN HOMES 4 RENT LLC	OR CURRENT RESIDENT	11227 E QUADE CIR	MESA	AZ	85212-4016
GRISelda CENTENO	OR CURRENT RESIDENT	11235 E QUADE CIR	MESA	AZ	85212-4016
DAVID VASQUEZ	OR CURRENT RESIDENT	11243 E QUADE CIR	MESA	AZ	85212-4016
LUCHANA L HANSEN	OR CURRENT RESIDENT	11251 E QUADE CIR	MESA	AZ	85212-4016
DANIEL M CHESEBRO SR	OR CURRENT RESIDENT	11257 E QUADE CIR	MESA	AZ	85212-4016
CERBERUS SFR HOLDINGS LP	OR CURRENT RESIDENT	11263 E QUADE CIR	MESA	AZ	85212-4016
JUSTINE L SMITH TRUST	OR CURRENT RESIDENT	3736 S OPAL	MESA	AZ	85212-4025
REETZ MICHAEL W/KELLY K	OR CURRENT RESIDENT	11402 E QUARRY AVE	MESA	AZ	85212-4031
MILLHAM DAVID G/KOVARNIK STEPHANIE L	OR CURRENT RESIDENT	11406 E QUARRY AVE	MESA	AZ	85212-4031
ACOSTA RAFAEL JR/KRYSTAL	OR CURRENT RESIDENT	3620 S CLANCY	MESA	AZ	85212-4035
BOWLES CLINTON A/PAULA R	OR CURRENT RESIDENT	3636 S CLANCY	MESA	AZ	85212-4035
MAXIE DEMETRIOUS O	OR CURRENT RESIDENT	3644 S CLANCY	MESA	AZ	85212-4035
ANDREWS BRADLEY G	OR CURRENT RESIDENT	3652 S CLANCY	MESA	AZ	85212-4035
POSEY FAMILY TRUST	OR CURRENT RESIDENT	3660 S CLANCY	MESA	AZ	85212-4035
MCCOLLUM STEVEN A	OR CURRENT RESIDENT	4921 S ANTONIO	MESA	AZ	85212-5191
HIGHLAND RIDGE HOMEOWNERS ASSOCIATION	OR CURRENT RESIDENT	7740 N 16TH ST STE 300	PHOENIX	AZ	85020-4473
WENDEL PATRICIA A	OR CURRENT RESIDENT	16428 N 7TH PL	PHOENIX	AZ	85022-2603
MOUNTAIN RANCH COMMUNITY ASSOCIATION	OR CURRENT RESIDENT	16625 S DESERT FOOTHILLS PKV	PHOENIX	AZ	85048-8470
BENJAMIN MOSLEY	OR CURRENT RESIDENT	4771 E MEADOW LAND DR	SAN TAN V.	AZ	85140-5210
SAMUEL BOWMAN	OR CURRENT RESIDENT	26606 S TANGELO AVE	QUEEN CRI	AZ	85142-8037
3557 OXLEY LLC	OR CURRENT RESIDENT	1184 W DESERT HOLLOW DR	SAN TAN V.	AZ	85143-3444
WICHTERMAN KAREN EILEEN	OR CURRENT RESIDENT	1636 E HAMPTON AVE	MESA	AZ	85204-6030
BRADLEY T PORTER AND JANALEE H PORTER TRUST	OR CURRENT RESIDENT	5345 E MCLELLAN RD UNIT 87	MESA	AZ	85205-3415
CRYSTAL GRAHAM	OR CURRENT RESIDENT	5136 E EVERGREEN ST UNIT 104	MESA	AZ	85205-5380
NASSIVERA CHRISTA/JOHN	OR CURRENT RESIDENT	4510 E BANNER GATEWAY DR A	MESA	AZ	85206-4750
YOST TODD/RANA R	OR CURRENT RESIDENT	5210 E HAMPTON AVE	MESA	AZ	85206-6788
11261 E QUICKSILVER AVE LLC	OR CURRENT RESIDENT	3852 N BARRON	MESA	AZ	85207-1848
J & L FAMILY TRUST	OR CURRENT RESIDENT	10514 E LOMITA AVE	MESA	AZ	85209-1596
MERIDIAN POINT HOA	OR CURRENT RESIDENT	7255 E HAMPTON AVE STE 101	MESA	AZ	85209-3312
FERRIN LARRY K/DIANA	OR CURRENT RESIDENT	7061 E MONTE CIR	MESA	AZ	85209-6661
3216 S CALDERON LLC	OR CURRENT RESIDENT	3241 E JAEGER CIR # 058	MESA	AZ	85213-3235
PAPKIN DAVID M	OR CURRENT RESIDENT	2301 W STOTTLER DR	CHANDLER	AZ	85224-2523
DWIGHT SCHRUTE HOLDINGS LLC	OR CURRENT RESIDENT	575 W CHANDLER BLVD	CHANDLER	AZ	85225-7541
ERNEST A MAGOFFIE	OR CURRENT RESIDENT	PO BOX 765	HIGLEY	AZ	85236-0765
SUFIA INCORPORATED	OR CURRENT RESIDENT	1911 E HORSESHOE DR	CHANDLER	AZ	85249-2611
JOHNSON HELEN K/MARK D	OR CURRENT RESIDENT	6649 E LAFAYETTE BLVD	SCOTTSDAI	AZ	85251-3145
2018-1 1H BORROWER LP	OR CURRENT RESIDENT	8665 E HARTFORD DR STE 200	SCOTTSDAI	AZ	85255-7807
SN ARIZONA LLC	OR CURRENT RESIDENT	8390 E VIA DE VENTURA STE F1	SCOTTSDAI	AZ	85258-3189
SUNLAND SPRINGS VILLAGE HOA	OR CURRENT RESIDENT	9000 E PIMA CENTER PKWY STE	SCOTTSDAI	AZ	85258-4471
OLYMPUS BORROWER LLC	OR CURRENT RESIDENT	PO BOX 4090	SCOTTSDAI	AZ	85261-4090
PULVE FREDERICK/MICHELLE	OR CURRENT RESIDENT	15231 E REDROCK DR	FOUNTAIN	AZ	85268-5814
TINA BECK	OR CURRENT RESIDENT	16848 E MONTEREY DR	FOUNTAIN	AZ	85268-6207
MYND MANAGEMENT INC	OR CURRENT RESIDENT	58 S RIVER DR STE 150	TEMPE	AZ	85281-3774
HIGHLAND RIDGE HOMEOWNERS ASSOCIATION	OR CURRENT RESIDENT	1600 W BROADWAY RD STE 200	TEMPE	AZ	85282-1136
HAYES MICHAEL	OR CURRENT RESIDENT	3732 E SHEFFIELD RD	GILBERT	AZ	85296-8280
NICOLE TOUMA	OR CURRENT RESIDENT	2931 E MORRISON RANCH PKW	GILBERT	AZ	85296-9467
JPS SERVICES LLC	OR CURRENT RESIDENT	2091 E QUEEN CREEK RD	GILBERT	AZ	85297-0300
JASON BEST	OR CURRENT RESIDENT	3317 S HIGLEY RD	GILBERT	AZ	85297-5436
BARBER INVESTMENTS LLC	OR CURRENT RESIDENT	2767 E CAROB DR	GILBERT	AZ	85298-8488
FINACE DENTON	OR CURRENT RESIDENT	10529 W PLEASANT VALLEY RD	SUN CITY	AZ	85351-1846
GEORGE SELF	OR CURRENT RESIDENT	342 W ASHBY APPLE DR	PAYSON	AZ	85541-2187
FKH SFR C1 L P	OR CURRENT RESIDENT	1850 PARKWAY PL SE STE 900	MARIETTA	GA	30067-8261
GOMEZ MARIACRISTINA	OR CURRENT RESIDENT	2646 CAMDEN PARK LOOP	DAVENPOR	FL	33837-1805

NAME	Company	Address	City	ST	ZIP
WILSON DONALD R/SARAH L	OR CURRENT RESIDENT	1260 DOGWOOD DR	ORRVILLE	OH	44667-1091
ELANDRA L MILBURN LIVING TRUST	OR CURRENT RESIDENT	869 JOSHUA DR	HIGHLAND	MI	48356-2961
KAREN KUHN	OR CURRENT RESIDENT	18000 N ROLLIN HWY	ADDISON	MI	49220-9527
PAM MANS	OR CURRENT RESIDENT	11547 SHADY VIEW LN	MAPLE GR	MN	55311-7502
PAGAYA SMARTRESI F1 FUND PROPERTY OWNER III LLC	OR CURRENT RESIDENT	6101 BAKER RD STE 200	MINNETON	MN	55345-5959
VOLK STEVEN M/JENNIFER A	OR CURRENT RESIDENT	5026 AUTUMN PL	RAPID CITY	SD	57702-9275
ABRAHAM VENTURES LLC	OR CURRENT RESIDENT	PO BOX 386	COOPERST	ND	58425-0386
TIPPETT ENTERPRISE-PERSIMMON LLC	OR CURRENT RESIDENT	227 FOREST CREEK DR	BOZEMAN	MT	59718-9260
JORDAN MATTHEW D/MARCIE LIN	OR CURRENT RESIDENT	27403 HEAFNER DR	GODFREY	IL	62035-3635
2018-3 IH BORROWER LP	OR CURRENT RESIDENT	1717 MAIN ST STE 2000	DALLAS	TX	75201-4657
DANIEL M CHESEBRO SR	OR CURRENT RESIDENT	210 WELLS FARGO DR APT 1310	HOUSTON	TX	77090-4032
JOSHUA M NEAL	OR CURRENT RESIDENT	13403 FOWLER RDG	SAN ANTOI	TX	78245-2057
2018-3 IH BORROWER LP	OR CURRENT RESIDENT	PO BOX 4698	LOGAN	UT	84323-4698
SYED A HASAN REVOCABLE TRUST	OR CURRENT RESIDENT	298 W HOPKINS VISTA DR	GREEN VAL	AZ	85614-1463
CVSTI LLC	OR CURRENT RESIDENT	PO BOX 1483	MORIARTY	NM	87035-1483
SILVA RONALD/DEANNA	OR CURRENT RESIDENT	PO BOX 1384	GALLUP	NM	87305-1384
AH4R PROPERTIES TWO LLC	OR CURRENT RESIDENT	23975 PARK SORRENTO	CALABASA	CA	91302-4015
ROBINSON COURTNEY ALLEN/SWITZER SARA	OR CURRENT RESIDENT	3628 GINGERWOOD CT	THOUSAND	CA	91360-6242
QUEZADA RAUL/ROSEMARY TR	OR CURRENT RESIDENT	12882 WINDFLOWER DR	RANCHO CI	CA	91739-9441
CRAIG R DELMAN	OR CURRENT RESIDENT	1544 N ALBRIGHT AVE	UPLAND	CA	91786-2222
BLODGETT GARY M/ROSE M	OR CURRENT RESIDENT	191 E MILLAN ST	CHULA VIS	CA	91910-6256
SCHNITZ LIVING TRUST	OR CURRENT RESIDENT	604 PORT STIRLING	CHULA VIS	CA	91913-1313
LIONEL TAYLOR AND LETICIA TAYLOR 2014 REVOCABLE TRUS	OR CURRENT RESIDENT	1549 SHERBROOKE ST	SAN DIEGO	CA	92139-3967
MORALES ROBERT M	OR CURRENT RESIDENT	903 LA HUERTA WAY	SAN DIEGO	CA	92154-2660
GIBSON GERRY	OR CURRENT RESIDENT	29150 MELBY DR	LAKE ELSIN	CA	92532-2300
SUNLAND SPRINGS VILLAGE ASSOC	OR CURRENT RESIDENT	PO BOX 62511	IRVINE	CA	92602-6083
CERBERUS SFR HOLDINGS LP	OR CURRENT RESIDENT	PO BOX 82739	GOLETA	CA	93118-2680
ANTHOLOMEUS LLC	OR CURRENT RESIDENT	86 DENSLOWE DR	SAN FRANC	CA	94132-2013
STAPLES ANDREW/SEIJA PAIVI ANITA	OR CURRENT RESIDENT	UNIT 9800 BOX 343	DPO	AP	96303-0343
LAURIE L BALZARINI	OR CURRENT RESIDENT	4401 CORDOVA PL	FREMONT	CA	94536-4630
SEASE GREGORY/WARNER PATRICIA	OR CURRENT RESIDENT	4752 REGINA WAY	CAMPBELL	CA	95008-5719
CHRISTINE A WENG REVOCABLE LIVING TRUST	OR CURRENT RESIDENT	1216 CAPRI DR	CAMPBELL	CA	95008-6800
TERRI CASCIO	OR CURRENT RESIDENT	1204 SHORE RD	HOLLISTER	CA	95023-9202
ZHANG XIAOJIE	OR CURRENT RESIDENT	2626 E TRIMBLE RD	SAN JOSE	CA	95132-1051
KATHY DUNCAN	OR CURRENT RESIDENT	6914 237TH AVE NE	REDMOND	WA	98053-7912
CURT ALBRIGHT	OR CURRENT RESIDENT	10129 E KNOWLES AVE	MESA	AZ 8	85209
MICHELE ARROLLADO	OR CURRENT RESIDENT	1577 E BRADSTOCK WAY	SAN TAN V.	AZ	85140-7939
DORY KALICH	OR CURRENT RESIDENT	3210 E DRY CREEK RD	PHOENIX A	AZ	85044-5032
JUANITA GONZALES	OR CURRENT RESIDENT	1117 W GARY ST	MESA	AZ	85201
CITY OF MESA Planning Department	ATTN: Joshua Grandlienard	PO BOX 1466	MESA	AZ	85211-1466