


EXTERIOR LIGHT FIXTURE SCHEDULE

FIXTURE TAG	MANUFACTURER/BASIC OF DESIGN	MODEL/SERIES #	LAMP/LED SOURCE	VOLTAGE	INSTALLATION	DESCRIPTION
A2	COOPER LIGHTING	HC610D010IEM7-IM60525840-61MDCIEM	LED 10 VA 3000K	120	RECESSED IN CANOPY	DOWNLIGHT RECESSED IN CANOPY WITH EMERGENCY BACKUP
L	LITON	WD1340-BZL15-EMAC-T30	LED 21 VA 3000K	120	WALL MOUNT 8' ABOVE GRADE	WALL MOUNT FIXTURE WITH EMERGENCY BACKUP
SB	COOPER	PRV-C40-730-D-UNV-T4-SA-BK-HSS- MS/DIM-L20	LED 131 VA 3000K	120	POLE 20' ABOVE GRADE	SITE LIGHTING SINGLE HEAD WITH INTEGRAL MOTION/PHOTOCELL 18'-0" POLE ON 2'-0" CONCRETE BASE
SC	COOPER	PRV-C25-730-D-UNV-T2-SA-BK-HSS MS/DIM-L20	LED 96 VA 3000K	120	POLE 20' ABOVE GRADE	SITE LIGHTING SINGLE HEAD WITH INTEGRAL MOTION/PHOTOCELL 18'-0" POLE ON 2'-0" CONCRETE BASE
SE	COOPER	PRV-C60-730-D-UNV-T2-SA-BK- MS/DIM-L20	LED 306 VA 3000K	120	POLE 20' ABOVE GRADE	SITE LIGHTING DOUBLE HEAD WITH INTEGRAL MOTION/PHOTOCELL 18'-0" POLE ON 2'-0" CONCRETE BASE
SG	COOPER	PRV-C60-730-D-UNV-T4-SA-BK- MS/DIM-L20	LED 306 VA 3000K	120	POLE 20' ABOVE GRADE	SITE LIGHTING DOUBLE HEAD WITH INTEGRAL MOTION/PHOTOCELL 18'-0" POLE ON 2'-0" CONCRETE BASE
SH	COOPER	BTR6-A2-730-U-T3-36-BK-SM2	LED 11 VA 3000K	120	BOLLARD 3' ABOVE GRADE	BOLLARD WITH INTEGRAL MOTION SENSOR
SI	COOPER	TCRS8W-BK-7030	LED 8 VA 3000K	120	STAKE 6' ABOVE GRADE	LANDSCAPE LIGHT

NOTES:  
 1. VERIFY LAMP COLOR WITH ARCHITECT PRIOR TO ORDERING.  
 2. MANUFACTURERS LISTED IN THIS SCHEDULE OR BY WRITTEN ADDENDUM WILL BE THE ONLY APPROVED MANUFACTURERS TO BID THE LIGHTING FIXTURES FOR THIS PROJECT.  
 CONTRACTORS AND SUPPLIERS USING PRICING FROM MANUFACTURERS NOT LISTED ON SCHEDULE OR BY ADDENDUM DO SO AT THEIR OWN RISK.  
 3. VERIFY COLOR OF FIXTURE AND ALL COMPONENTS WITH ARCHITECT PRIOR TO ORDERING.

LIGHT LEVEL STATISTICS					
DESCRIPTION	AVG	MAX	MIN	MAX/MIN	AVG/MIN
PROPERTY LINE	0.1 FC	0.5 FC	0.0 FC	N/A	N/A
PARKING	3.7 FC	15.8 FC	0.1 FC	158:1	37:1

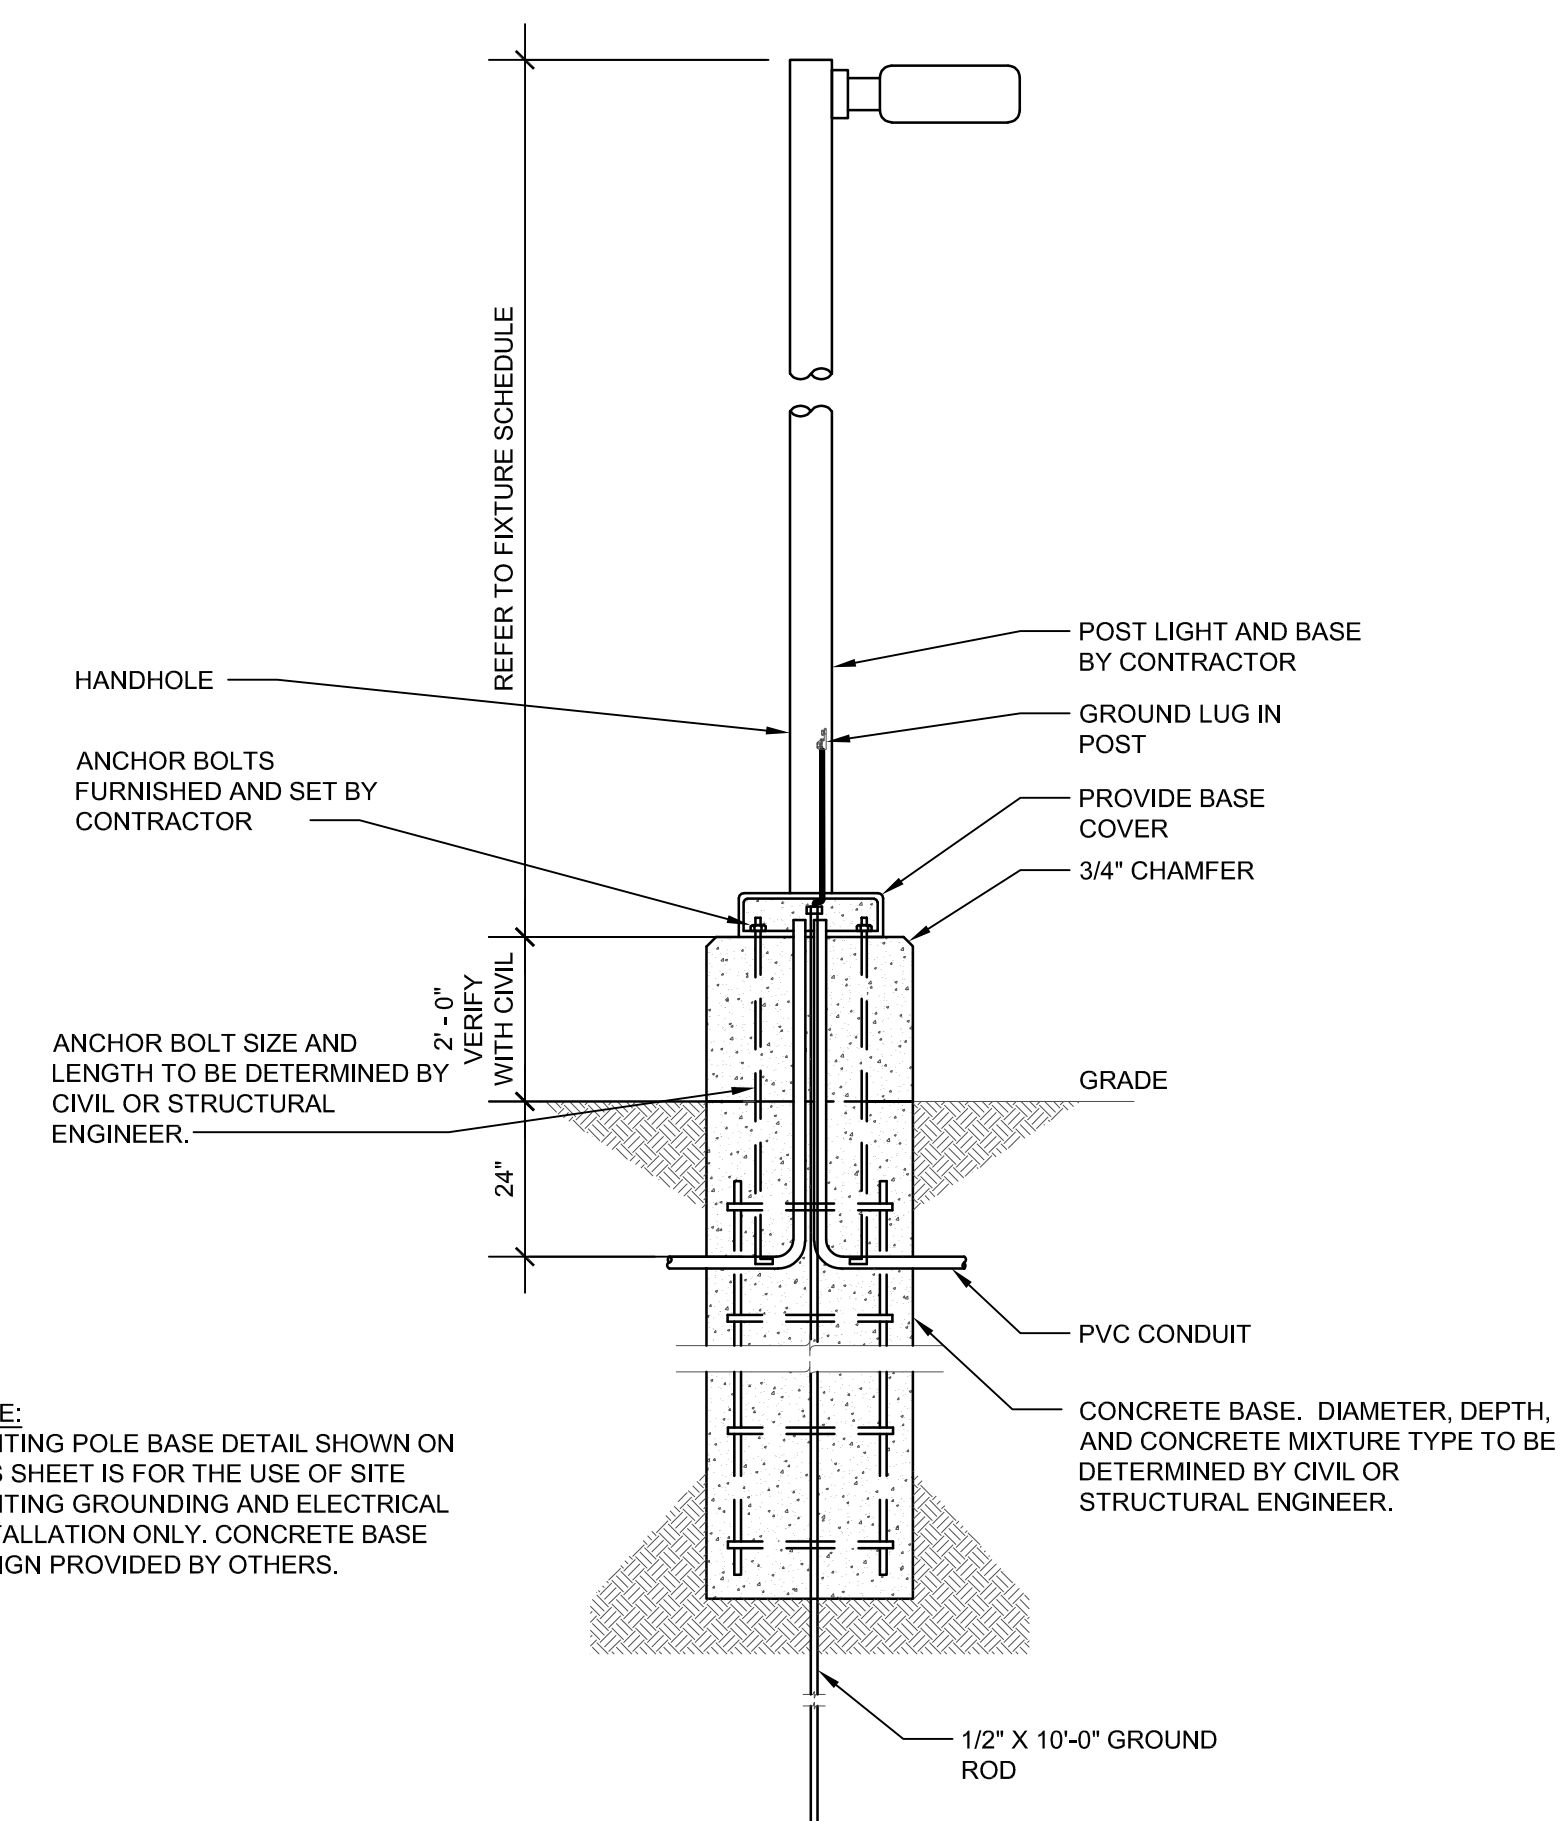

NOTE:  
 LIGHTING POLE BASE DETAIL SHOWN ON THIS SHEET IS FOR THE USE OF SITE LIGHTING GROUNDING AND ELECTRICAL INSTALLATION ONLY. CONCRETE BASE DESIGN PROVIDED BY OTHERS.

- NOTES:
- TYPICAL FOR ALL POLE MOUNTED LIGHTS. SEE PLAN FOR LOCATION AND QUANTITY.
  - PROVIDE ONE EXTRA STUBBED AND CAPPED CONDUIT IN EACH BASE FOR FUTURE EXTENSIONS.
  - WHERE REQUIRED BY LOCAL AUTHORITY, PROVIDE A BASE DRAWING DESIGNED BY A REGISTERED STRUCTURAL ENGINEER AND STAMPED BY ENGINEER FOR SUBMISSION TO AHJ.

2 LIGHT POLE DETAIL  
 NOT TO SCALE

