




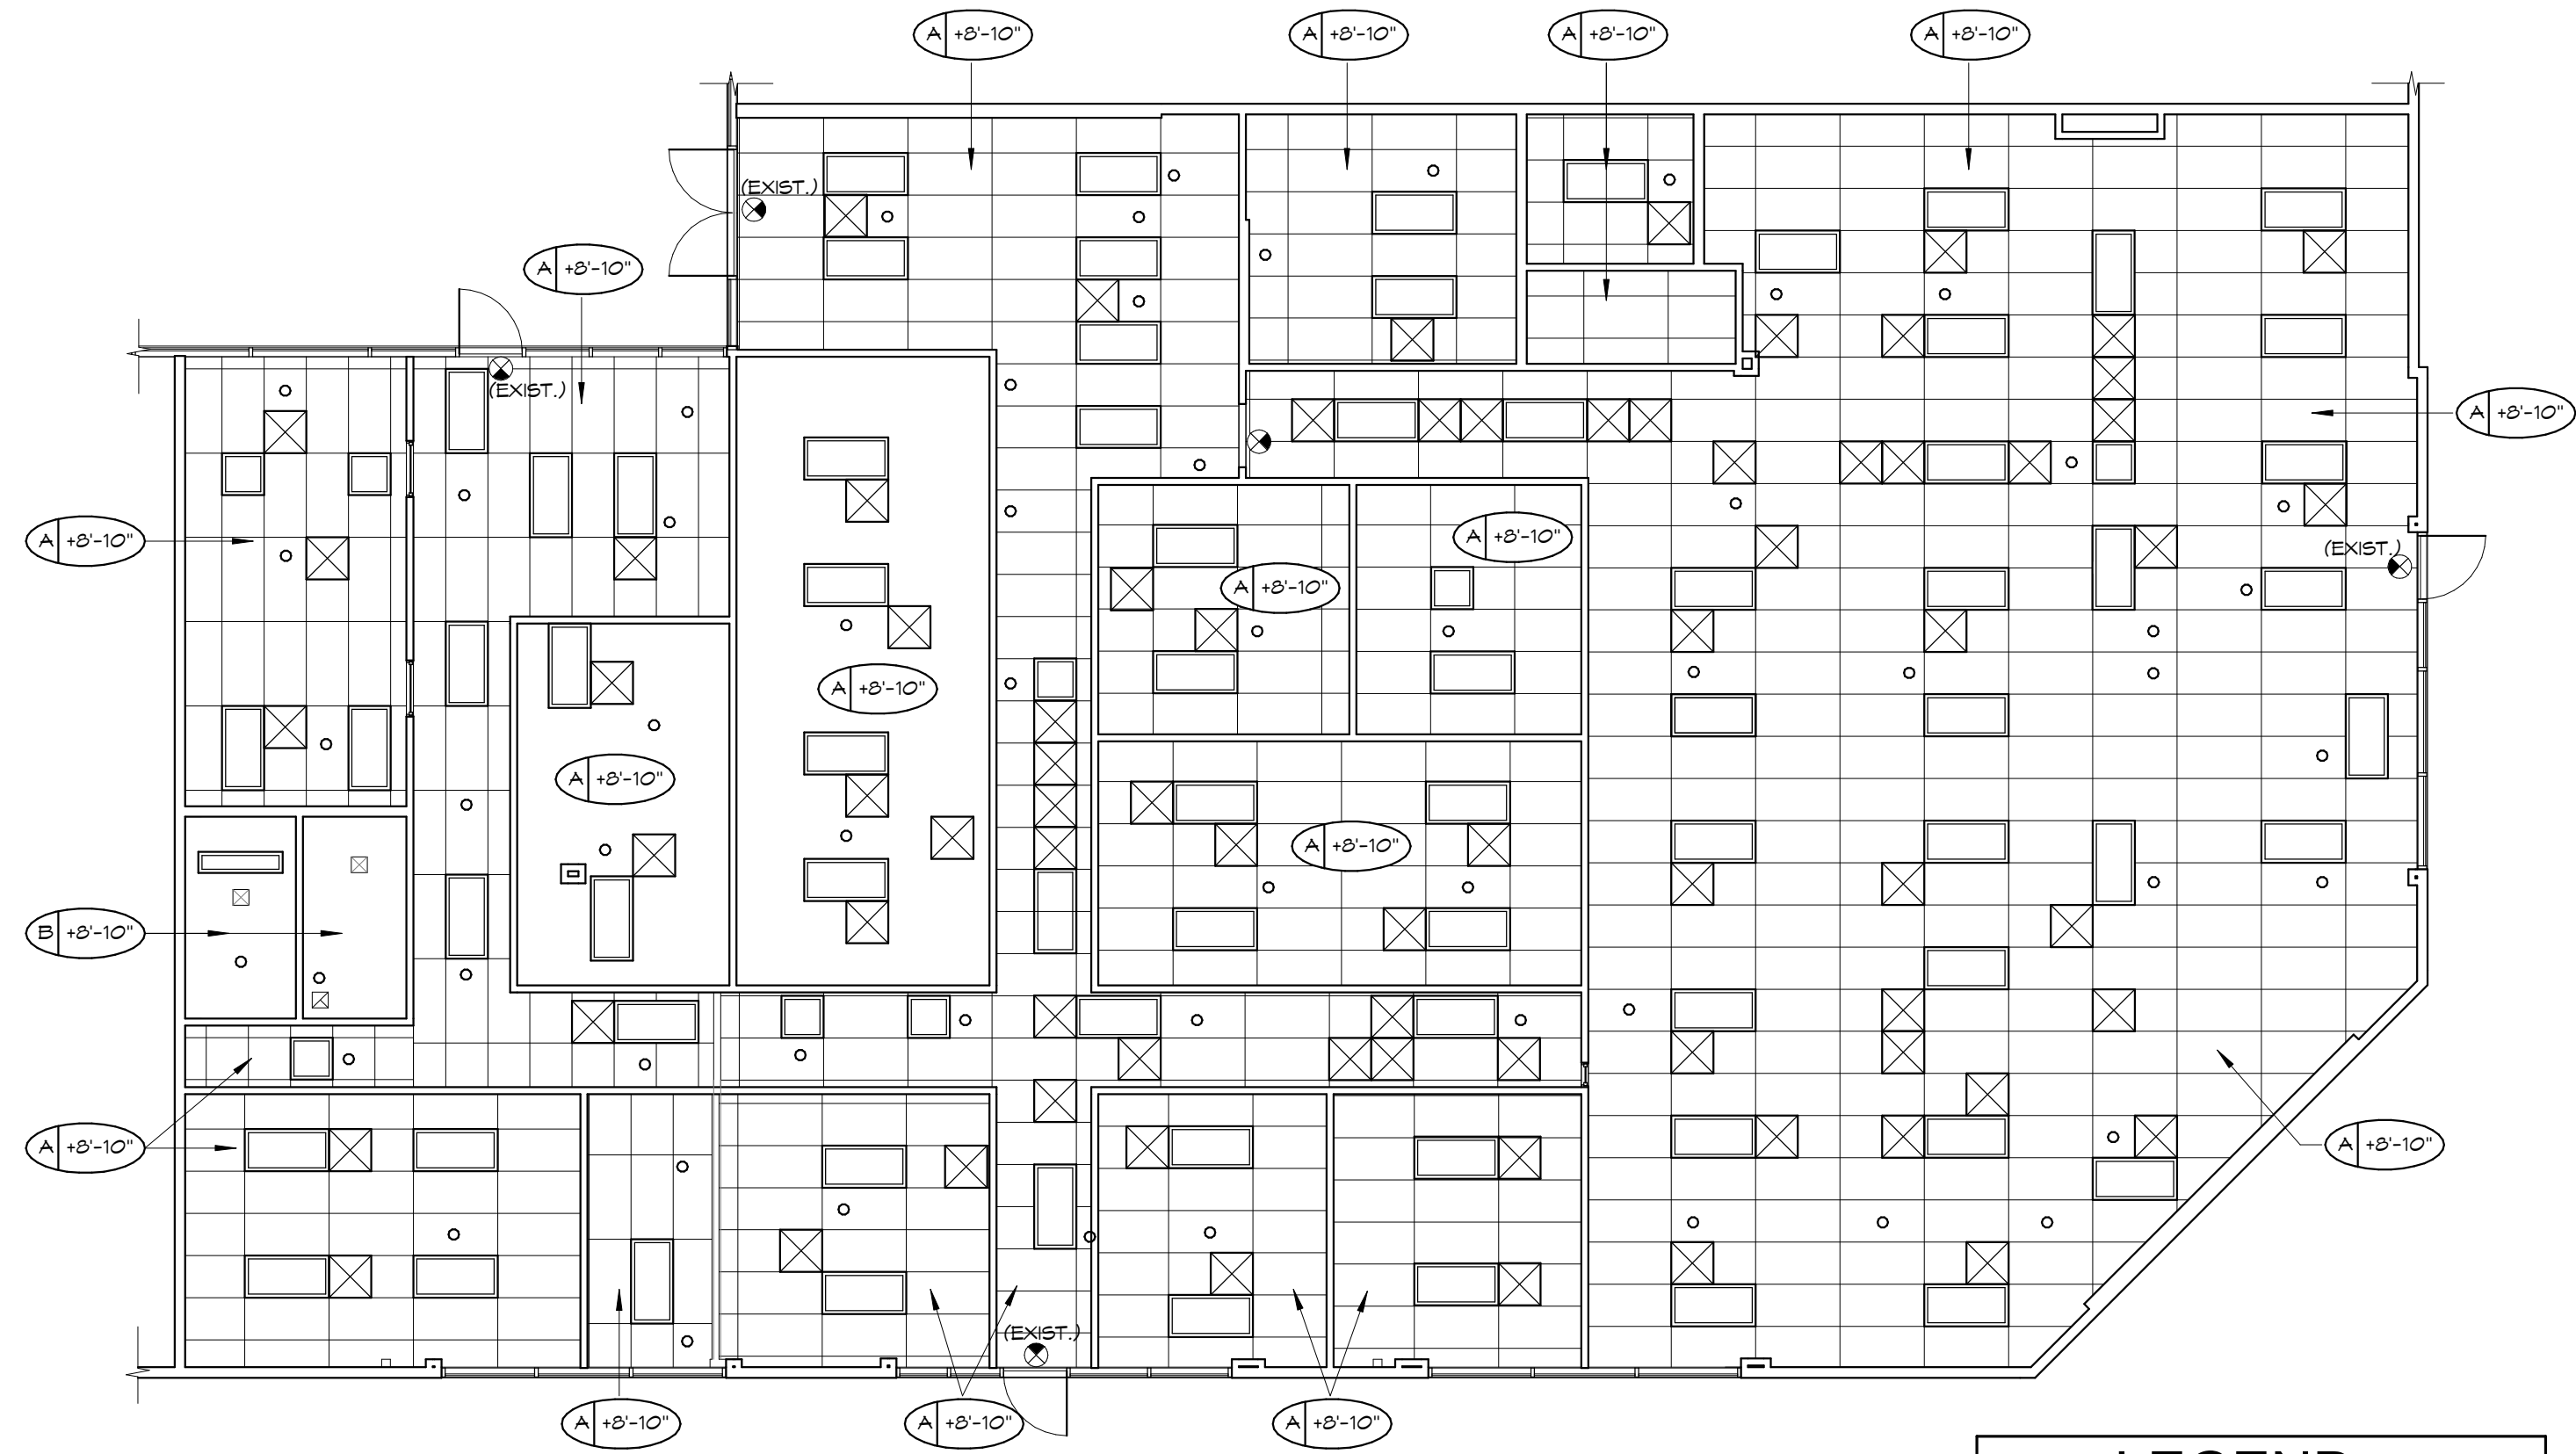


EXISTING REFLECTED CEILING PLAN



LEGEND	
TYPE	CLS. HGT.
(A)	EXISTING 2'X4' LAY-IN ACOUSTICAL TILE TO REMAIN
(B)	EXISTING 5/8" GYP. BOARD - PAINTED

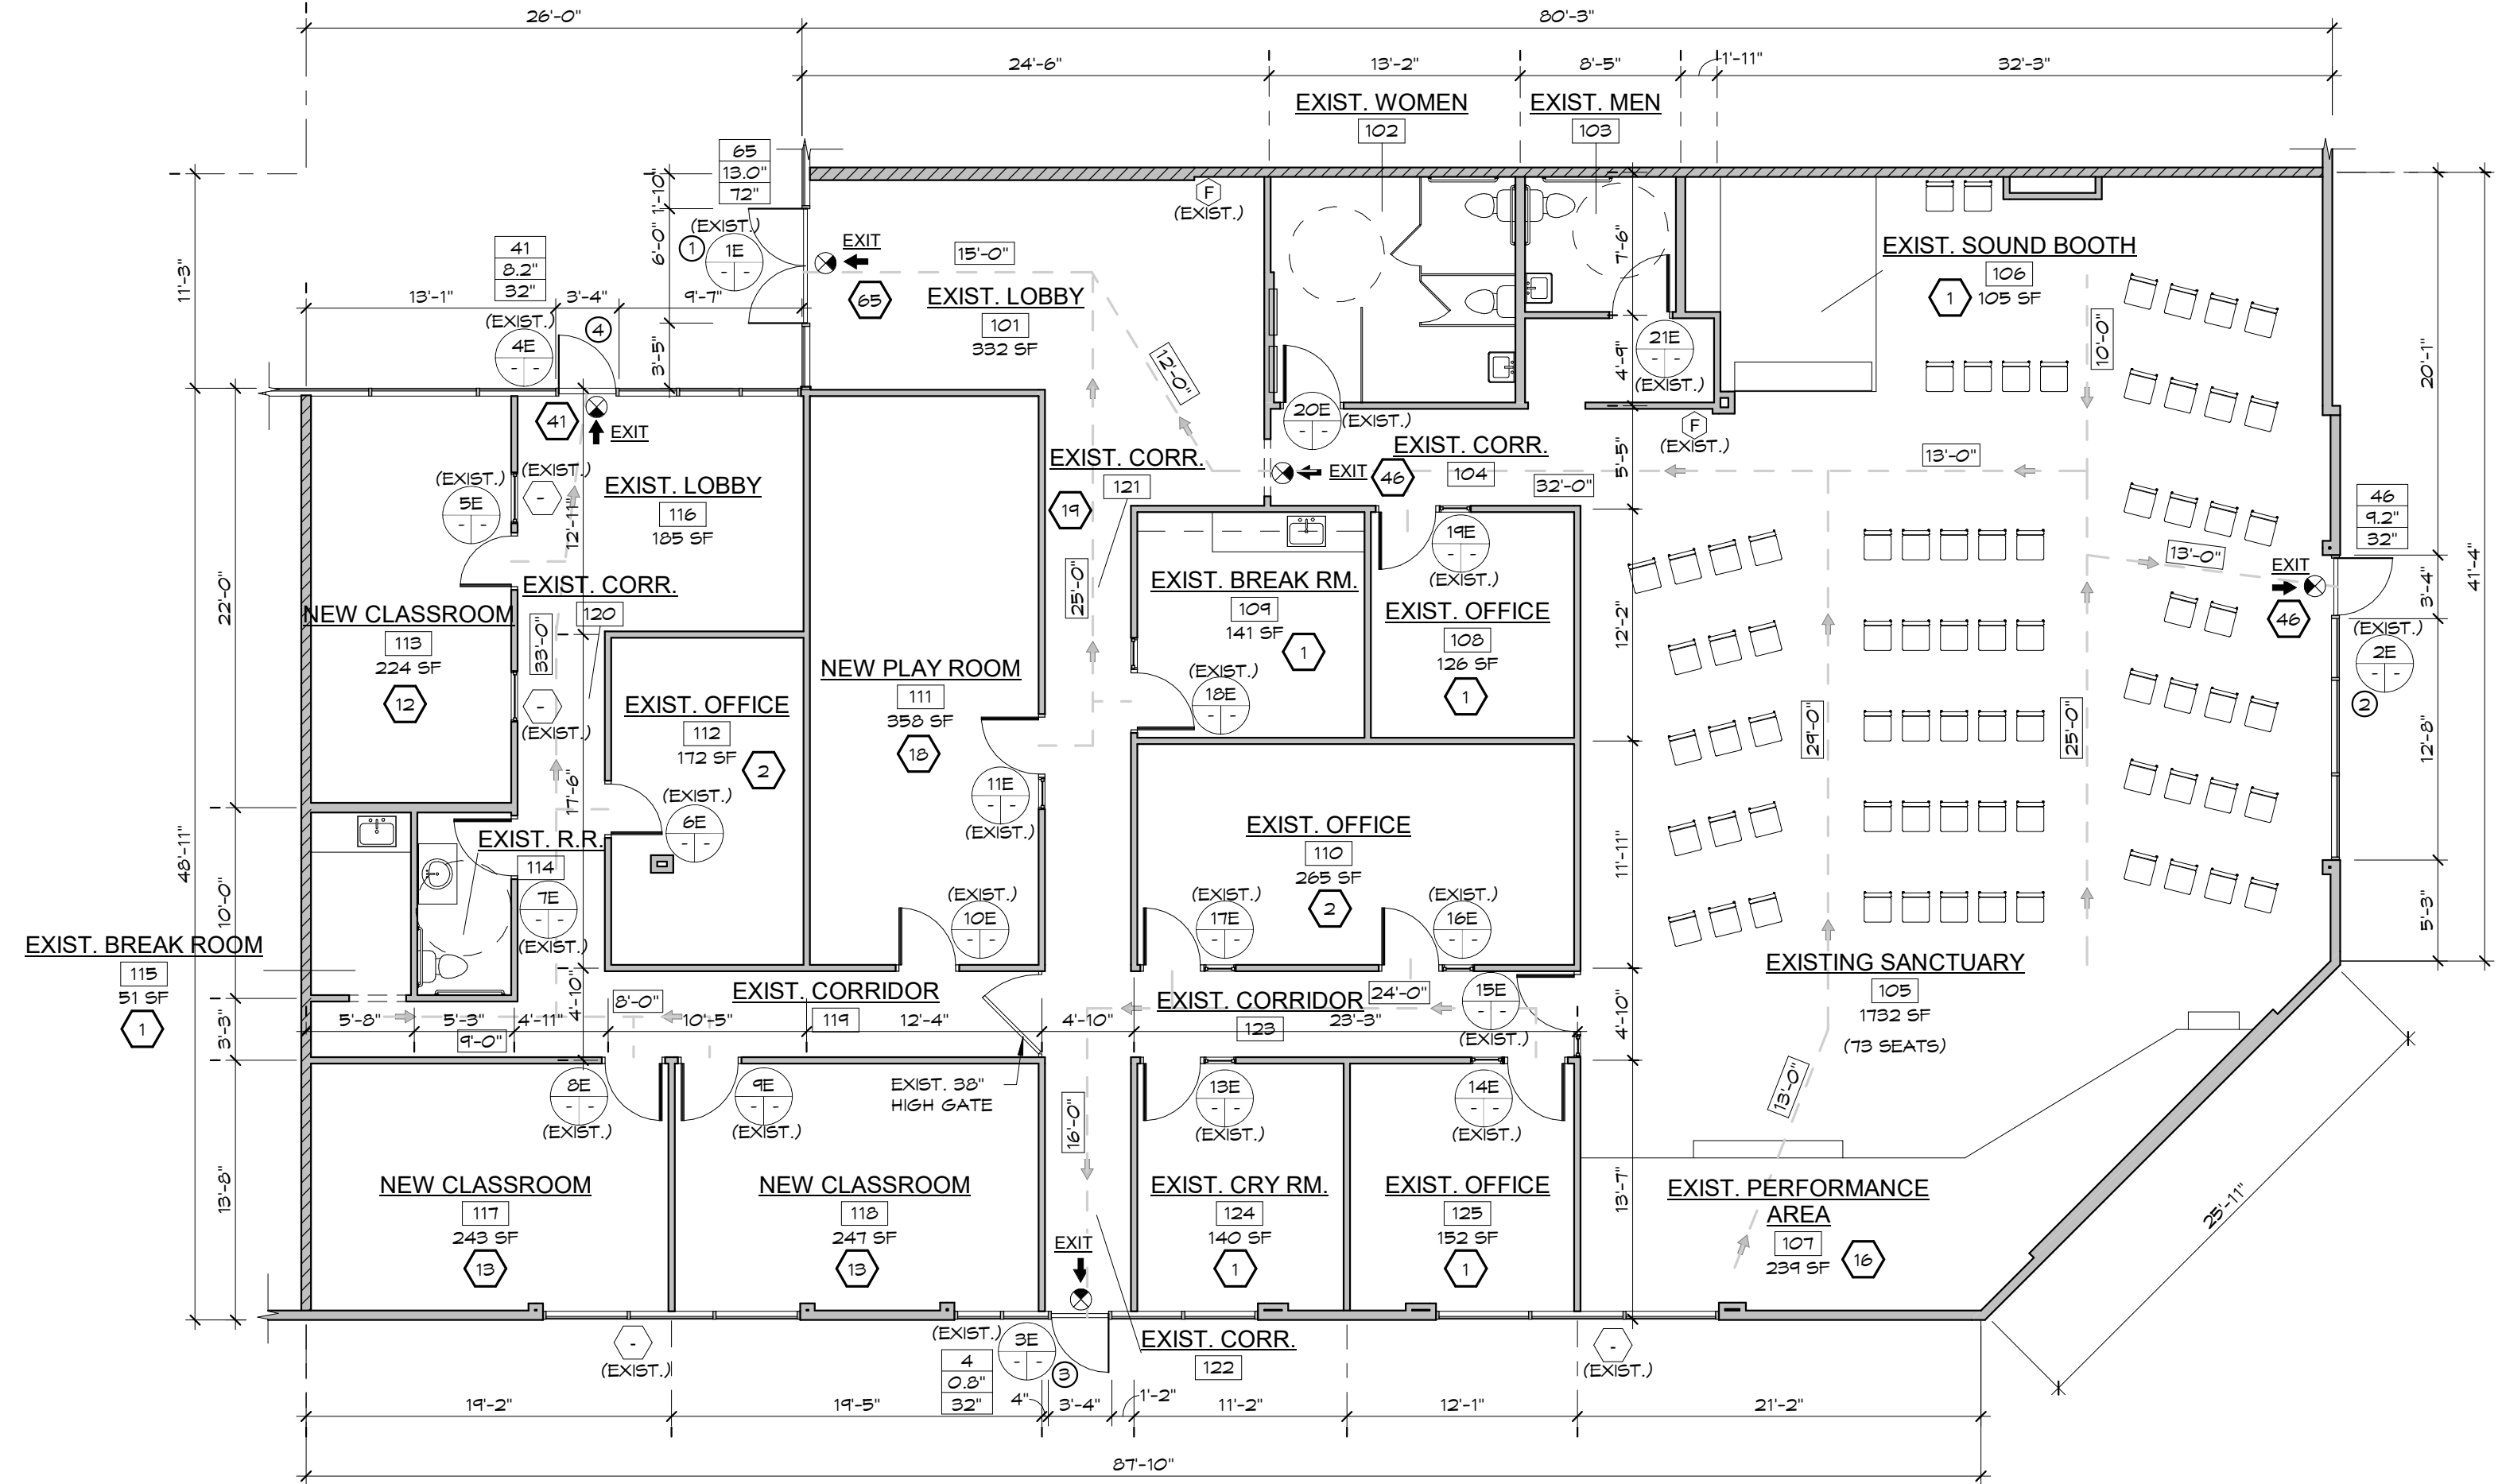

EXISTING FLOOR PLAN



PLUMBING FIXTURE CALCULATIONS:

TOTAL OCCUPANT LOAD = 155
78 MEN, 78 WOMEN

A-3 OCCUPANCY GROUP: PLACES OF WORSHIP

	WC	1/LAV	EDF
MEN	1	1	1
WOMEN	1	1	1

PROVIDED:

MEN: 1 WATER CLOSET, 1 LAV.
WOMEN: 2 WATER CLOSETS, 1 LAV.
UNISEX: 1 WATER CLOSET, 1 LAV.
BUILDING: BOTTLED WATER

LEGEND:

- OCC. LD. - DOOR INFORMATION
- REQD WIDTH - DOOR INFORMATION
- PROVD WIDTH - DOOR INFORMATION
- EXIT - INDICATES EXIT DOOR
- 1 - INDICATES OCCUPANT LOAD PER ROOM
- - - INDICATES PATH OF EXIT TRAVEL
- 247 SF - INDICATES AREA OF ROOM

EXIT WIDTH REQUIRED CALCULATION:

- 1 - DOOR 1E - 65 OCCUPANTS
 $65 \times 0.2 = 13.0' < 12' \text{ O.K.}$
- 2 - DOOR 2E - 46 OCCUPANTS
 $46 \times 0.2 = 9.2' < 32' \text{ O.K.}$
- 3 - DOOR 3E - 4 OCCUPANTS
 $4 \times 0.2 = 0.8' < 32' \text{ O.K.}$
- 4 - DOOR 4E - 41 OCCUPANTS
 $41 \times 0.2 = 8.2' < 32' \text{ O.K.}$

LEGEND:

- 1. EXISTING WALLS TO REMAIN.
- 2. EXISTING DEMISING WALLS TO REMAIN.
- 3. (F) INDICATES EXISTING FIRE EXTINGUISHER - 2A:10BC BRACKET MOUNTED.
- 4. PROVIDE SIGN AT DOOR 1E STATING THIS DOOR TO REMAIN UNLOCKED WHEN BUILDING IS OCCUPIED PER I.B.C. SECT. 1008.1.3, EXCEPTION 2.2.
- 5. ALL EXIT DOORS TO COMPLY IV I.B.C. SEC. 1008.1.4 AND AZ ADAAG REQUIREMENTS.